


ACDR-B

Air-Cooled Chillers with Reciprocating Compressors 21 to 200 Tons



Features

-  **DIRECTOR** microcomputer controller
 - Windows® based PC interface
- ETL/CSA, MEA unit approval pending
 - New high efficiency design
- Compatible with HFC refrigerants
 - Reduced overall length
 - Rated with HCFC-22
 - Quiet operation



 **DUNHAM-BUSH®**

INTRODUCTION



The Dunham-Bush Commitment...

Our commitment to continuous product improvement and quality enhancement could not be more evident than in this new generation of Air Cooled Reciprocating Liquid Chillers...The **ACDR-B**.

New enhanced condenser fins, plus modular construction provide for increased commonality of parts, high unit electrical efficiency, and compact footprint throughout the line. We can build a unit for you in a shorter lead time, while still offering all the optional features mounted, piped and wired to meet your exact needs. In fact, Dunham-Bush is famous for its design flexibility. Our customers find that we can handle special applications where others might turn away.

ACDR-B units feature state-of-the-art full function, PC Windows® based, microcomputer controller standard on all model sizes with an optional tie-in to a building management system. Remote monitoring via optional modem allows instant diagnosis by the user or by a skilled Dunham-Bush technician.


Upon shipment, the new **ACDR-B** unit is installation-ready with its compact size, reduced weight, and complete factory piping and wiring. Refrigerant charge is included and a thorough test under load is conducted on each unit to insure trouble-free start-up operation.

The **ACDR-B**
Delivering on the promise of the Dunham-Bush Commitment

TABLE OF CONTENTS

	Page No.
Introduction	2
Nomenclature	3
Standard Features	4
Unit Features: Compressors	5 - 6
Unit Features: Air Cooled Condensers	7
Unit Features: DX Coolers	7
Windows® Based Microcomputer Controller	8 - 10
Options	11-13
Accessories	13
Unit Construction	14
Application Data	15 - 18
	I. P. S.I.
Selection Procedure	19..... 20
DX Cooler: Water Side Pressure Drop	21..... 21
Performance Data	22 - 31..... 32 - 41
Physical Specifications Model ACDR-B 021S to 035S	42..... 48
Physical Specifications Model ACDR-B 030D to 050D	43..... 49
Physical Specifications Model ACDR-B 052D to 075D	44..... 50
Physical Specifications Model ACDR-B 080D to 102D	45..... 51
Physical Specifications Model ACDR-B 112D to 155D	46..... 52
Physical Specifications Model ACDR-B 170D to 200D	47..... 53
Dimensional Data Model ACDR-B 021S to 027S	54
Dimensional Data Model ACDR-B 030S to 035S	55
Dimensional Data Model ACDR-B 030D to 055D	56
Dimensional Data Model ACDR-B 062D to 080D	57
Dimensional Data Model ACDR-B 085D to 102D	58
Dimensional Data Model ACDR-B 112D to 130D	59
Dimensional Data Model ACDR-B 140D to 170D	60
Dimensional Data Model ACDR-B 180D to 200D	61
Electrical Data	62 - 67
Typical Control Wiring Diagram	68
Typical Power Wiring Diagrams	69 - 70
Typical Sequence of Operations	71
Part Load Information	72 - 73
Product Specifications	74 - 79
Installation Clearance	80

NOMENCLATURE

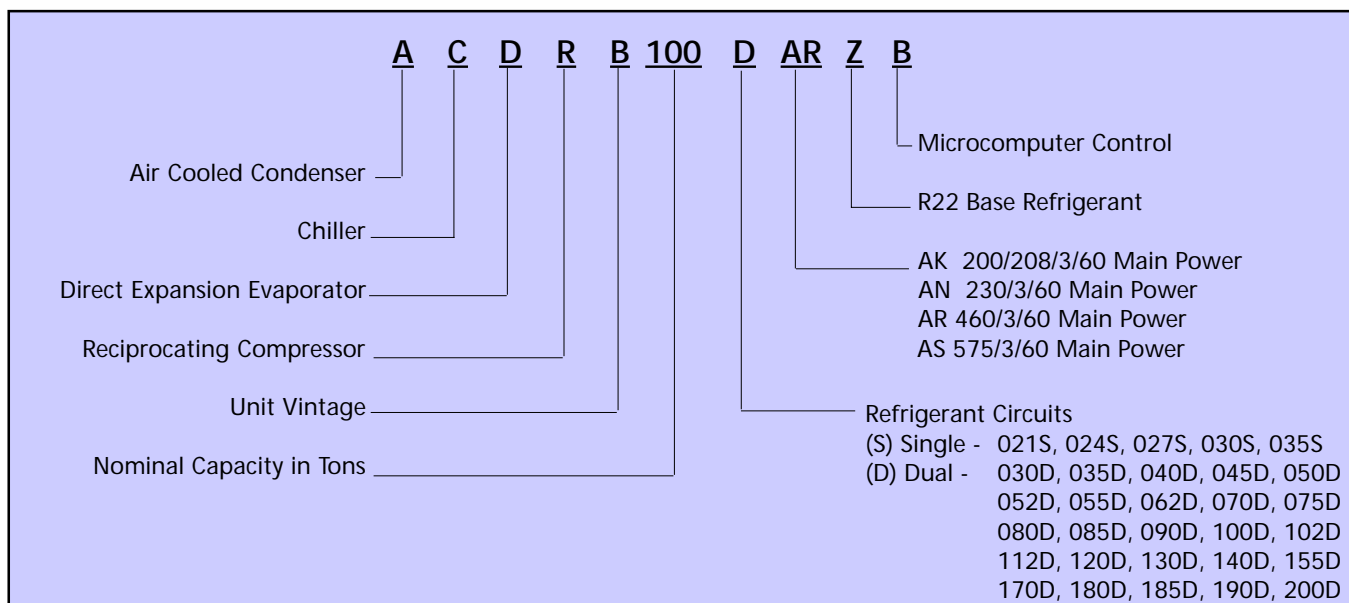

STANDARD FEATURES

Size Range

- 30 Models from 21 to 200 Tons
- High Unit EER at ARI Standard Conditions
- Rated with HCFC-22. Compatible with HFC's (R-407C and R-134a) using Synthetic Oil (Consult Factory)

Compressor

- Reliable Semi-Hermetic Reciprocating Type at 1750 RPM
- (2) Refrigerant Circuits over 27 Tons for Redundancy
- Unloading Compressor under 85 Tons for Energy Savings
- Compressor Cycling of 4 compressors over 85 Tons for Maximum Efficiency
- Optional capacity control steps available over 45 tons

Evaporator

- ASME/CRN Stamped on all Sizes 021S - 200D
- DB High Efficiency Inner Fin Design for Compactness and Weight Reduction
- 300 PSIG or 250 PSIG Refrigerant Side Design Pressure
- 200 PSIG Water Side Design Pressure

Condenser

- Long Life Copper Tubes with Aluminum Fins
- Sub-Cooling Circuit for Efficiency
- 450 PSIG Test Pressure
- Low Noise 30" Diameter Fans - Direct Drive at 1140 RPM
- All Fan Motors Open Drip Proof with Rain Shield for Safety and Low Maintenance
- Minimum Clearance Required on Sizes 021S to 035S

Electrical/Control

- Widest range of optional equipment available
- Proactive Full Function PC Windows® Based Microcomputer Controller on all Sizes 021S to 200D for Precise Control
- Separate Power and Control Panels for Service above Size 035S
- Separate Power and Control Compartments Sizes 021S to 035S
- ETL Unit Approval (IEC Control Panel Available) Pending
- MEA Unit Approval Pending

All compressors also feature individual suction and discharge, manually operated, service valves, oil sight glasses and cartridge type crankcase heaters.

Capacity Control - Modulation of capacity in response to system load requirements is affected by a micro-computer sequence controller which monitors the return water temperature and controls from leaving water temperature.

Compressors are controlled via cylinder unloading and optional hot gas bypass. Cylinder unloading is achieved by shutting off the suction gas supply to one or more cylinder banks resulting in good partload efficiencies. Hot gas bypass operates by imposing an artificial load on the evaporator. Discharge gas from the compressor is introduced to the liquid-vapor mixture of refrigerant

downstream of the expansion valve. The discharge gas is cooled by the liquid refrigerant present in the turbulence of the evaporator so that the final temperature of refrigerant gas leaving the evaporator does not rise. Hot gas bypass does not offer any energy savings, but does allow the cooling capacity of the equipment to vary precisely with the load requirements.


On multiple compressor units, capacity is controlled by a combination of cylinder unloading and compressor staging. See the following table for the type of capacity control furnished as standard with each unit.

All compressors are UL recognized and C.S.A. approved for 60 Hz.

TABLE 6 Package Capacity Control Steps

Model ACDR-B	% Full Load Capacity Control	
	Standard (and Optional HGBP)	Option Capacity Control Steps (and Optional HGBP)
021S	100 - 50 - (25) - OFF	
024S	100 - 50 - (25) - OFF	
027S	100 - 67 - 33 - (17) - OFF	
030S	100 - 67 - 33 - (17) - OFF	
035S	100 - 67 - 33 - (17) - OFF	
030D	100 - 75 - 50 - 25 - (13) - OFF	
035D	100 - 75 - 50 - 25 - (13) - OFF	
040D	100 - 75 - 50 - 25 - (13) - OFF	
045D	100 - 80 - 42 - 21 - (12) - OFF	100 - 80 - 59 - 42 - 21 - (12) - OFF
050D	100 - 82 - 47 - 23 - (12) - OFF	100 - 82 - 59 - 47 - 23 - (12) - OFF
052D	100 - 83 - 50 - 33 - (17) - OFF	100 - 83 - 67 - 50 - 33 - 17 - (9) - OFF
055D	100 - 82 - 54 - 36 - (18) - OFF	100 - 82 - 64 - 54 - 36 - 18 - (9) - OFF
062D	100 - 83 - 50 - 33 - (17) - OFF	100 - 83 - 67 - 50 - 33 - 17 - (9) - OFF
070D	100 - 83 - 50 - 33 - (17) - OFF	100 - 83 - 67 - 50 - 33 - 17 - (9) - OFF
075D	100 - 85 - 46 - 31 - (16) - OFF	100 - 85 - 69 - 46 - 31 - 15 - (8) - OFF
080D	100 - 75 - 50 - 25 - (13) - OFF	100 - 88 - 75 - 50 - 38 - 25 - (13) - OFF
085D	100 - 77 - 50 - 27 - (14) - OFF	100 - 89 - 77 - 64 - 50 - 37 - 27 - (14) - OFF
090D	100 - 78 - 50 - 28 - (14) - OFF	100 - 90 - 78 - 69 - 50 - 40 - 28 - 19 - (10) - OFF
100D	100 - 77 - 50 - 27 - (15) - OFF	100 - 91 - 77 - 68 - 50 - 41 - 27 - 18 - (9) - OFF
102D	100 - 75 - 50 - 25 - (13) - OFF	100 - 92 - 75 - 67 - 50 - 42 - 25 - 17 - (9) - OFF
112D	100 - 77 - 50 - 27 - (14) - OFF	100 - 91 - 77 - 68 - 50 - 41 - 27 - 18 - (9) - OFF
120D	100 - 75 - 50 - 25 - (13) - OFF	100 - 92 - 75 - 67 - 50 - 42 - 25 - 17 - (9) - OFF
130D	100 - 76 - 50 - 26 - (13) - OFF	100 - 91 - 76 - 68 - 50 - 41 - 26 - 18 - (9) - OFF
140D	100 - 75 - 50 - 25 - (13) - OFF	100 - 92 - 75 - 67 - 50 - 42 - 25 - 17 - (9) - OFF
155D	100 - 73 - 50 - 23 - (12) - OFF	100 - 92 - 73 - 65 - 50 - 42 - 23 - (12) - OFF
170D	100 - 75 - 50 - 25 - (13) - OFF	100 - 88 - 75 - 63 - 50 - 38 - 25 - (13) - OFF
180D	100 - 73 - 50 - 23 - (12) - OFF	100 - 89 - 73 - 62 - 50 - 39 - 23 - (12) - OFF
185D	100 - 73 - 50 - 23 - (12) - OFF	100 - 89 - 73 - 62 - 50 - 39 - 23 - (12) - OFF
190D	100 - 75 - 50 - 25 - (13) - OFF	100 - 88 - 75 - 63 - 50 - 38 - 25 - (13) - OFF
200D	100 - 75 - 50 - 25 - (13) - OFF	100 - 88 - 75 - 63 - 50 - 38 - 25 - (13) - OFF

- NOTES: 1 - Sizes 021S - 080D have cylinder unloading on lead compressor only (Extra steps shaded)
 2 - Sizes 085D - 200D have compressor staging standard
 3 - Sizes 045D - 200D cylinder unloading for optional extra unloading steps of capacity control
 This ECCS option is not available on ACDR-B 052D - 075D if "ACM" option is ordered (page 12)
 4 - HGBP = Hot Gas Bypass available on lead compressor only, all units
 5 - HGBP modulates to approximately one half of the preceding unloaded step
 EXAMPLE: ACDR-B 070 w/HGBP (33% x .5 = 17% minimum capacity)
 EXAMPLE: ACDR-B 070 w/optional steps and optional HGBP (17% x .5 = 9% minimum capacity)

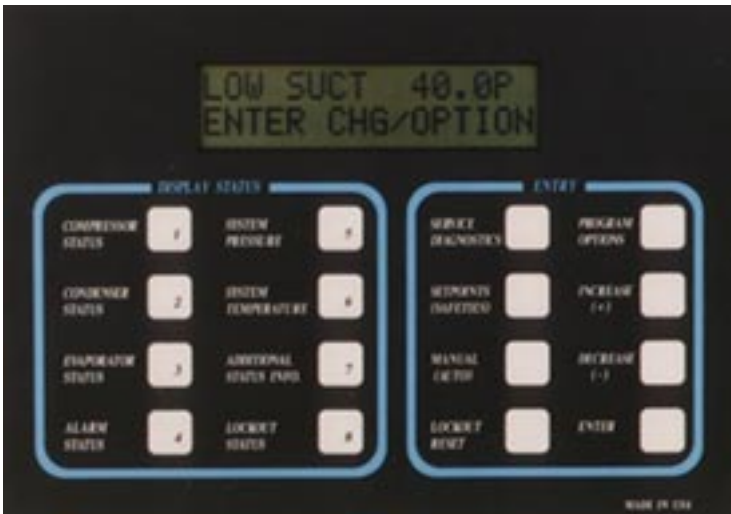

Full Function Microcomputer Controller with Windows® Based PC Interface

Complimenting our high-energy efficient product is a Full Function Microcomputer Controller designed to keep your system running at its most Energy Efficient Level, based on current load.

This system is designed as a Control 'State' (control status) microcomputer providing the user with the current Control State for exact knowledge of what the microcomputer is doing. Some of the main features of the controller are as follows:

- A large character LCD display that can be seen in bright or dim lighting.
- A 16 function keypad that is so user friendly it rarely requires a manual.
- A four-layer printed circuit board provides extremely high quality and unit control stability.
- A battery backed up Real Time Clock that should never need attention.
- An automatic power monitoring system that is designed to protect your system.
- Multiple authorization levels to provide complete security of the control system.
- Automatic history storage that provides data to a flexible static and dynamic graphing system.
- Extended temperature range to allow operation in either hot or cold climates, from -40°F (-40°C) to 140°F (60°C).
- A PC control programming download/pullback in only 45 seconds.
- Alarm information is provided in simple English for the previous 32 alarms, with data shown down to the second.
- The system provides 'last time' enabled & disabled, number cycles, and total run hours.
- A slope algorithm control function with all analogs read 10 times per second provides unparalleled stability.
- A 'fuzzy logic control zone' based on leaving fluid temperature that reduces compressor cycling, and improves unit part load efficiency.
- A proactive compressor protection logic for protecting against low or high discharge pressure to minimize compressor cycling and nuisance trips.
- A Windows® based display providing all pertinent information on your 'PC'.
- A high speed RS232 port operating at 19,200 baud for connection to a local PC up to 100 feet away or a modem at 14,400 baud rate communications for remote communication.
- A high speed RS485 port for connection to a building management system, or PC at 38,400 baud rate communications up to 6000 feet away from the chiller(s).

Display Information

All information is displayed using common terms that are easy to understand. It is a simple procedure to determine the actual status of the system and the individual circuits, as they are displayed in common terms that are meaningful. The 2 line by 16 extra large character alphanumeric liquid crystal display (LCD) utilizes easy to understand menu-driven software. The LCD displays eight character alphanumeric sensor names and twelve character alphanumeric set point names enabling the use of meaningful status names. This enables an inexperienced operator to quickly work through these menus to obtain the information they require or to modify control parameters. The well designed keypad is separated into a *DISPLAY STATUS* section and an *ENTRY* section each consisting of eight keys that are clearly labeled to identify the information that will be displayed. When data is being modified, the second display line contains help information to ensure that the desired modification is properly made. Easily accessible measurements include:

- Current capacity status
- Current circuit/compressor status
- Entering and leaving chilled water temperature
- Evaporator pressure of each refrigerant circuit
- Condenser pressure of each refrigerant circuit
- Compressor elapsed run time, each compressor
- Number of compressor starts
- Compressor contactor status with actual Amp draw
- Fan on/off status
- Remote chilled water reset input (optional)
- Water flow switch status
- External start/stop command status
- Optional low ambient temperature sensor for easier cold ambient starting
- Optional low ambient lockout

Two proactive control features included in the microcomputer are low suction and high discharge pressure unload. Compressor #1 will be unloaded if circuit #1 discharge pressure exceeds the high pressure unload setpoint or if suction pressure from either refrigerant circuit approaches the low-pressure trip setpoint. If there is more than one compressor on a refrigerant circuit, one of the compressors will be shut down under one of these "near-fault" conditions.

Capacity Control

Control is based upon leaving chilled water temperature. How fast the temperature is changing and the rate of change are calculated and capacity decisions are based upon the rate, the current temperature, and the control temperature zone. Capacity is never added if the system is moving toward the temperature target at an acceptable rate. The unit will monitor all control functions and load the compressors to the required operating capacity. Remote adjustment of the leaving chilled water setpoint is accomplished through either direct connection or a remote keypad to the microcomputer through the RS485 long distance differential communications port, via PC or a modem connected to the RS232 communication port, or from an external Building Automation System supplying a simple 0 to 5 VDC signal.

System Control

The unit may be started or stopped manually, or through the use of an external signal from a Building Automation System. In addition, the microcomputer may be programmed with a seven-day optional cycle or other DB control packages may start and stop the system through interconnecting wiring.

System Protection

The following system protection controls will automatically act to insure system reliability:

- Low suction pressure
- High discharge pressure
- High motor temperature/over current
- Freeze protection
- Compressor run error
- Low oil pressure
- Power loss
- Chilled water flow loss
- Sensor error
- Pump down frequency alarm (with no chiller flow)
- Anti-recycle
- Time delay


Remote Monitoring

The Microcomputer is equipped with a high speed RS232 communications port and two high speed RS485 communications ports, to allow for a variety of different remote monitoring operations. The RS232 communications port allows for remote communications at distances of up to 100 feet over a 4-wire shielded cable. The RS485 communication system allows for remote communications at up to 6000 feet with a 2-wire shielded cable connection.

1) RMCT - Remote Mounted Control Terminal (Figure 10A)

This Remote Mounted Control Terminal (RMCT) is a stand alone Control Terminal to communicate and control the unit from a remote location up to 6000 feet away, via the 485 communications port, when wired with a 2-wire shielded cable. This enhanced version of the Remote Mounted Control Terminal with 8 relay outputs and 8 sensor inputs provides remote alarm capabilities and additional sensor inputs as may be required.

Figure 10A

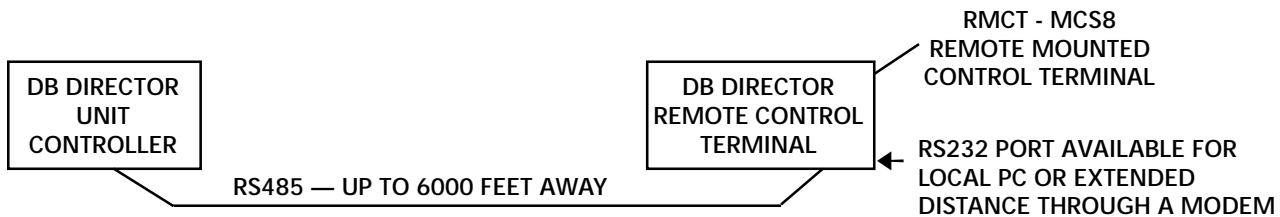

2) PCON - PC Connection:

The PC Connection function provides communications for complete operation of the packaged chiller including graphing information. This option is available through two communications techniques as follows:

a) PCCB (Basic) (Figure 10B)

The standard communications for PCCB is via the RS232 connection which may be as far as 100 feet away from the packaged chiller.


Figure 10B



b) PCCE (Enhanced) (Figure 10C)

The enhanced PCCE system allows for communications via the RS485 port and can be located as far as 6000 feet from the packaged chiller(s). This option requires the addition of a gateway to convert the RS485 port back to a RS232 port and then may be connected to a modem or directly to a PC. One additional feature is that you may field install a manual AB switch, which allows switching between a local PC and a modem.

Figure 10C

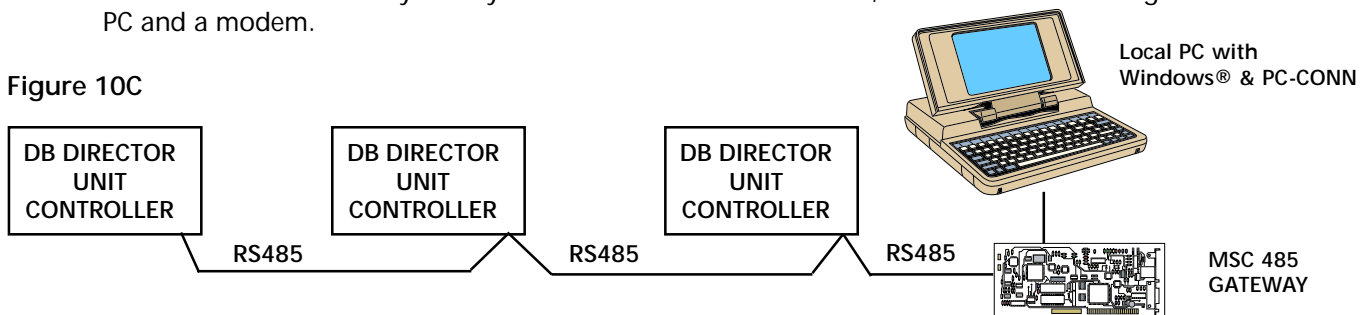

As can be seen, the microcomputer system allows for a variety of remote connection capabilities for almost infinite flexibility. Utilizing the PC connection portion of the system, the unit will support up to twenty packaged chillers connected via the RS485/RS232 ports into the system. The user may then select whichever packaged chiller to review.

OPTIONS

Options are installed at the factory. Accessories are shipped unmounted.

Copper Fin Condenser (CUF) - Copper fin and tube condenser.

Poly fin Condenser (PFC) - The material is a polyester paint baked onto the aluminum finstock prior to final manufacture, rather than material applied to the assembly after formation of the coils. The pre-painted fin material has been tested for salt spray corrosion resistance using ASTM B117 specification.

Oversized Cooler (CH2) - For 42°F (5.5°C) leaving water temperature applications, 20% and higher glycol applications will not require oversized coolers.

Oversized Cooler (CH3) - For 40°F (4.5°C) leaving water temperature applications, 20% and higher glycol applications will not require oversized coolers.

Control Circuit Transformer (TSF) - appropriate KVA rating to power the 115/1/60 control circuit and compressor oil heaters off the service voltage.

Convenience Outlet (CON) - dual 3-prong ground fault receptacle powered from a dedicated transformer and fused for 15 amps.

Hot Gas Bypass (HGB1) - is for circuit #1 only to minimize compressor cycling when the "load" is less than the unit minimum mechanical capacity.

Hot Gas Bypass (HGB2) - is for units ordered with (ALL) automatic circuit-to-circuit lead-lag, and includes HGBP on both refrigerant circuits.

Low Ambient Control (LAC) TO 0°F (-17.8°C) Minimum Ambient - units use variable speed fans in conjunction with standard fan cycling.

Extra Low Ambient Control (ELAC) TO -20°F (-29°C) Minimum Ambient - includes LAC and EEV (Electronic Expansion Valve(s)) options and requires the use of 50% glycol and roughly 50% load to ensure extra low ambient starting, with a maximum of 5 MPH (8 KPH) wind.

Low Ambient Lock-out (LALO) - uses an ambient sensor and requires a lock-out set point entered into the microcomputer controller.

Unit Mounted Disconnect Switch (Non-fused) (UMD1)

- for 200 and 230 volt single/dual power source units ACDR-B 021S thru ACDR-B 090D - single power source ACDR-B 100D thru ACDR-B 200D - dual power source
- mounted in the control box with mechanical interlock through the door.

Unit Mounted Disconnect Switch (Non-Fused) (UMD2)

- for 200 & 230 volt "single point power source" units ACDR-B 100D thru ACDR-B 120D when ordered with (SPPS) "single point power source" option. The disconnect is mounted in the control box with mechanical interlock through the door and circuit breakers mounted and wired.

- for units ACDR-B 130D-200D requiring disconnects and "single point power source", unit mounted disconnects are not available. Refer to (FMD) field mounted disconnects, listed under "Accessories" (shipped loose for field mounting and wiring by others).

Unit Mounted Disconnect Switch (Non-Fused) (UMD3)

- for 460 and 575 volt single point power source units
- mounted in the control box with mechanical interlock through the door, all models ACDR-B 021S-200D.

Operating and Safety Lights (OSL) - lights indicating control power to the unit and faults for high discharge pressure, low evaporator pressure, low oil pressure and high motor temperature and alarm status.

Oil Pressure Reading Through The Microcomputer (OPM) - a low pressure transducer provides sensing for the microcomputer readout.

Gauges (GAG2) - includes suction, discharge and oil pressure for all unit models. The micro computer displays discharge and suction pressure so these readings are redundant. If OPM option is ordered, it may eliminate the need for gauges.

Louvers (Painted Galvanized Steel) (LUV) - for complete unit enclosure for general mechanical security and unit aesthetics.

Grill (Aluminum Painted) (GRL) - similar to the louver option except manufactured of aluminum with 3/8" X 3 1/2" slots instead of louvers for security and hail protection and unit aesthetics.

Fin Guard Top (FGT) (1" x 4" Coated Wire) - protects the vertical condenser side coil only.

Fin Guard Bottom (FGB) (1" x 4" Coated Wire) - encloses the bottom compressor, condenser and cooler section of the unit only. Use FGT and FGB for full unit protection.

Undervoltage and Phase Protection Relay (UVR1) - protects against low incoming voltage conditions as well as single phasing and phase reversal by opening the control circuit. It is an automatic reset device, but the microcomputer can be set up for manual reset to prevent unwanted restarts.

Over and Under Voltage and Phase Protection Relay (UVR2) - protects against high and low incoming voltage conditions as well as single phasing, phase reversal and phase imbalance by opening the control circuit. It is an automatic reset device, but the microcomputer can be set up for manual reset to prevent unwanted restarts.

Part Wind Starting (PWS1 OR PWS2) - this feature provides reduced current draw at start-up.

Circuit Breakers (CB) - provide additional short circuit protection for each compressor.

Single Point Power Source (SPPS) - for 200/230/3/60 and 200/3/50 units

- ACDR-B 100 to 120D - supplied with one main terminal block
- ACDR-B 130 to 200D - supplied with two main terminal blocks
- Circuit breakers are supplied mounted and wired for branch circuit protection, all models ACDR-B 100 to 200D

Electrical Panel Door Latch Solenoids (DLS)

- to provide the security required by local codes. Main power must be disconnected to gain entry to power or control electrical panel for models ACDR-B 021S-035S. On all other models the control panel can be accessed with a keylock override actuated switch. The power must be disconnected to gain entry to the high voltage power panel.

Weather Proof Alarm Bell (BEL2) - mounted and wired to indicate a common alarm fault.

Unit Ground Fault Detector (GFD) - that takes the unit off line if a ground fault is detected.

500 Hour Salt Spray Coating (PNT) - special high-grade outdoor quality coating system tested to maintain integrity under the ASTM-B-117 specification.

Suction Line Insulation (INS) - suggested for medium and low temperature applications.

Electronic Expansion Valves (EEV) - for more precise control over a wide range of operating conditions such as dual mode air conditioning and thermal storage applications. The EEV option is supplied as part of the (ELAC) extra low ambient operation down to -20°F minimum ambient operation.

Remote Monitoring Modem (MOD1) - for single chiller long distance communication, allows the system to be monitored, retrieve logs, and assist with investigating potential problems quickly and in a cost effective manner from a remote source.

Remote Monitoring Modem (MOD2) - for multiple chiller network long distance communication with the same features as MOD1, with the addition of a gateway to convert the RS485 ports for network operation.

ChillerLINK (CHLK) - for communication with (BMS) building management systems through BacNet or Modbus. See ChillerLINK Data Acquisition Form SD202-22203.

Chilled Water Pump Control (CWPC) - provides a contact closure for pump starting prior to starting the chiller.

Mounted and Wired Water Flow Switch (MWFS)

Extra Capacity Control Steps (ECCS) - for models ACDR-B 045D and larger to provide lower minimum unit capacity and intermediate capacity steps, requiring extra compressor unloaders. ECCS option is not available on ACDR-B 052D to ACDR-B 080D if ACM (Auxiliary Control Module) option is ordered.

Auxiliary Control Module (ACM) - this "ACM" module consists of ALL, UDL, LLC, HPL, LPL, and ECCS (where possible) providing a package of special control options that all require extra compressor unloaders and associated hardware. ECCS option is not available on ACDR-B 052D to ACDR-B 080D if ACM option is ordered.

- **ALL** - Auto Lead-Lag is circuit to circuit lead lag, and causes special capacity control steps on units with dissimilar compressors. The two compressor models all have an unloader on circuit number one so an extra unloader is required on circuit number two. The four compressor models with optional extra capacity control steps also require an unloader on circuit two, to provide equal equipment for auto lead-lag.

- **UDL** - Utility Demand Limiting - requires a remote analog input signal that is used to unload or disallow compressors to limit electrical demand. The demand limiting can be one or more stages based on the particular unit configuration. Small units with only two steps of capacity control can only be unloaded one step. The required signal is 0 to 5 VDC.

- **LLC** - Load Limiting Control - requires unloading or multiple compressors per circuit. The decision to limit loading is based on compressor current, rather than return water temperature. This current limiting method of Load Limiting, is superior because it protects the compressor from over current while allowing the unit to run fully loaded when possible.

- **HPL** - High Pressure Limiting - requires unloading or multiple compressors per circuit. The signal to limit loading is discharge pressure approaching high pressure shut-down limit, factory set.

- **LPL** - Low Pressure Limiting - requires unloading or multiple compressors per circuit. The purpose of low pressure limiting is to keep the unit from shutting down on nuisance trips. Early morning start-up situations with close coupled equipment that may not have enough load to get a normal start. The micro will unload the machine and use a time delay to attempt starting.

- **ECCS** - Extra capacity control steps - for models ACDRB 045D, 050D and 085D-200D to provide lower minimum unit capacity and intermediate capacity steps (not available on ACDRB 052D-080D).

ACCESSORIES (SHIPPED LOOSE FOR FIELD MOUNTNG)

Water Flow Switch (WFS) - paddle type field adjustable flow switch available for remote cooler option. Usually tied into the unit safety circuit so that the package will remain off until water flow is proved. Helps prevent cooler freeze up. NEMA 3R enclosure, for use on water or ethylene glycol circuits.

Spring Isolators (SPG) - designed for 1" deflection, these housed spring assemblies have a neoprene friction pad on the bottom to help prevent the passage of noise and a spring locking leveling bolt at the top. Neoprene inserts prevent contact between the steel upper and lower housings. Suitable for more critical applications than RIS isolators.

Rubber-in-shear Isolators (RIS) - designed for ease of installation, these rubber, one piece, molded isolators have skid resistant baseplates. Applicable for most installations.

Weather Proof Bell (BEL1) - is a shipped-loose bell to be mounted remote of the unit and wired to the ALC common alarm contacts in the unit by others.

PC Connection Basic (PCCB) - Provides communications via the RS232 connection port, for complete operation of the packaged chiller, including graphing information, up to 100 feet from the packaged chiller. The PCONN software will be provided for use with a remote PC by others. See connection diagram page 10.

PC Connection Enhanced (PCCE) - Provides communications via the RS485 connection port, for complete operation of the packaged chiller including graphing, up to 6000 feet away. This option requires the addition of a gateway to convert the RS485 port back to RS232 port, and then may be connected to a modem or directly to a PC. One additional feature is that a field supplied and installed AB switch can be added to allow switching between a local PC and a modem. The gateway and PCONN software will be supplied for use with a remote PC by others. See connection diagram page 10.

Remote Monitor-Control Terminal (RMCT) - is a stand alone microcomputer that interfaces with the microcomputer in the unit which provides all unit control functions, at a remote location.

Field Mounted Disconnect Switch (FMD) - (non-fused) for 200 and 230 volt "single point power source" units, ACDR-B 130 to 200 - where "unit mounted disconnects" are not available, the unit (must be ordered with (SPPS) - single point power source option). Circuit breakers are supplied mounted and wired for branch circuit protection. (Field mounting and wiring by others.)


UNIT CONSTRUCTION



Optional plastic coated wire fanguard. Available for upper half of unit (FGT) as shown on page 2, lower half of unit (FGB), or both.



Optional full length painted aluminum grilles (GRL) to protect condenser fins and mechanical components. This option also includes sheet metal enclosure panels for the unit ends.

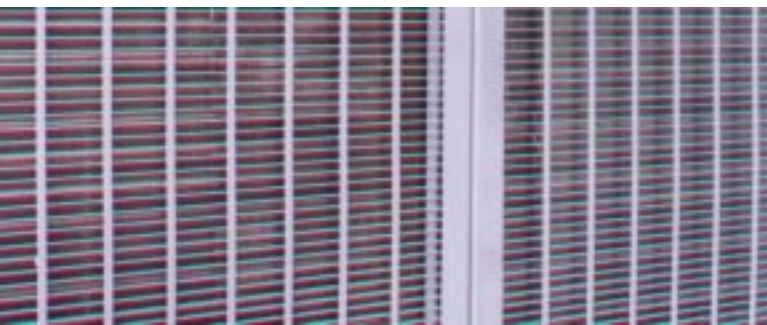

Optional full length painted steel louvers (LUV) for the maximum protection for condenser fins and mechanical components. This option also includes sheet metal enclosure panels for the unit ends.



Standard heavy duty base rails with cross members. Optional electronic expansion valves (EEV) shown.




Optional weatherproof alarm bell (BEL2) to indicate a common alarm fault.

Cooler Design Data

1. **Maximum** - Leaving chilled fluid temperature (LCFT) is 60°F (18°C). The unit can start and pull down with up to 80°F (27°C) entering-water temperature. For sustained operation, it is recommended that the entering water temperature not exceed 70°F (21°C).
2. **Minimum** - LCFT is 42°F (5.5°C) for all models except ACDR-B 035D, 090D, and 112D for *water applications with standard coolers*. Oversized coolers CH1 for 42°F (5.5°C) water on models ACDR-B 035D, 090D and 112D and CH2 for 40°F (4.4°C) water for most models are available from the factory for chilled *water* applications. Medium temperature glycol application selections from 20°F (6.6°C) to 39°F (3.9°C) are available from the factory.
3. Minimum/Maximum Flow Rates and Vessel Fluid Volume - refer to Physical Specifications.
4. Pressure Drop Data - refer to Figure 20 and glycol correction factors, Tables 18A and 18B.
5. Wide Range ΔT - Low Flow Applications
 - a. Multiple smaller chillers may be applied in series, each providing a portion of the design temperature range of roughly 10°F (5.5°C) each.
 - b. Special cooler baffling may be provided from the factory for applications from 12.5°F to 20°F (7°C to 11°C) chiller fluid ranges.
 - c. Chilled fluid may be recirculated through the cooler as shown below to allow the chiller to operate with acceptable flow rates and temperature ranges (Figure 15A).

Figure 15A

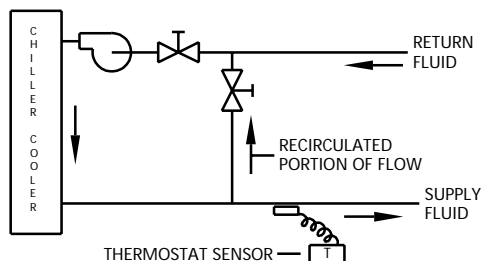


The mixed fluid temperature range through the cooler for units with standard coolers, should not be less than 7.5°F (4.2°C).

6. Narrow Range ΔT - High Flow Applications

- a. Special cooler baffling is available from the factory for 5°F to 7.5°F (2.7°C to 4.2°C) ΔT applications.
- b. For Extra-Narrow Range ΔT applications a partial cooler bypass piping and valve configuration can be used as shown below. This permits a higher ΔT and lower ΔP (pressure drop) through the cooler (Figure 15B).

Figure 15B

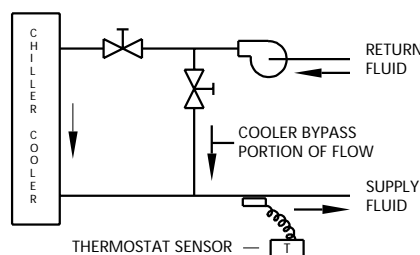

The fluid mixes after the cooler.

Chilled Fluid Loop Volume (CFLV)

Careful consideration needs to be given to the "Chilled Fluid Loop Volume" (CFLV) or System / Inertia to maintain an acceptable leaving fluid temperature.

In close-coupled systems as the compressor starts, loads, unloads and stops, the leaving fluid temperature will shift up and down 2°F to 4°F (1.1°C to 2.2°C) per step of capacity control. The 5-minute anti-recycle timer will prevent the compressor from starting for up to 5 minutes and will further complicate the leaving fluid temperature shift.

Air Conditioning Applications

The chilled fluid loop volume must equal or exceed 3 gallons per nominal ton of cooling (3.25 L per kW).

Process & Special Air Conditioning Applications

Where leaving fluid temperature is often more critical, the chilled fluid loop volume should be increased to 6 to 10 gallons per ton minimum (6.5 to 10.8 L per kW).

Table 16A

Minimum Chilled Fluid Loop Volume*

ACDR-B Model	Air Conditioning Applications		Process Applications				
	Gallons	Liters	Gallons	Liters		Gallons	Liters
021S	63	238	126	477	To	210	795
024S	72	272	144	545	To	240	908
027S	81	307	162	613	To	270	1022
030S	90	340	180	681	To	300	1135
035S	105	397	210	795	To	350	1325
030D	90	340	180	681	To	300	1135
035D	105	397	210	795	To	350	1325
040D	120	454	180	681	To	400	1514
045D	135	511	270	1022	To	450	1703
050D	150	568	300	1135	To	500	1892
052D	156	590	316	1196	To	520	1968
055D	165	624	330	1249	To	550	2082
062D	186	704	372	1408	To	620	2347
070D	210	795	420	1590	To	700	2650
075D	225	852	450	1703	To	750	2839
080D	240	908	480	1817	To	800	3028
085D	255	965	510	1930	To	850	3217
090D	270	1022	540	2044	To	900	3406
100D	300	1135	600	2271	To	1000	3785
102D	306	1158	612	2316	To	1020	3861
112D	336	1272	672	2543	To	1120	4239
120D	360	1363	720	2725	To	1200	4542
130D	390	1476	780	2952	To	1300	4920
140D	420	1590	840	3179	To	1400	5299
155D	465	1760	930	3520	To	1550	5867
170D	510	1930	1020	3861	To	1700	6434
180D	540	2044	1080	4088	To	1800	6813
185D	555	2101	1110	4201	To	1850	7002
190D	570	2157	1140	4315	To	1900	7191
200D	600	2271	1200	4542	To	2000	7570

*Values calculated for ARI Conditions of Service (C.O.S.)


<u>Type of Application</u>	Gal/Ton	L/KW	Gallons = Gal/Ton x ARI Capacity in Tons
Normal Air Conditioning	3	3.25	Liters = L/KW x ARI capacity in KW
Process Cooling	6 - 10	6.5 - 10.8	

For applications other than ARI C.O.S., calculate the system volume based on the adjusted or corrected unit capacity.

Tanks for System Volume Enhancement

It may be necessary to install a tank in the system to provide sufficient system fluid volume. The tank should be baffled and piped for proper fluid mixing to prevent stratification (Figure 16).

Figure 16

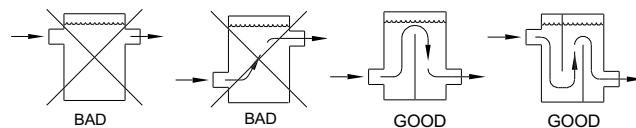

Fouling Factors

The fouling factors used to calculate performance data per ARI Standard 590 is 0.00025 ft.² • Hr • F/BTU (.044 m² • kW). As vessel fouling is increased, both unit capacity and compressor power change. Standard ratings should be corrected using the following multipliers (Table 16B):

Table 16B - Fouling Factors


Fouling Factor		Cooler	
Eng.	S.I.	Cap.	Power
0.00025	0.044	1.000	1.000
0.0005	0.088	.980	.995
0.00075	0.132	.961	.989
0.00100	0.176	.943	.984
0.00175	0.308	.892	.969

The ACDR-B performance tables are based on ARI Standard 590-92 Conditions of Service (C.O.S.) with a 10 range and 0.00025 (.044-SI) FF on the cooler.

Multiple Chillers Per Chilled Water System


1. Where the load is greater than one **ACDR-B** can supply or where standby capacity is required or the load profile dictates, multiple chillers may be piped in parallel. Units of equal size help to ensure fluid flow balance, but balancing valves ensure balanced flows even with dissimilar chillers. Temperature controller sensors may or may not need to be moved to the common fluid piping depending on the specific application.
2. Parallel Chiller Applications **METHOD A** (Figure 17A). Both units operate simultaneously modulating with load variations. Each unit operates independently sensing its own leaving water temperature. The set point of each thermostat is set to maintain the desired loading scheme.

Figure 17A

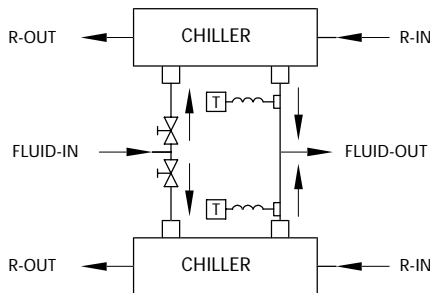


3. Parallel Chiller Applications **METHOD B** (Figure 17B) Install the units the same as in METHOD A, but a third thermostat needs to be added to the common return fluid piping. This thermostat will be set to disable the second unit when the load drops below 50%. When this condition is reached, the leaving mixed fluid temperature will rise, causing the return fluid temperature to rise and the first unit will load up. The disabled unit is sequenced to start again before full system load temperature is reached. The advantage of METHOD B is a better part load efficiency, but it will not provide as stable an operation as METHOD A.

Figure 17B

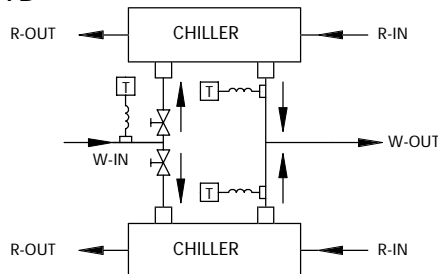

4. Series Chiller Applications (Figure 17C) Where a large temperature range is required (over 25°F [13.9°C]), the chiller may be piped in series. In this case the units are controlled independently. The load is progressive by temperature so the chiller selections are critical.

Figure 17C

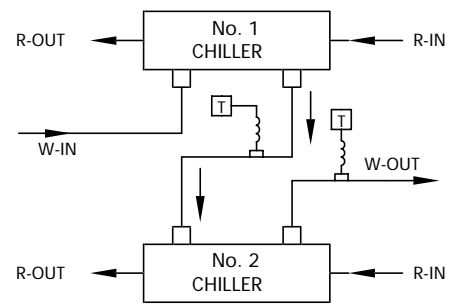

Oversizing Chillers

Oversizing of chillers more than 5-10% is not recommended. Oversizing causes energy inefficiency and shortened compressor life due to excessive compressor cycling. Larger future load requirements may cause temporary oversizing of equipment which will require careful unit selection. It may be better to properly size for the present load and add another unit later for future expansion. It is also recommended using multiple units where operation at minimum load is critical. Fully loaded equipment operates better and more efficiently than large equipment running at or near minimum capacity.

Hot gas bypass should not be a means to allow oversizing of chillers. Hot gas bypass should only be used where the equipment is sized properly for full load but the load turn down is less than the minimum unloading step available. See Page 6 for estimated hot gas bypass turndown.

Part-wind Start

Part-wind start is not normally required on **ACDR-B**'s due to the low inrush current requirements of small HP compressors but is available as an option, if required. See Electrical Data, Pages 62, 64 and 66.

Sound and Vibration

ACDR-B compressors are solid mounted to the frame to absorb sound and vibration in the mass of the unit. Spring mounted compressors are more prone to line breakage and refrigerant leaks. Compressor discharge chambers are built into the heads of the compressors as well as discharge mufflers are supplied standard for smooth, quiet operation. Unit isolation prevents any remaining sound or vibration from entering the building structure, piping or electrical service.

Water (Fluid) Strainers

It is recommended that 40-mesh strainers be installed in the fluid piping as close to unit cooler as possible.

Glycol Freeze Protection

If the chiller or fluid piping may be exposed to temperatures below freezing, glycol protection is recommended. The recommended protection is 15°F (8.3°C) below the minimum ambient temperature. Use only glycol solutions approved for heat exchanger duty. The use of automotive anti-freeze is not recommended because they have short-lived inhibitors and fouling of the vessels will occur. If the equipment is exposed to freezing temperature and not being used, the vessels and piping should be drained.

Cooler heaters are provided for protection down to -20°F (-29°C) minimum ambient but piping must be protected. A separate 115V service is required for this protection.

If the equipment is being used for operating conditions below the water rated vessel capability, glycol should be used to prevent freeze damage. The freeze protection level should be 20°F (11°C) lower than the leaving brine temperature. The use of glycol causes a performance derate as shown below in Table 18A for ethylene glycol and Table 18B for propylene glycol and needs to be included in the unit selection procedure.

Table 18A

Ethylene Glycol

% E.G.	FREEZE POINT		C1 CAPACITY FACTOR	K1 kW FACTOR	G1 FLOW RATE	P1 P.D. FACTOR
	°F	°C				
10	26.2	-3.2	0.995	0.998	1.019	1.050
15	22.4	-5.3	0.991	0.997	1.030	1.083
20	17.8	-7.9	0.988	0.996	1.044	1.121
25	12.6	-10.8	0.984	0.995	1.060	1.170
30	6.7	-14.1	0.981	0.994	1.077	1.219
35	0.0	-17.8	0.977	0.992	1.097	1.275
40	-8.0	-25.8	0.973	0.991	1.116	1.331
45	-17.5	-27.5	0.968	0.990	1.138	1.398
50	-28.9	-33.8	0.964	0.989	1.161	1.466

Table 18B

Propylene Glycol

% P.G.	FREEZE POINT		C2 CAPACITY FACTOR	K2 kW FACTOR	G2 FLOW RATE	P2 P.D. FACTOR
	°F	°C				
10	26.1	-3.3	0.988	0.994	1.005	1.019
15	22.8	-5.1	0.984	0.992	1.008	1.031
20	19.1	-7.2	0.978	0.990	1.010	1.051
25	14.5	-9.7	0.970	0.988	1.015	1.081
30	8.9	-12.8	0.962	0.986	1.021	1.120
35	2.1	-16.6	0.952	0.981	1.033	1.163
40	-6.4	-21.3	0.943	0.978	1.043	1.213
45	-16.6	-27.0	0.933	0.975	1.057	1.269
50	-28.9	-33.8	0.924	0.972	1.073	1.326

SELECTION PROCEDURE: ENGLISH I.P. UNITS 60 Hz.....

EXAMPLE

Select an air cooled packaged chiller for the following conditions of service:

50 Tons at 55°F entering, 45°F leaving chilled water. Design ambient is 95°F. Minimum operating ambient is 50°F. Altitude is 6000 feet. Evaporator fouling is .00025. Electrical characteristics are 460/3/60. Unit to use 40% ethylene glycol by weight. (NOT ARI CERTIFIED)

Step 1 - Unit Selection

For 6000 feet elevation, divide the required tonnage by the altitude correction factor from Table 19A.

$$\frac{50}{.97} = 51.5 \text{ Tons}$$

To correct for evaporator fouling, consult Table 19B. In this example, the fouling factor is .00025 which has a capacity factor of 0.992 and a kW factor of 0.997, so the capacity correction is as follows:

$$\frac{51.5 \text{ Tons}}{.992} = 51.9 \text{ Tons}$$

To correct for 40% E.G., consult Table 18A for a correction factor and make the following adjustment.

$$\frac{51.9}{.973} = 53.3 \text{ Tons}$$

Entering the tables on page 24, we see that an ACDR-B 052D for water at sea level will do 54.2 tons drawing 60.3 compressor kW.

The unit will do the following, when corrected for altitude fouling and ethylene glycol

$$\text{Capacity } 54.2 \times .992 \times .973 \times .97 = 50.7 \text{ Tons}$$

which exceeds the original requirement.

Compressor kW needs to be adjusted from Table 18A by factor K1 and Table 19B for 0.00025 fouling as follows:

$$60.3 \text{ kW} \times .991 \times .997 = 59.6 \text{ kW}$$

Step 2 - Cooler GPM and Pressure Drop

$$\text{Water GPM} = \frac{\text{Tons (water)} \times 24}{\text{Cooling Range}} = \frac{50 \times 24}{10} = 120 \text{ GPM}$$

Correcting flow rate for glycol from Table 18A:

$$\text{GPM} = 120 \times 1.116 = 133.92 \text{ (E.G.) GPM}$$

Referring to pressure drop curve #9 on page 21 for the evaporator pressure drop, we see a 8.8 feet of water pressure drop for 120 GPM of water.

Correcting pressure drop for glycol from Table 18A:

$$\text{PD. (EG)} = 8.8 \text{ ft. of water} \times 1.331 = 11.7 \text{ ft. of water}$$

$$\text{PSI} = \text{Feet of water} \times .433$$

TABLE 19A

Elevation above Sea Level (ft.)	Capacity Factor
0	1.00
2000	.99
4000	.98
6000	.97

TABLE 19B

Evaporator Fouling Factor (hr-ft- F/BTU)	Capacity Factor	kW Factor
.0001	1.000	1.000
.00025	0.992	0.997
.0005	0.978	0.990
.001	0.951	0.978

TABLE 19C

Unit Model Size	Cooler Curve No. for Table 19		
	Std CH1	CH2 42°F(CLR)	CH3 40°F(CLR)
021S	1	1	1
024S	1	1	1
027S	1	1	23
030S	2	2	24
035S	3	3	24
030D	25	25	26
035D	25	6	8
040D	6	6	8
045D	7	7	11
050D	9	9	11
052D	9	9	11
055D	9	9	11
062D	10	10	28
070D	10	10	28
075D	12	12	28
080D	12	12	28
085D	13	13	27
090D	13	14	29
100D	14	14	29
102D	14	14	29
112D	14	15	30
120D	16	16	21
130D	16	16	21
140D	16	16	21
155D	18	18	31
170D	20	20	31
180D	20	20	22
185D	22	22	22
190D	20	20	22
200D	22	22	22

SELECTION PROCEDURE: METRIC S.I. UNITS 60 Hz.....

EXAMPLE

Select an air cooled packaged chiller for the following conditions of service:

175 kWo at 13°C entering, 7°C leaving chilled water. Design ambient is 35°C. Minimum operating ambient is 10 C. Altitude is 1800 meters. Evaporator fouling is .044. Electrical characteristics are 460/3/60. Unit to use 40% ethylene glycol by weight. (NOT ARI CERTIFIED)

Step 1 - Unit Selection

For 1800 meters elevation, divide the required capacity by the altitude correction factor from Table 20A.

$$\frac{175}{.97} = 180.4 \text{ kWo}$$

To correct for evaporator fouling, consult Table 20B. In this example, the fouling factor is .044 which has a capacity factor of 0.992 and a kW factor of 0.997, so the capacity correction is as follows:

$$\frac{180.4 \text{ kWo}}{.992} = 181.8 \text{ kWo}$$

To correct for 40% E.G., consult Figure 18A for a correction factor and make the following adjustment.

$$\frac{181.8}{.973} = 186.8 \text{ kWo}$$

Entering the tables on page 34, we see that an ACDR-B 052D for water at sea level will do 188.6 kWo drawing 60.0 compressor kW.

The unit will do the following, when corrected for altitude and ethylene glycol

$$\text{Capacity } 188.6 \times .992 \times .973 \times .99 = 180.2 \text{ kWo}$$

which exceeds the original requirement.

Compressor kW needs to be adjusted from Table 18A by factor K1 and Table 20B for 0.044 fouling as follows:

$$60.0 \text{ kW} \times .991 \times .997 = 59.3 \text{ kW}$$

Step 2 - Cooler Flow Rate and Pressure Drop

$$\text{Water Flow Rate} = \frac{\text{kWo(water)}}{4.187 \times \text{Range}} = \frac{175 \text{ kWo}}{4.187 \times 6} = 6.97 \text{ Lit./sec.}$$

Correcting flow rate for glycol from Table 18A:

$$\text{Flow Rate} = 6.97 \times 1.116 = 7.78 \text{ (E.G.) Liters/sec.}$$

Referring to pressure drop curve #9 on page 21 for the evaporator pressure drop, we see a 22.5 kPa pressure drop for 6.97 Liters/sec. of water.

Correcting pressure drop for glycol from Table 18A:

$$\text{P.D. (EG)} = 22.5 \text{ kPa} \times 1.331 = 29.95 \text{ kPa}$$

TABLE 20A

Elevation above Sea Level (m)	Capacity Factor
0	1.00
600	.99
1200	.98
1800	.97

TABLE 20B

Evaporator Fouling Factor (M ² °C kW ⁻¹)	Capacity Factor	kW Factor
0.018	1.000	1.000
0.044	0.992	0.997
0.088	0.978	0.990
0.176	0.951	0.978

TABLE 20C

Unit Model Size	Cooler Curve No. for Table 19		
	Std CH1	CH2 5.5°C (CLR)	CH3 4.5°C (CLR)
021S	1	1	1
024S	1	1	1
027S	1	1	23
030S	2	2	24
035S	3	3	24
030D	25	25	26
035D	25	6	8
040D	6	6	8
045D	7	7	11
050D	9	9	11
052D	9	9	11
055D	9	9	11
062D	10	10	28
070D	10	10	28
075D	12	12	28
080D	12	12	28
085D	13	13	27
090D	13	14	29
100D	14	14	29
102D	14	14	29
112D	14	15	30
120D	16	16	21
130D	16	16	21
140D	16	16	21
155D	18	18	31
170D	20	20	31
180D	20	20	22
185D	22	22	22
190D	20	20	22
200D	22	22	22

DX COOLER: WATER SIDE PRESSURE DROP

ENGLISH I.P. AND METRIC S.I. UNITS

Figure 21

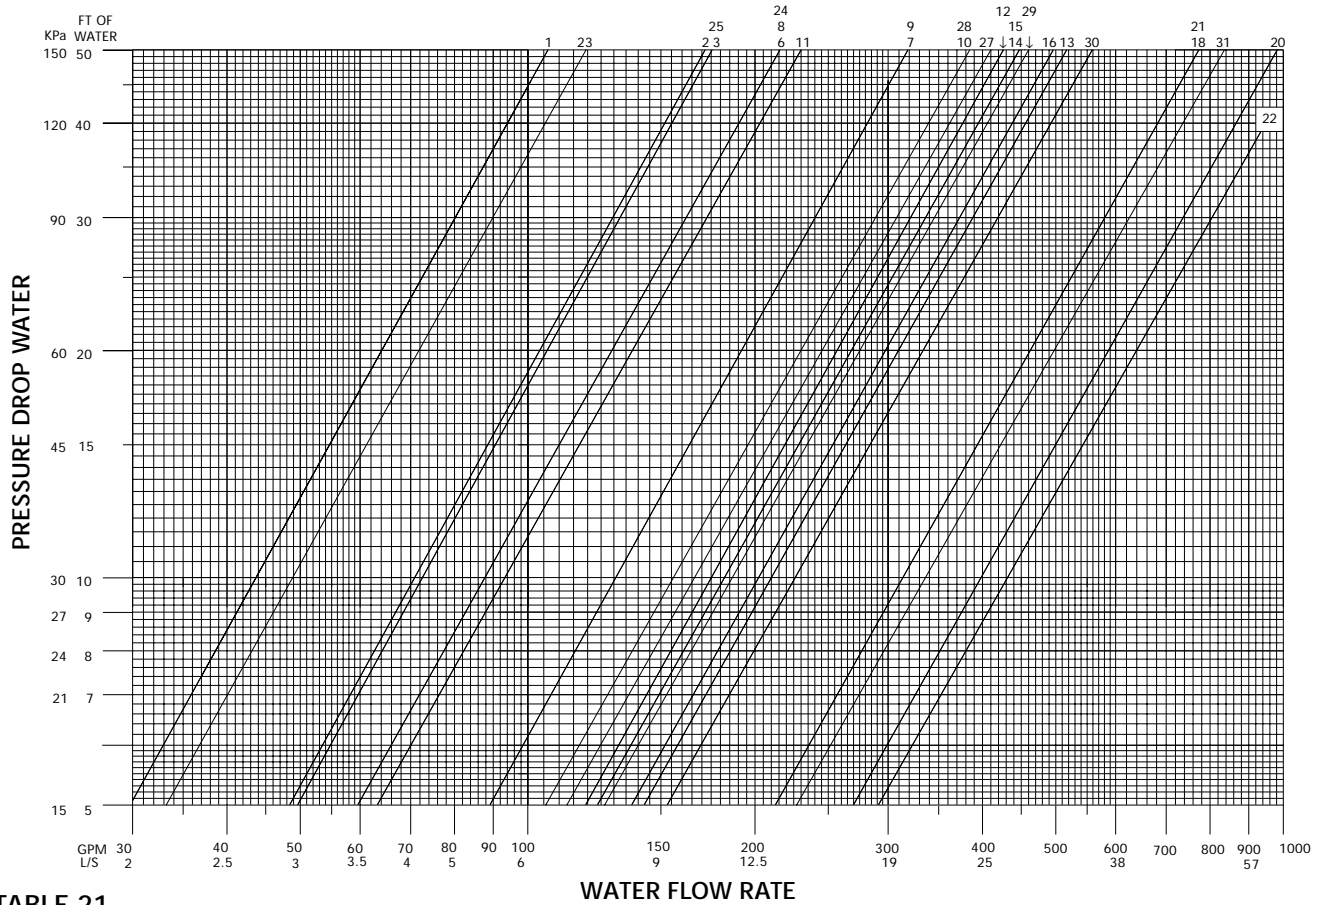


TABLE 21

Curve No.	Cooler		English I.P. Units		Metric S.I. Units	
	Model	*Conn. Size	Minimum GPM	Maximum GPM	Min. Lit./Sec.	Max. Lit./Sec.
1	CHS007601A	3" NPTE	37	101	2.34	6.39
2	CHS007601B	3" NPTE	50	164	3.16	10.38
3	CHS008601A	3" NPTE	56	168	3.54	10.63
23	CHS008602A	3" NPTE	42	114	2.66	7.21
24	CHS010601A	4" NPTE	62	205	3.92	12.97
25	CHD008601A	3" NPTE	56	168	3.54	10.63
6	CHD010601A	4" NPTE	62	205	3.92	12.97
26	CHD010602A	4" NPTE	47	116	2.97	7.34
7	CHD010601B	4" NPTE	78	315	4.93	19.23
8	CHD011601A	4" NPTE	69	206	4.37	13.03
9	CHD011601B	4" NPTE	86	304	5.44	19.23
10	CHD012601B	4" NPTE	94	367	5.94	23.22
11	CHD013601A	4" NPTE	80	220	5.06	13.92
12	CHD013601B	4" NPTE	101	407	6.39	25.75
13	EXD12102J07	4" VIC	158	444	10.00	28.09
14	EXD12122J09	4" VIC	153	442	9.68	27.96
15	EXD14102J09	5" VIC	140	440	8.86	27.84
16	EXD14122J09	5" VIC	169	484	10.69	30.62
27	EXD14122J11	5" VIC	140	391	8.86	24.74
28	EXD16092J11	6" VIC	116	366	7.34	23.16
18	EXD16122J07	6" VIC	236	697	14.93	44.10
29	EXD16122J11	6" VIC	159	443	10.06	28.03
20	EXD18122J07	8" VIC	267	1060	16.89	67.07
21	EXD18122J09	8" VIC	213	740	13.48	46.82
30	EXD18122J11	8" VIC	177	604	11.20	38.22
22	EXD20122J07	10" VIC	298	816	18.54	51.63
31	EXD20122J09	10" VIC	237	800	14.99	50.62

*Non-metric compliance

PERFORMANCE DATA: ENGLISH I. P. UNITS

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		85°F				95°F				105°F			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
40	021SZB	21.1	19.6	11.1	12.8	19.8	21.2	9.7	12.1	18.4	22.6	8.6	11.5
	024SZB	24.2	24.1	10.6	12.2	22.6	25.8	9.4	11.5	21.1	27.6	8.2	11.0
	**027SZB	27.8	27.1	11.0	13.1	26.0	29.0	9.7	12.4	24.2	30.8	8.5	11.7
	**030SZB	33.0	31.9	10.8	12.3	30.8	34.3	9.4	11.7	28.7	36.8	8.3	11.0
	**035SZB	36.0	35.4	10.8	12.3	33.6	38.1	9.4	11.7	31.3	40.8	8.2	11.0
	**030DZB	32.6	29.8	11.6	12.9	30.2	32.2	10.1	13.5	27.9	34.4	8.7	12.7
	**035DZB	38.4	36.3	11.5	14.2	35.8	39.2	10.0	13.3	33.2	41.9	8.7	12.6
	**040DZB	42.1	39.2	11.1	12.2	39.5	42.3	9.7	12.7	36.8	45.2	8.6	12.1
	**045DZB	49.0	47.2	11.0	12.3	45.8	50.6	9.6	12.9	42.6	53.9	8.5	12.3
	**050DZB	52.4	51.3	10.9	13.1	48.9	54.9	9.6	12.4	45.5	58.5	8.4	11.8
	**052DZB	54.9	55.0	10.7	12.5	51.4	58.6	9.5	11.7	47.7	62.2	8.3	11.0
	**055DZB	58.9	60.6	10.5	11.8	55.0	64.8	9.3	11.0	51.3	68.9	8.2	11.0
	**062DZB	66.1	63.9	10.8	12.4	61.5	68.6	9.4	11.5	56.9	73.3	8.2	11.2
	**070DZB	72.3	72.2	10.6	12.0	67.1	77.4	9.2	11.6	62.1	82.6	8.1	10.9
	**075DZB	78.3	78.9	10.6	12.0	72.8	84.6	9.3	11.8	67.4	90.1	8.1	10.9
	**080DZB	84.0	87.0	10.4	11.8	78.2	93.0	9.2	10.9	72.4	98.7	8.0	10.2
	**085DZB	90.5	88.1	10.8	12.6	84.5	94.6	9.4	11.8	78.5	100.8	8.3	11.1
	**090DZB	98.1	94.2	11.0	12.8	91.5	100.9	9.7	12.5	84.9	107.4	8.5	11.9
	**100DZB	104.3	104.3	10.7	12.6	97.2	111.4	9.4	11.8	90.2	118.4	8.3	11.7
	**102DZB	110.0	109.9	10.8	12.6	102.7	117.2	9.5	11.8	95.3	124.3	8.3	11.1
**112DZB	122.1	119.0	10.9	13.3	113.7	127.5	9.5	12.6	105.4	135.8	8.3	12.0	
**120DZB	130.1	132.0	10.5	13.1	121.1	141.4	9.2	12.4	112.4	150.7	8.1	11.8	
**130DZB	136.7	138.1	10.6	13.2	127.2	148.2	9.3	12.5	118.0	158.0	8.1	11.8	
**140DZB	143.2	143.8	10.5	12.9	133.3	154.4	9.2	12.2	123.6	164.8	8.1	11.6	
**155DZB	159.8	159.2	10.7	13.3	149.0	171.0	9.4	12.6	138.4	182.3	8.2	11.9	
**170DZB	171.4	175.6	10.6	12.9	160.1	188.1	9.3	12.1	148.6	200.0	8.1	11.5	
**180DZB	186.9	196.0	10.3	12.6	174.8	209.0	9.1	11.9	162.8	221.2	8.0	11.3	
185DZB	186.9	196.0	10.3	12.6	174.8	209.0	9.1	11.9	162.8	221.2	8.0	11.3	
**190DZB	201.6	222.1	9.9	12.1	188.7	235.2	8.8	11.5	176.2	247.4	7.8	11.0	
200DZB	201.6	222.1	9.9	12.1	188.7	235.2	8.8	11.5	176.2	247.4	7.8	11.0	
42	021SZB	21.9	19.9	11.4	13.2	20.5	21.5	10.0	12.5	19.2	23.0	8.8	11.8
	024SZB	25.1	24.5	10.9	12.5	23.5	26.3	9.6	11.8	21.9	28.1	8.4	11.3
	027SZB	28.0	27.2	11.1	13.3	26.2	29.1	9.7	12.6	24.4	30.9	8.6	11.9
	030SZB	32.2	31.6	10.6	12.3	30.1	34.0	9.3	11.6	28.0	36.4	8.2	11.0
	035SZB	36.3	35.5	10.8	12.5	33.9	38.3	9.5	11.8	31.6	41.0	8.3	11.1
	030DZB	32.6	29.8	11.7	12.9	30.3	32.2	10.1	13.6	28.0	34.5	8.8	12.8
	*035DZB	38.8	36.5	11.6	14.3	36.2	39.4	10.1	13.4	33.6	42.1	8.8	12.7
	040DZB	42.4	39.3	11.1	12.2	39.8	42.4	9.8	12.8	37.1	45.4	8.6	12.1
	045DZB	47.8	46.7	10.8	12.2	44.8	50.1	9.5	12.8	41.7	53.3	8.4	12.1
	050DZB	52.8	51.5	10.9	13.2	49.3	55.2	9.6	12.5	45.9	58.8	8.5	11.9
	052DZB	55.3	55.1	10.8	12.5	51.8	58.8	9.5	11.8	48.1	62.5	8.4	11.1
	055DZB	59.1	60.8	10.6	11.8	55.3	65.0	9.3	11.0	51.7	69.2	8.2	11.1
	062DZB	65.4	63.5	10.7	12.3	61.0	68.4	9.4	11.4	56.7	73.2	8.2	11.2
	070DZB	70.9	71.6	10.5	11.9	66.1	76.9	9.2	11.5	61.5	82.2	8.0	10.9
	075DZB	77.7	78.7	10.6	12.0	72.6	84.5	9.3	11.7	67.4	90.1	8.1	10.9
	080DZB	82.9	86.5	10.4	11.7	77.5	92.6	9.1	10.9	72.1	98.5	8.0	10.2
	085DZB	89.4	87.7	10.7	12.6	83.4	94.0	9.4	11.7	77.3	100.1	8.2	11.0
	*090DZB	97.3	93.9	10.9	12.8	90.9	100.6	9.6	12.5	84.5	107.1	8.5	11.9
	100DZB	103.1	103.8	10.6	12.5	96.3	110.9	9.3	11.7	89.5	117.9	8.2	11.7
	102DZB	108.7	109.3	10.7	12.5	101.6	116.6	9.4	11.8	94.4	123.7	8.3	11.0
*112DZB	119.4	117.8	10.7	13.1	111.2	126.2	9.4	12.5	103.1	134.3	8.2	11.8	
120DZB	129.1	131.6	10.5	13.0	120.4	141.1	9.2	12.4	112.0	150.5	8.1	11.8	
130DZB	135.2	137.5	10.6	13.1	126.2	147.6	9.3	12.4	117.3	157.6	8.1	11.8	
140DZB	141.3	143.0	10.5	12.8	131.9	153.7	9.2	12.2	122.7	164.2	8.0	11.5	
155DZB	155.6	157.3	10.6	13.2	145.4	169.1	9.3	12.4	135.2	180.3	8.1	11.8	
170DZB	171.2	175.5	10.6	12.9	159.9	188.0	9.3	12.1	148.5	200.0	8.1	11.5	
180DZB	186.8	196.0	10.3	12.6	174.8	209.0	9.1	11.9	162.9	221.3	8.0	11.3	
185DZB	194.1	199.5	10.5	12.9	181.6	213.0	9.3	12.1	169.2	225.7	8.2	11.5	
190DZB	200.9	221.8	9.9	12.1	188.2	235.0	8.8	11.5	175.8	247.3	7.8	11.0	
200DZB	208.4	226.4	10.1	12.3	196.0	240.0	9.0	11.7	183.2	252.6	8.0	11.2	

- NOTES: (1) Double asterisk (**) indicates ratings with CH3 oversized evaporator for 40°F LWT
(2) Asterisk (*) indicates ratings with CH2 oversized evaporator for 42°F LWT
(3) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
(4) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
(5) Interpolation between ratings is permissible but extrapolation is not
(6) KW is for compressor only. EER is for entire unit. See Physical Specs for fan kW

PERFORMANCE DATA: ENGLISH I. P. UNITS

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		115°F				120°F (See Note 6)				125°F (See Note 6)			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
40	021SZB	17.1	24.1	7.5	10.9	16.4	24.8	7.0	10.5	15.7	25.4	6.6	10.2
	024SZB	19.5	29.3	7.2	10.4	18.8	30.2	6.7	10.1	18.0	31.1	6.3	9.9
	**027SZB	22.4	32.6	7.5	11.1	21.5	33.5	7.0	10.8	20.6	34.4	6.6	10.6
	**030SZB	26.7	39.2	7.3	10.4	—	—	—	—	—	—	—	—
	**035SZB	29.1	43.4	7.2	10.4	28.1	44.7	6.8	10.2	27.1	45.9	6.4	9.9
	**030DZB	25.5	36.5	7.6	12.0	24.3	37.4	7.1	11.7	23.0	38.3	6.6	11.3
	**035DZB	30.6	44.4	7.6	11.9	29.3	45.6	7.1	11.6	—	—	—	—
	**040DZB	34.0	48.0	7.5	11.5	32.6	49.4	7.0	11.2	31.2	50.8	6.6	10.9
	**045DZB	39.4	57.1	7.4	11.7	37.7	58.7	7.0	11.4	36.1	60.3	6.5	11.1
	**050DZB	42.0	62.0	7.4	11.2	40.3	63.8	6.9	10.9	38.6	65.6	6.4	10.6
	**052DZB	44.1	65.7	7.3	10.9	42.3	67.5	6.9	10.6	40.5	69.3	6.4	10.3
	**055DZB	47.7	73.0	7.2	10.5	45.9	75.0	6.8	10.2	—	—	—	—
	**062DZB	52.6	77.9	7.2	10.6	50.6	80.1	6.8	10.3	48.7	82.4	6.3	10.1
	**070DZB	57.4	87.4	7.1	10.3	55.1	89.8	6.7	10.1	53.0	92.0	6.3	9.9
	**075DZB	62.1	95.2	7.1	10.7	59.5	97.7	6.6	10.4	56.9	100.0	6.2	10.0
	**080DZB	66.6	104.1	7.0	9.5	63.6	106.6	6.6	9.8	60.6	109.1	6.1	9.5
	**085DZB	72.3	106.8	7.3	11.2	69.2	109.8	6.8	10.9	66.0	112.7	6.3	10.7
	**090DZB	78.3	113.6	7.4	11.3	74.9	116.6	6.9	11.1	71.5	119.5	6.5	10.8
	**100DZB	83.1	125.2	7.2	11.2	79.5	128.6	6.7	11.0	76.0	132.0	6.3	10.7
	**102DZB	87.8	131.2	7.3	11.3	84.1	134.6	6.8	11.0	80.3	137.9	6.4	10.8
**112DZB	97.5	144.0	7.3	11.4	93.7	148.0	6.9	11.1	89.9	152.0	6.4	11.2	
**120DZB	104.2	159.9	7.1	11.3	100.4	164.5	6.7	11.0	96.9	169.1	6.3	10.7	
**130DZB	109.3	167.5	7.1	11.2	105.2	172.1	6.7	11.0	101.4	176.7	6.3	10.7	
**140DZB	114.5	174.7	7.1	11.0	110.1	179.4	6.7	10.7	106.0	184.0	6.3	10.9	
**155DZB	127.9	193.2	7.2	11.4	122.7	198.4	6.8	11.1	117.7	203.4	6.3	10.9	
**170DZB	136.9	211.4	7.1	10.9	131.1	216.8	6.7	11.1	125.1	222.0	6.2	10.8	
**180DZB	151.0	232.7	7.1	10.7	145.1	238.2	6.7	10.5	139.3	243.4	6.3	10.3	
185DZB	151.0	232.7	7.1	10.7	145.1	238.2	6.7	10.5	139.3	243.4	6.3	10.3	
**190DZB	164.2	258.8	7.0	10.5	158.4	264.1	6.6	10.3	152.7	269.2	6.3	10.1	
200DZB	164.2	258.8	7.0	10.5	158.4	264.1	6.6	10.3	152.7	269.2	6.3	10.1	
42	021SZB	17.7	24.5	7.7	11.2	17.0	25.2	7.2	10.8	16.3	25.9	6.7	10.5
	024SZB	20.3	29.9	7.4	10.7	19.5	30.8	6.9	10.4	18.7	31.8	6.4	10.1
	027SZB	22.6	32.8	7.5	11.3	21.7	33.7	7.1	11.0	20.8	34.6	6.6	10.7
	030SZB	26.1	38.8	7.2	10.4	25.2	40.0	6.7	10.2	24.3	41.2	6.3	9.9
	035SZB	29.4	43.6	7.3	10.6	28.3	44.9	6.8	10.3	27.3	46.2	6.4	10.0
	030DZB	25.6	36.6	7.6	12.0	24.4	37.5	7.1	11.7	—	—	—	—
	*035DZB	31.0	44.7	7.7	12.0	29.7	45.9	7.2	11.7	28.4	47.0	6.7	11.4
	040DZB	34.3	48.2	7.5	11.6	32.9	49.6	7.1	11.2	31.5	51.0	6.6	11.0
	045DZB	38.6	56.5	7.4	11.5	37.0	58.1	6.9	11.3	35.4	59.6	6.4	11.0
	050DZB	42.5	62.4	7.4	11.3	40.8	64.3	6.9	11.0	39.1	66.1	6.5	10.7
	052DZB	44.5	66.1	7.4	11.0	42.8	68.0	6.9	10.7	41.0	69.8	6.5	10.4
	055DZB	48.1	73.4	7.2	10.5	46.4	75.5	6.8	10.2	—	—	—	—
	062DZB	52.7	77.9	7.2	10.6	50.8	80.3	6.8	10.3	49.0	82.7	6.4	10.1
	070DZB	57.1	87.2	7.1	10.3	55.0	89.7	6.6	10.1	53.0	92.0	6.3	9.9
	075DZB	62.4	95.5	7.1	10.7	59.9	98.1	6.7	10.4	57.5	100.6	6.3	10.1
	080DZB	66.6	104.1	7.0	9.5	63.8	106.8	6.6	9.8	61.0	109.5	6.1	9.5
	085DZB	71.2	105.9	7.2	11.1	68.0	108.8	6.7	10.8	—	—	—	—
	*090DZB	77.9	113.3	7.4	11.3	74.6	116.4	6.9	11.1	71.2	119.3	6.5	10.8
	100DZB	82.6	124.8	7.2	11.2	79.1	128.2	6.7	10.9	75.6	131.6	6.3	10.7
	102DZB	87.1	130.7	7.3	11.2	83.4	134.1	6.8	11.0	79.7	137.4	6.4	10.8
*112DZB	95.2	142.2	7.2	11.2	91.4	146.0	6.8	11.0	87.6	149.8	6.3	11.0	
120DZB	104.0	159.8	7.1	11.3	100.3	164.5	6.7	11.0	96.7	169.0	6.3	10.7	
130DZB	108.9	167.2	7.1	11.2	104.9	171.9	6.7	11.0	101.1	176.5	6.3	11.1	
140DZB	113.8	174.2	7.1	11.0	109.7	179.1	6.6	10.7	105.6	183.7	6.2	10.9	
155DZB	125.1	191.1	7.1	11.3	120.1	196.2	6.7	11.0	115.2	201.2	6.3	10.7	
170DZB	136.8	211.3	7.1	11.3	130.9	216.7	6.7	11.1	124.9	221.9	6.2	10.9	
180DZB	151.1	232.8	7.1	10.7	145.2	238.2	6.7	10.5	139.3	243.4	6.3	10.8	
185DZB	157.0	237.6	7.2	10.9	150.9	243.2	6.8	10.7	144.9	248.6	6.4	11.0	
190DZB	163.8	258.6	7.0	10.6	158.0	263.9	6.6	10.3	152.3	268.9	6.3	10.1	
200DZB	170.8	264.4	7.1	10.8	164.8	269.9	6.8	10.5	159.0	275.2	6.4	10.3	

NOTES: (1) Double asterisk (**) indicates ratings with CH3 oversized evaporator for 40°F LWT
(2) Asterisk (*) indicates ratings with CH2 oversized evaporator for 42°F LWT
(3) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
(4) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
(5) Interpolation between ratings is permissible but extrapolation is not
(6) KW is for compressor only. EER is for entire unit. See Physical Specs for fan kW
(7) High Ambient Applications over 118°F require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: ENGLISH I. P. UNITS

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		85°F				95°F				105°F			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
44	021SZB	22.7	20.2	11.7	13.6	21.3	21.8	10.2	12.8	19.9	23.4	9.0	12.1
	024SZB	26.1	24.8	11.2	12.8	24.4	26.7	9.8	12.1	22.7	28.6	8.6	11.6
	027SZB	29.0	27.6	11.3	13.7	27.1	29.5	9.9	12.9	25.2	31.5	8.7	12.2
	030SZB	33.3	32.1	10.9	12.6	31.2	34.6	9.5	11.9	29.0	37.0	8.3	11.3
	035SZB	37.7	36.0	11.1	12.8	35.2	38.9	9.7	12.1	32.8	41.7	8.5	11.4
	030DZB	34.0	30.2	12.0	13.2	31.6	32.8	10.4	14.0	29.2	35.1	9.0	13.2
	035DZB	39.0	36.5	11.6	14.3	36.4	39.4	10.1	13.5	33.8	42.2	8.8	12.8
	040DZB	44.0	39.9	11.4	13.9	41.3	43.1	10.0	13.2	38.5	46.2	8.8	12.5
	045DZB	49.5	47.4	11.0	12.4	46.4	50.9	9.7	13.1	43.2	54.2	8.5	12.4
	050DZB	54.7	52.3	11.2	13.5	51.1	56.1	9.8	12.8	47.6	59.8	8.6	12.2
	052DZB	56.9	56.0	10.9	12.8	53.4	59.8	9.7	12.0	49.8	63.6	8.5	11.2
	055DZB	61.1	61.8	10.7	12.0	57.1	66.2	9.5	11.2	53.3	70.5	8.3	11.3
	062DZB	67.7	64.5	11.0	12.5	63.2	69.5	9.6	11.6	58.8	74.5	8.4	11.5
	070DZB	73.4	72.7	10.7	12.2	68.5	78.2	9.4	11.8	63.7	83.6	8.2	11.1
	075DZB	80.5	79.9	10.8	12.9	75.2	85.9	9.4	12.0	69.9	91.7	8.3	11.6
	080DZB	86.0	87.9	10.6	12.0	80.4	94.2	9.3	11.1	74.7	100.3	8.2	10.4
	085DZB	92.8	89.1	10.9	12.9	86.6	95.7	9.6	12.0	80.4	102.0	8.4	11.3
	090DZB	98.7	94.5	11.0	12.9	92.1	101.2	9.7	12.6	85.4	107.7	8.5	12.0
	100DZB	106.9	105.5	10.8	12.8	99.9	112.9	9.5	12.5	92.8	120.2	8.4	12.5
	102DZB	112.0	111.0	10.9	12.8	105.1	118.6	9.6	12.0	97.6	126.0	8.4	12.0
112DZB	121.8	118.9	10.8	13.3	113.8	127.6	9.5	12.7	106.0	136.2	8.4	12.0	
120DZB	133.8	133.9	10.7	13.3	124.8	143.7	9.4	12.6	116.1	153.5	8.2	12.0	
130DZB	140.2	139.8	10.8	13.4	130.8	150.2	9.4	12.7	121.7	160.5	8.3	12.0	
140DZB	146.5	145.2	10.7	13.1	136.8	156.3	9.4	12.4	127.3	167.1	8.2	11.8	
155DZB	161.4	159.9	10.8	13.4	150.8	172.0	9.5	12.7	140.3	183.7	8.3	12.1	
170DZB	177.5	178.6	10.8	13.1	166.0	191.5	9.5	12.4	154.1	203.9	8.3	11.7	
180DZB	193.8	199.4	10.5	12.8	181.4	212.9	9.3	12.1	169.1	225.7	8.2	11.5	
185DZB	201.4	203.1	10.7	13.1	188.5	217.0	9.4	12.4	175.7	230.1	8.4	11.7	
190DZB	207.5	226.0	10.0	12.3	195.3	239.6	8.9	11.7	182.6	252.3	8.0	11.2	
200DZB	215.2	230.7	10.2	12.5	202.5	244.7	9.1	11.9	190.2	257.9	8.1	11.4	
45	021SZB	23.1	20.3	11.8	13.8	21.7	22.0	10.3	13.0	20.3	23.6	9.1	12.3
	024SZB	26.5	25.0	11.3	12.9	24.9	27.0	9.9	12.2	23.2	28.9	8.7	11.7
	027SZB	29.5	27.8	11.4	13.9	27.6	29.8	10.0	13.1	25.6	31.7	8.8	12.4
	030SZB	33.9	32.3	11.0	12.8	31.7	34.8	9.6	12.1	29.6	37.4	8.4	11.4
	035SZB	38.3	36.3	11.2	12.9	35.8	39.2	9.8	12.2	33.4	42.0	8.5	11.5
	030DZB	34.7	30.5	12.2	13.4	32.3	33.0	10.5	14.2	29.8	35.4	9.1	13.4
	035DZB	39.7	36.8	11.7	14.5	37.1	39.8	10.2	13.7	34.4	42.6	8.9	13.0
	040DZB	44.8	40.2	11.6	14.1	42.0	43.4	10.1	13.3	39.2	46.5	8.9	12.6
	045DZB	50.3	47.8	11.1	12.5	47.2	51.3	9.8	13.3	43.9	54.7	8.6	12.6
	050DZB	55.6	52.6	11.3	13.7	52.0	56.5	9.9	13.0	48.4	60.4	8.7	12.3
	052DZB	57.8	56.4	11.0	12.9	54.2	60.3	9.7	12.1	50.6	64.2	8.6	11.3
	055DZB	62.1	62.3	10.8	12.1	58.1	66.7	9.5	11.3	54.2	71.2	8.4	11.4
	062DZB	68.9	65.0	11.1	12.7	64.3	70.1	9.7	11.8	59.8	75.1	8.5	11.6
	070DZB	74.7	73.2	10.8	12.3	69.7	78.8	9.5	11.9	64.8	84.3	8.3	11.2
	075DZB	81.9	80.6	10.9	13.1	76.5	86.6	9.5	12.1	71.1	92.5	8.4	11.7
	080DZB	87.5	88.6	10.7	12.1	81.8	95.1	9.4	11.2	76.0	101.2	8.2	10.5
	085DZB	94.6	89.8	11.1	13.0	88.3	96.5	9.7	12.1	81.9	102.9	8.5	11.4
	090DZB	100.5	95.2	11.2	13.4	93.7	102.1	9.8	12.7	86.9	108.6	8.6	12.1
	100DZB	108.8	106.3	11.0	13.8	101.7	113.8	9.6	13.2	94.5	121.3	8.5	12.6
	102DZB	113.7	111.9	10.9	13.8	106.6	119.6	9.7	13.2	99.3	127.1	8.5	12.6
112DZB	123.9	119.8	10.9	13.5	115.8	128.7	9.6	12.8	107.9	137.4	8.4	12.1	
120DZB	136.2	135.0	10.8	13.4	127.1	145.0	9.5	12.8	118.3	154.9	8.3	12.1	
130DZB	142.7	140.9	10.9	13.5	133.2	151.6	9.5	12.8	123.9	162.0	8.4	12.2	
140DZB	149.1	146.4	10.8	13.3	139.3	157.6	9.5	12.5	129.7	168.6	8.3	11.9	
155DZB	164.3	161.3	10.9	13.6	153.6	173.5	9.6	12.8	142.9	185.3	8.4	12.2	
170DZB	180.4	180.1	10.9	13.2	169.1	193.3	9.5	12.5	157.0	205.8	8.4	11.8	
180DZB	197.4	201.2	10.6	13.0	184.8	214.9	9.3	12.2	172.3	227.8	8.3	11.6	
185DZB	205.1	204.9	10.8	13.2	192.0	219.0	9.5	12.5	179.0	232.3	8.4	11.8	
190DZB	210.9	228.0	10.1	12.4	198.6	241.9	9.0	11.8	186.1	254.9	8.1	11.3	
200DZB	218.6	232.8	10.3	12.6	205.8	247.1	9.2	12.0	193.3	260.5	8.2	11.5	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
 (2) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
 (3) Interpolation between ratings is permissible but extrapolation is not
 (4) KW is for compressor only. EER is for entire unit. See Physical Specs for fan kW
 (5) ARI Standard rating point and IPLV.

PERFORMANCE DATA: ENGLISH I. P. UNITS.....

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		115°F				120°F (See Note 4)				125°F (See Note 4)			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
44	021SZB	18.4	24.9	7.9	11.5	17.7	25.7	7.3	11.2	16.9	26.4	6.8	10.8
	024SZB	21.1	30.5	7.5	11.0	20.2	31.5	7.0	10.6	19.3	32.4	6.5	10.4
	027SZB	23.4	33.4	7.7	11.6	22.4	34.3	7.2	11.3	21.5	35.3	6.7	11.0
	030SZB	27.0	39.5	7.3	10.7	26.1	40.7	6.9	10.4	25.2	42.0	6.5	10.2
	035SZB	30.5	44.4	7.4	10.8	29.4	45.7	7.0	10.5	28.3	47.0	6.6	10.3
	030DZB	26.7	37.2	7.8	12.4	25.4	38.2	7.3	12.1	24.1	39.1	6.7	11.7
	035DZB	31.2	44.8	7.7	12.1	29.8	46.0	7.2	11.8	28.5	47.2	6.7	11.4
	040DZB	35.6	49.1	7.7	11.9	34.2	50.6	7.2	11.6	32.7	52.0	6.7	11.3
	045DZB	40.0	57.5	7.5	11.9	38.4	59.2	7.0	11.6	36.7	60.8	6.6	11.3
	050DZB	44.1	63.6	7.6	11.5	42.3	65.5	7.1	11.2	40.5	67.4	6.6	11.0
	052DZB	46.1	67.4	7.5	11.2	44.2	69.3	7.0	10.9	42.4	71.2	6.6	10.6
	055DZB	49.7	74.9	7.3	10.7	48.0	77.0	6.9	10.4	—	—	—	—
	062DZB	54.6	79.4	7.4	10.8	52.7	81.9	6.9	10.5	50.8	84.3	6.5	10.3
	070DZB	59.1	88.8	7.2	10.5	57.0	91.3	6.8	10.4	54.9	93.8	6.4	10.1
	075DZB	64.7	97.3	7.3	10.9	62.1	99.9	6.8	10.6	59.6	102.6	6.4	10.4
	080DZB	68.9	106.1	7.1	10.3	66.0	108.9	6.7	10.0	63.1	111.6	6.3	9.7
	085DZB	74.0	108.1	7.3	11.3	70.7	111.1	6.8	11.1	67.3	114.0	6.4	10.8
	090DZB	78.6	113.8	7.4	11.4	75.1	116.8	7.0	11.1	71.6	119.7	6.5	11.1
	100DZB	85.7	127.3	7.3	11.9	82.0	130.9	6.8	11.7	78.4	134.5	6.4	11.4
	102DZB	90.2	133.2	7.4	12.0	86.4	136.8	6.9	11.7	82.6	140.3	6.5	11.5
112DZB	98.3	144.6	7.3	11.4	94.5	148.8	6.9	11.1	90.8	152.9	6.5	11.3	
120DZB	107.9	163.1	7.2	11.5	104.1	168.0	6.8	11.2	100.4	172.8	6.4	10.9	
130DZB	113.0	170.5	7.3	11.5	108.9	175.4	6.8	11.2	105.0	180.1	6.4	11.3	
140DZB	118.1	177.5	7.2	11.2	113.8	182.5	6.8	11.3	109.6	187.2	6.4	11.1	
155DZB	129.9	194.8	7.3	11.5	124.7	200.1	6.8	11.3	119.6	205.2	6.4	11.0	
170DZB	142.0	215.6	7.3	11.6	135.9	221.2	6.8	11.3	129.7	226.5	6.3	11.1	
180DZB	156.9	237.6	7.2	10.9	150.8	243.2	6.8	10.7	144.8	248.6	6.4	11.0	
185DZB	163.1	242.4	7.4	11.1	156.8	248.3	7.0	10.9	150.6	253.9	6.5	11.2	
190DZB	170.3	264.0	7.1	10.7	164.3	269.5	6.8	10.5	158.5	274.7	6.4	10.3	
200DZB	177.5	270.0	7.3	10.9	171.4	275.7	6.9	10.7	—	—	—	—	
45	021SZB	18.8	25.2	7.9	11.7	18.0	25.9	7.4	11.3	17.2	26.7	6.9	11.0
	024SZB	21.4	30.8	7.6	11.1	20.6	31.8	7.1	10.8	19.7	32.8	6.6	10.5
	027SZB	23.8	33.7	7.7	11.8	22.8	34.7	7.2	11.4	21.9	35.6	6.8	11.2
	030SZB	27.5	39.9	7.4	10.8	26.6	41.1	6.9	10.6	25.6	42.4	6.5	10.3
	035SZB	31.0	44.8	7.5	10.9	29.9	46.1	7.0	10.6	28.8	47.5	6.6	10.4
	030DZB	27.3	37.6	7.9	12.6	26.0	38.5	7.4	12.2	24.6	39.4	6.8	11.9
	035DZB	31.8	45.2	7.8	12.3	30.4	46.4	7.3	11.9	29.1	47.6	6.8	11.6
	040DZB	36.3	49.5	7.8	12.0	34.8	51.0	7.3	11.7	33.3	52.5	6.8	11.4
	045DZB	40.7	58.1	7.6	12.0	39.0	59.7	7.1	11.7	37.4	61.4	6.6	11.4
	050DZB	44.8	64.2	7.6	11.7	43.1	66.1	7.1	11.4	41.3	68.1	6.6	11.1
	052DZB	46.9	68.0	7.6	11.3	45.0	70.0	7.1	11.0	43.1	71.9	6.6	10.7
	055DZB	50.5	75.6	7.4	10.8	48.7	77.8	6.9	10.5	—	—	—	—
	062DZB	55.6	80.1	7.4	10.9	53.6	82.6	7.0	10.6	51.7	85.2	6.5	10.4
	070DZB	60.2	89.6	7.3	10.6	58.0	92.2	6.8	10.5	55.9	94.6	6.4	10.2
	075DZB	65.8	98.1	7.3	11.0	63.2	100.9	6.9	10.7	60.7	103.5	6.4	10.5
	080DZB	70.1	107.1	7.2	10.4	67.2	109.9	6.7	10.1	64.3	112.7	6.3	9.8
	085DZB	75.4	109.2	7.4	11.5	72.0	112.2	6.9	11.2	68.6	115.2	6.4	10.9
	090DZB	80.0	114.9	7.5	12.0	76.5	117.9	7.0	11.8	72.9	120.9	6.5	11.7
	100DZB	87.2	128.6	7.4	12.1	83.5	132.3	6.9	11.8	79.8	135.9	6.4	11.5
	102DZB	91.7	134.5	7.5	12.1	87.9	138.1	7.0	11.9	84.1	141.7	6.5	11.6
112DZB	100.0	146.0	7.4	11.6	96.2	150.2	6.9	11.6	92.4	154.4	6.5	11.4	
120DZB	109.9	164.8	7.3	11.6	106.0	169.7	6.8	11.3	102.3	174.7	6.4	11.0	
130DZB	115.1	172.2	7.3	11.6	110.9	177.1	6.9	11.3	106.9	182.0	6.5	11.5	
140DZB	120.4	179.1	7.3	11.3	115.9	184.2	6.8	11.5	111.6	189.1	6.4	11.2	
155DZB	132.3	196.7	7.4	11.6	127.1	202.1	6.9	11.4	121.9	207.3	6.5	11.1	
170DZB	144.7	217.8	7.3	11.7	138.5	223.5	6.8	11.4	132.2	228.9	6.4	11.2	
180DZB	159.9	240.0	7.3	11.0	153.7	245.7	6.9	11.3	147.6	251.1	6.5	11.1	
185DZB	166.2	244.9	7.5	11.2	159.8	250.8	7.0	11.5	153.5	256.5	6.6	11.3	
190DZB	173.6	266.8	7.2	10.8	167.6	272.4	6.8	10.6	161.6	277.6	6.5	10.4	
200DZB	181.0	272.9	7.4	11.0	174.7	278.7	7.0	10.8	—	—	—	—	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
(2) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
(3) Interpolation between ratings is permissible but extrapolation is not
(4) KW is for compressor only. EER is for entire unit. See Physical Specs for fan kW
(5) High Ambient Applications over 118°F require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: ENGLISH I. P. UNITS

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		85°F				95°F				105°F			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
46	021SZB	23.6	20.5	12.0	14.0	22.1	22.2	10.5	13.2	20.6	23.8	9.2	12.5
	024SZB	27.0	25.2	11.4	13.1	25.3	27.2	10.0	12.4	23.6	29.1	8.8	11.9
	027SZB	30.0	28.0	11.6	14.1	28.0	30.0	10.1	13.3	26.1	32.0	8.9	12.6
	030SZB	34.5	32.5	11.1	12.9	32.3	35.1	9.7	12.2	30.1	37.7	8.5	11.5
	035SZB	39.0	36.6	11.3	13.1	36.4	39.5	9.9	12.4	34.0	42.4	8.6	11.6
	030DZB	35.4	30.7	12.3	13.6	33.0	33.3	10.7	14.4	30.4	35.7	9.2	13.5
	035DZB	40.4	37.1	11.9	14.7	37.7	40.1	10.3	13.9	35.1	42.9	9.0	13.1
	040DZB	45.6	40.4	11.7	14.3	42.8	43.7	10.2	13.5	39.9	46.9	9.0	12.8
	045DZB	51.1	48.1	11.3	12.7	48.0	51.7	9.9	13.4	44.7	55.2	8.7	12.8
	050DZB	56.6	53.0	11.4	13.9	52.9	57.0	10.0	13.1	49.3	60.9	8.8	12.4
	052DZB	58.6	56.8	11.1	13.0	55.0	60.8	9.8	12.2	51.4	64.7	8.7	12.0
	055DZB	63.1	62.8	10.9	12.2	59.0	67.3	9.6	11.4	55.1	71.8	8.4	11.5
	062DZB	70.1	65.5	11.2	12.8	65.4	70.7	9.8	12.4	60.9	75.8	8.6	11.7
	070DZB	76.0	73.8	10.9	12.7	70.9	79.5	9.6	12.0	66.0	85.0	8.4	11.3
	075DZB	83.3	81.2	11.0	13.2	77.8	87.3	9.6	12.3	72.4	93.3	8.4	11.8
	080DZB	88.9	89.4	10.8	12.2	83.2	95.9	9.5	11.4	77.3	102.1	8.3	10.6
	085DZB	96.3	90.5	11.2	13.2	90.0	97.3	9.8	12.3	83.5	103.9	8.6	11.5
	090DZB	102.3	95.9	11.3	14.1	95.4	102.9	9.9	13.4	88.5	109.6	8.7	12.8
	100DZB	110.5	107.2	11.1	14.0	103.4	114.8	9.7	13.3	96.1	122.4	8.5	12.7
	102DZB	115.4	112.7	11.0	13.9	108.2	120.5	9.7	13.3	101.0	128.2	8.6	12.8
112DZB	126.1	120.7	11.1	13.6	117.9	129.7	9.7	12.9	109.8	138.6	8.5	12.3	
120DZB	138.3	136.2	10.9	13.6	129.4	146.3	9.6	12.9	120.4	156.4	8.4	12.2	
130DZB	145.2	142.1	11.0	13.7	135.6	152.9	9.6	13.0	126.2	163.5	8.4	12.3	
140DZB	151.8	147.5	10.9	13.4	141.8	159.0	9.6	12.7	132.0	170.1	8.4	12.0	
155DZB	167.3	162.6	11.0	13.7	156.5	175.0	9.7	13.0	145.6	187.0	8.5	12.3	
170DZB	183.4	181.6	11.0	13.4	172.1	195.0	9.6	12.6	159.9	207.8	8.5	11.9	
180DZB	201.0	202.9	10.7	13.1	188.2	216.9	9.4	12.4	175.5	230.0	8.3	11.7	
185DZB	208.6	206.6	10.9	13.3	195.6	221.0	9.6	12.6	182.4	234.6	8.5	11.9	
190DZB	214.3	230.1	10.2	12.5	201.8	244.2	9.1	11.9	189.5	257.4	8.1	11.4	
200DZB	222.1	234.9	10.4	12.7	209.1	249.5	9.2	12.1	196.5	263.0	8.3	11.6	
48	021SZB	24.4	20.7	12.3	14.4	22.9	22.5	10.7	13.6	21.4	24.2	9.4	12.9
	024SZB	28.0	25.6	11.7	13.4	26.2	27.6	10.2	12.6	24.4	29.6	8.9	12.1
	027SZB	30.9	28.4	11.7	14.5	29.0	30.5	10.3	13.7	26.9	32.5	9.0	13.0
	030SZB	35.8	33.0	11.3	13.3	33.4	35.7	9.9	12.5	31.2	38.3	8.7	11.8
	035SZB	40.4	37.1	11.6	13.4	37.7	40.1	10.1	12.6	35.2	43.1	8.8	11.9
	030DZB	36.8	31.1	12.6	15.7	34.3	33.8	10.9	14.8	31.7	36.3	9.5	13.9
	035DZB	42.0	37.6	12.2	15.1	39.2	40.7	10.6	14.2	36.4	43.6	9.2	13.4
	040DZB	47.3	41.0	12.0	14.7	44.4	44.4	10.5	13.9	41.4	47.7	9.2	13.2
	045DZB	52.8	48.8	11.5	12.9	49.5	52.5	10.1	13.8	46.2	56.1	8.9	13.1
	050DZB	58.5	53.8	11.7	14.2	54.8	57.9	10.2	13.4	51.0	61.9	9.0	12.7
	052DZB	60.4	57.7	11.3	13.2	56.6	61.8	10.0	12.4	52.9	65.8	8.8	12.3
	055DZB	65.0	63.8	11.1	12.4	60.9	68.5	9.8	12.3	56.8	73.1	8.6	11.7
	062DZB	72.5	66.5	11.4	13.1	67.7	71.8	10.0	12.7	63.0	77.1	8.7	11.9
	070DZB	78.6	74.9	11.2	13.0	73.4	80.8	9.7	12.2	68.3	86.5	8.5	11.5
	075DZB	86.0	82.5	11.2	13.5	80.5	88.8	9.8	12.5	74.9	94.9	8.6	12.0
	080DZB	91.7	90.8	11.0	12.4	86.0	97.5	9.6	11.5	80.0	104.0	8.5	10.7
	085DZB	100.0	91.9	11.5	13.5	93.4	98.9	10.0	12.6	86.6	105.8	8.8	11.7
	090DZB	106.0	97.4	11.5	14.5	98.8	104.5	10.1	13.7	91.6	111.5	8.8	13.1
	100DZB	114.0	108.9	11.2	14.3	106.9	116.8	9.9	13.6	99.5	124.7	8.7	13.0
	102DZB	118.9	114.4	11.2	14.2	111.5	122.5	9.9	13.6	104.1	130.5	8.7	13.0
112DZB	130.5	122.6	11.3	13.9	122.0	131.9	9.9	13.2	113.6	141.1	8.7	12.5	
120DZB	142.6	138.5	11.1	13.8	133.7	149.0	9.7	13.1	124.8	159.5	8.5	12.5	
130DZB	150.1	144.5	11.2	13.9	140.4	155.6	9.8	13.2	130.8	166.5	8.6	12.5	
140DZB	157.1	149.9	11.2	13.7	146.9	161.6	9.7	12.9	136.8	173.1	8.5	12.2	
155DZB	173.4	165.1	11.3	14.0	162.2	177.9	9.9	13.2	151.0	190.4	8.6	12.6	
170DZB	189.3	184.8	11.1	13.6	177.7	198.5	9.8	12.8	165.8	211.8	8.6	12.9	
180DZB	208.1	206.4	10.9	13.4	195.1	220.8	9.6	12.6	182.0	234.4	8.5	11.9	
185DZB	215.4	210.2	11.1	14.2	202.5	225.0	9.8	13.5	189.2	239.0	8.7	12.9	
190DZB	221.0	234.3	10.3	12.7	208.2	248.8	9.2	12.1	195.8	262.4	8.2	11.6	
200DZB	229.1	239.2	10.5	12.9	215.8	254.2	9.4	12.3	202.9	268.3	8.4	11.8	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
 (2) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
 (3) Interpolation between ratings is permissible but extrapolation is not
 (4) KW is for compressor only. EER is for entire unit. See Physical Specs for fan KW

PERFORMANCE DATA: ENGLISH I. P. UNITS

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		115°F				120°F (See Note 4)				125°F (See Note 4)			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
46	021SZB	19.1	25.4	8.0	11.8	18.3	26.2	7.5	11.5	17.5	26.9	7.0	11.1
	024SZB	21.8	31.1	7.6	11.2	20.9	32.1	7.1	10.9	20.0	33.1	6.6	10.6
	027SZB	24.2	34.0	7.8	11.9	23.2	35.0	7.3	11.6	22.3	36.0	6.8	11.3
	030SZB	28.0	40.2	7.5	10.9	27.0	41.5	7.0	10.7	26.1	42.8	6.6	10.4
	035SZB	31.6	45.2	7.6	11.1	30.4	46.6	7.1	10.8	29.4	47.9	6.7	10.5
	030DZB	27.8	37.9	8.0	12.8	26.5	38.9	7.5	12.4	25.1	39.8	6.9	12.0
	035DZB	32.4	45.6	7.9	12.4	31.0	46.9	7.3	12.0	29.6	48.1	6.9	11.7
	040DZB	37.0	50.0	7.9	12.2	35.4	51.5	7.3	11.9	33.9	52.9	6.9	11.5
	045DZB	41.4	58.6	7.6	12.2	39.7	60.3	7.1	11.9	38.0	62.0	6.7	11.6
	050DZB	45.6	64.8	7.7	11.8	43.8	66.8	7.2	11.5	42.0	68.8	6.7	11.2
	052DZB	47.6	68.7	7.6	11.4	45.8	70.6	7.1	11.2	—	—	—	—
	055DZB	51.3	76.3	7.4	10.9	49.5	78.6	7.0	10.6	—	—	—	—
	062DZB	56.6	80.9	7.5	11.0	54.5	83.4	7.0	10.9	52.6	86.0	6.6	10.5
	070DZB	61.3	90.4	7.4	10.7	59.1	93.0	6.9	10.6	56.9	95.5	6.5	10.3
	075DZB	67.0	99.0	7.4	11.2	64.3	101.8	6.9	10.8	61.7	104.5	6.5	10.7
	080DZB	71.4	108.1	7.3	10.5	68.4	111.0	6.8	10.2	65.4	113.8	6.4	9.9
	085DZB	76.8	110.2	7.5	11.6	73.4	113.3	7.0	11.3	69.9	116.4	6.5	11.1
	090DZB	81.5	116.0	7.6	12.2	77.9	119.1	7.1	11.9	74.3	122.1	6.6	11.9
	100DZB	88.7	129.9	7.5	12.2	85.0	133.6	7.0	11.9	81.2	137.3	6.5	11.6
	102DZB	93.3	135.8	7.5	12.2	89.5	139.5	7.0	12.0	85.6	143.2	6.6	11.7
112DZB	101.8	147.4	7.5	11.7	97.9	151.7	7.0	11.8	94.1	156.0	6.6	11.5	
120DZB	111.9	166.5	7.4	11.7	107.9	171.5	6.9	11.4	104.1	176.5	6.5	11.6	
130DZB	117.2	173.8	7.4	11.7	113.0	178.9	7.0	11.8	108.9	183.9	6.5	11.6	
140DZB	122.6	180.8	7.4	11.4	118.1	186.0	6.9	11.6	113.7	190.9	6.5	11.4	
155DZB	134.8	198.5	7.4	11.7	129.5	204.0	7.0	11.5	124.2	209.3	6.5	11.2	
170DZB	147.4	219.9	7.4	11.8	141.1	225.7	6.9	11.5	134.7	231.2	6.5	11.3	
180DZB	162.9	242.4	7.4	11.1	156.6	248.2	6.9	11.4	150.4	253.7	6.5	11.2	
185DZB	169.3	247.3	7.5	11.3	162.9	253.4	7.1	11.7	156.4	259.2	6.7	11.4	
190DZB	176.9	269.5	7.3	10.9	170.8	275.2	6.9	10.7	—	—	—	—	
200DZB	184.4	275.7	7.4	11.1	178.1	281.6	7.0	10.9	—	—	—	—	
48	021SZB	19.8	25.8	8.2	12.2	19.0	26.6	7.6	11.8	18.2	27.4	7.1	11.5
	024SZB	22.6	31.7	7.8	11.5	21.7	32.7	7.2	11.1	20.7	33.8	6.7	10.9
	027SZB	25.0	34.6	7.9	12.3	24.0	35.6	7.4	11.9	23.0	36.7	6.9	11.6
	030SZB	29.0	41.0	7.6	11.2	28.0	42.3	7.1	10.9	27.0	43.6	6.7	10.7
	035SZB	32.7	46.0	7.7	11.3	31.5	47.4	7.3	11.0	30.4	48.8	6.8	10.8
	030DZB	29.0	38.5	8.2	13.1	27.6	39.6	7.6	12.8	26.2	40.5	7.1	12.4
	035DZB	33.6	46.4	8.0	12.7	32.2	47.7	7.5	12.4	30.8	49.0	7.0	12.0
	040DZB	38.3	50.8	8.0	12.5	36.7	52.4	7.5	12.2	35.1	53.9	7.0	11.8
	045DZB	42.8	59.6	7.8	12.5	41.1	61.4	7.3	12.2	—	—	—	—
	050DZB	47.2	66.0	7.8	12.1	45.3	68.0	7.3	11.7	43.4	70.1	6.8	11.5
	052DZB	49.2	69.9	7.7	11.7	47.3	72.0	7.2	11.4	—	—	—	—
	055DZB	52.9	77.8	7.5	11.1	51.1	80.1	7.1	10.8	—	—	—	—
	062DZB	58.5	82.4	7.6	11.3	56.4	85.0	7.2	11.1	54.4	87.6	6.7	10.8
	070DZB	63.4	92.0	7.5	11.1	61.1	94.7	7.0	10.8	58.9	97.3	6.6	10.5
	075DZB	69.3	100.8	7.5	11.4	66.6	103.7	7.1	11.1	63.9	106.4	6.6	10.9
	080DZB	73.9	110.1	7.4	10.7	70.8	113.1	6.9	10.3	67.7	115.9	6.5	10.1
	085DZB	79.7	112.4	7.6	11.9	76.2	115.6	7.1	11.5	72.6	118.8	6.6	11.3
	090DZB	84.4	118.1	7.7	12.4	80.7	121.4	7.2	12.1	77.0	124.5	6.7	12.2
	100DZB	91.9	132.5	7.6	12.4	88.0	136.3	7.1	12.2	84.1	140.2	6.6	12.2
	102DZB	96.5	138.4	7.7	12.4	92.6	142.3	7.2	12.1	—	—	—	—
112DZB	105.4	150.2	7.6	12.3	101.4	154.7	7.1	12.0	97.5	159.1	6.7	11.8	
120DZB	116.0	169.9	7.5	11.9	111.9	175.1	7.0	11.6	—	—	—	—	
130DZB	121.5	177.2	7.5	11.9	117.2	182.5	7.1	12.1	113.0	187.6	6.7	11.8	
140DZB	127.1	184.2	7.5	12.1	122.4	189.5	7.0	11.8	118.0	194.7	6.6	11.6	
155DZB	139.8	202.2	7.6	12.0	134.3	208.0	7.1	11.7	128.8	213.5	6.6	11.4	
170DZB	152.9	224.2	7.5	12.3	146.3	230.2	7.0	12.1	139.6	236.0	6.6	11.8	
180DZB	169.1	247.1	7.5	12.2	162.6	253.1	7.1	12.0	156.2	258.9	6.7	11.8	
185DZB	175.7	252.2	7.7	12.5	169.0	258.5	7.2	12.2	162.4	264.5	6.8	12.0	
190DZB	183.6	275.0	7.4	11.1	177.3	281.0	7.0	10.9	—	—	—	—	
200DZB	190.4	281.3	7.5	11.3	184.4	287.5	7.1	11.0	—	—	—	—	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
(2) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
(3) Interpolation between ratings is permissible but extrapolation is not
(4) KW is for compressor only. EER is for entire unit. See Physical Specs for fan KW
(5) High Ambient Applications over 118°F require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: ENGLISH I. P. UNITS

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		85°F				95°F				105°F			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
50	021SZB	25.3	21.0	12.6	14.8	23.8	22.8	11.0	13.9	22.2	24.6	9.6	13.2
	024SZB	29.0	26.0	11.9	13.7	27.2	28.1	10.4	13.2	25.3	30.2	9.1	12.4
	027SZB	31.9	28.8	12.0	14.9	29.8	30.9	10.5	14.1	27.8	33.1	9.2	13.3
	030SZB	37.0	33.5	11.6	13.6	34.6	36.3	10.1	12.8	32.3	39.0	8.8	12.1
	035SZB	41.8	37.7	11.8	13.7	39.1	40.7	10.3	12.9	36.4	43.8	9.0	12.2
	030DZB	38.2	31.6	13.0	16.2	35.6	34.3	11.2	15.2	32.9	36.9	9.7	14.3
	035DZB	43.5	38.1	12.4	15.5	40.6	41.3	10.8	14.6	37.7	44.4	9.4	13.8
	040DZB	49.0	41.5	12.3	15.1	46.0	45.0	10.7	14.3	42.9	48.4	9.4	13.5
	045DZB	54.5	49.5	11.7	13.1	51.1	53.3	10.3	14.1	47.7	57.0	9.0	13.4
	050DZB	60.4	54.6	11.9	14.5	56.6	58.8	10.4	13.7	52.7	63.0	9.1	13.0
	052DZB	62.1	58.6	11.5	13.4	58.2	62.8	10.1	12.6	54.4	67.0	8.9	12.5
	055DZB	66.9	64.9	11.3	12.5	62.7	69.6	9.9	12.6	58.6	74.4	8.7	12.0
	062DZB	75.1	67.4	11.7	13.4	70.1	72.9	10.2	12.9	65.2	78.4	8.9	12.2
	070DZB	81.3	76.1	11.4	13.3	75.9	82.1	9.9	12.5	70.7	87.9	8.7	11.8
	075DZB	88.8	83.7	11.4	13.7	83.2	90.2	10.0	13.0	77.5	96.5	8.8	12.3
	080DZB	94.5	92.3	11.1	12.6	88.7	99.2	9.8	11.7	82.8	105.8	8.6	11.5
	085DZB	103.6	93.2	11.7	13.8	96.8	100.5	10.2	12.8	89.8	107.6	8.9	12.7
	090DZB	109.8	98.8	11.8	14.8	102.3	106.2	10.3	14.0	94.9	113.4	9.0	13.4
	100DZB	117.5	110.6	11.4	14.5	110.2	118.8	10.1	13.9	102.9	126.9	8.8	13.2
	102DZB	122.5	116.2	11.4	14.5	114.7	124.5	10.0	13.9	107.2	132.8	8.8	13.2
112DZB	135.0	124.4	11.5	14.2	126.2	134.0	10.1	13.5	117.5	143.5	8.8	12.8	
120DZB	147.0	140.7	11.3	14.1	137.9	151.6	9.9	13.3	129.0	162.4	8.7	12.7	
130DZB	154.8	146.8	11.4	14.2	145.3	158.2	10.0	13.4	135.5	169.5	8.8	12.7	
140DZB	162.6	152.2	11.4	14.0	152.1	164.3	9.9	13.2	141.7	176.1	8.7	12.5	
155DZB	179.6	167.8	11.5	14.3	168.0	181.0	10.1	13.5	156.5	193.8	8.8	12.8	
170DZB	195.4	187.9	11.3	14.5	183.4	202.1	9.9	13.8	171.1	215.7	8.7	13.2	
180DZB	214.6	209.9	11.1	14.2	202.0	224.7	9.8	13.5	188.7	238.8	8.7	13.0	
185DZB	222.2	213.7	11.3	14.5	209.0	229.0	10.0	13.8	195.9	243.5	8.8	13.2	
190DZB	227.8	238.5	10.5	12.9	214.8	253.6	9.3	12.3	202.0	267.5	8.4	11.8	
200DZB	236.1	243.5	10.7	13.2	222.5	259.0	9.5	12.5	209.3	273.5	8.5	12.0	
55	021SZB	27.6	21.6	13.3	15.7	25.9	23.6	11.6	14.8	24.1	25.5	10.1	14.2
	024SZB	31.5	26.9	12.5	14.4	29.6	29.1	11.0	14.0	27.5	31.4	9.5	13.2
	027SZB	34.2	29.8	12.4	16.0	32.0	32.1	10.9	15.1	29.9	34.4	9.6	14.2
	030SZB	40.2	34.7	12.2	14.5	37.6	37.6	10.6	13.6	35.1	40.6	9.3	12.8
	035SZB	45.4	39.0	12.4	14.5	42.5	42.3	10.8	13.6	39.7	45.6	9.4	12.8
	030DZB	41.8	32.7	13.7	17.3	38.9	35.6	11.9	16.3	36.0	38.4	10.3	15.3
	035DZB	47.3	39.4	13.2	16.5	44.3	42.8	11.4	15.5	41.2	46.1	9.9	14.6
	040DZB	53.4	42.8	13.0	16.2	50.1	46.6	11.3	15.3	46.7	50.2	9.9	14.4
	045DZB	58.8	51.2	12.3	15.9	55.2	55.3	10.7	15.0	51.5	59.3	9.4	14.3
	050DZB	65.2	56.5	12.4	15.4	61.1	61.0	10.9	14.5	57.0	65.6	9.5	13.7
	052DZB	66.7	60.7	11.9	14.0	62.4	65.2	10.5	13.9	58.3	69.8	9.2	13.2
	055DZB	71.8	67.4	11.7	13.9	67.3	72.5	10.2	13.2	63.0	77.7	9.0	12.5
	062DZB	81.5	69.7	12.3	14.5	76.1	75.6	10.7	13.6	70.9	81.5	9.3	12.8
	070DZB	87.6	78.9	11.9	14.4	82.2	85.3	10.4	13.6	76.8	91.6	9.1	12.9
	075DZB	96.0	86.9	11.9	14.5	89.9	93.8	10.4	13.7	83.8	100.6	9.1	12.9
	080DZB	101.6	96.0	11.5	13.1	95.4	103.3	10.1	12.7	89.1	110.4	8.9	12.0
	085DZB	113.0	96.5	12.4	15.7	105.7	104.5	10.8	14.9	98.0	112.2	9.4	14.1
	090DZB	118.5	102.3	12.4	15.6	111.0	110.3	10.8	14.8	103.3	118.1	9.5	14.0
	100DZB	126.5	114.7	11.9	15.3	118.6	123.6	10.4	14.5	110.7	132.5	9.1	13.8
	102DZB	131.6	120.6	11.8	15.2	123.2	129.5	10.4	14.5	115.0	138.5	9.1	13.8
112DZB	145.8	128.8	12.1	14.9	136.9	139.2	10.6	14.1	127.8	149.6	9.3	13.9	
120DZB	158.3	146.3	11.7	14.7	148.5	158.1	10.2	13.9	139.0	169.8	9.0	13.2	
130DZB	166.8	152.5	11.9	14.8	156.6	164.9	10.4	14.0	146.7	177.1	9.1	13.7	
140DZB	175.7	158.0	11.9	15.2	165.1	171.0	10.4	14.5	154.6	183.7	9.1	13.9	
155DZB	193.8	174.4	12.0	15.0	182.3	188.6	10.5	14.1	170.6	202.4	9.2	13.4	
170DZB	210.9	195.8	11.8	15.2	198.0	211.0	10.3	14.4	184.9	225.6	9.1	13.8	
180DZB	231.5	218.6	11.5	14.9	218.0	234.6	10.2	14.2	204.6	249.8	9.0	13.6	
185DZB	239.6	222.7	11.7	15.2	225.5	239.1	10.3	14.4	211.6	254.8	9.2	13.8	
190DZB	245.0	249.1	10.8	13.4	231.3	265.3	9.6	12.8	217.8	280.4	8.6	12.2	
200DZB	253.8	254.3	11.0	13.7	239.5	271.0	9.8	13.0	225.6	286.7	8.8	12.4	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
 (2) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
 (3) Interpolation between ratings is permissible but extrapolation is not
 (4) KW is for compressor only. EER is for entire unit. See Physical Specs for fan kW

PERFORMANCE DATA: ENGLISH I. P. UNITS.....

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		115°F				120°F (See Note 4)				125°F (See Note 4)			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
50	021SZB	20.5	26.2	8.4	12.5	19.7	27.1	7.8	12.1	18.8	27.9	7.3	11.8
	024SZB	23.4	32.3	7.9	11.8	22.4	33.3	7.4	11.4	21.5	34.4	6.8	11.5
	027SZB	25.8	35.2	8.1	12.6	24.8	36.3	7.5	12.2	23.8	37.4	7.0	11.9
	030SZB	30.0	41.7	7.8	11.4	29.0	43.1	7.3	11.2	28.0	44.5	6.8	10.9
	035SZB	33.9	46.8	7.9	11.5	32.7	48.2	7.4	11.3	31.5	49.6	6.9	11.4
	030DZB	30.1	39.2	8.4	13.5	28.7	40.3	7.8	13.1	27.2	41.2	7.2	12.7
	035DZB	34.8	47.3	8.2	13.0	33.4	48.6	7.6	12.7	32.0	49.9	7.1	12.3
	040DZB	39.7	51.7	8.2	12.8	38.0	53.3	7.6	12.5	36.4	54.9	7.1	12.1
	045DZB	44.3	60.7	7.9	12.8	42.5	62.5	7.4	12.5	—	—	—	—
	050DZB	48.8	67.2	8.0	12.4	46.8	69.3	7.4	12.0	44.9	71.5	6.9	11.7
	052DZB	50.6	71.2	7.8	11.9	48.8	73.3	7.3	11.6	—	—	—	—
	055DZB	54.6	79.3	7.6	11.4	52.7	81.7	7.2	11.0	—	—	—	—
	062DZB	60.6	83.8	7.8	11.5	58.4	86.5	7.3	11.4	56.3	89.3	6.8	11.0
	070DZB	65.7	93.6	7.6	11.3	63.3	96.4	7.2	11.0	61.0	99.1	6.7	10.7
	075DZB	71.8	102.6	7.7	11.6	68.9	105.5	7.2	11.3	66.1	108.4	6.7	11.1
	080DZB	76.5	112.1	7.5	10.9	73.3	115.2	7.0	10.6	70.0	118.1	6.6	10.2
	085DZB	82.6	114.5	7.8	12.1	79.0	117.9	7.3	11.8	75.2	121.2	6.7	11.5
	090DZB	87.4	120.3	7.9	12.7	83.6	123.7	7.4	12.8	79.8	127.0	6.8	12.5
	100DZB	95.0	135.0	7.7	12.6	91.1	139.1	7.2	12.4	—	—	—	—
	102DZB	99.6	140.9	7.8	12.7	95.8	145.0	7.3	12.4	—	—	—	—
112DZB	109.1	152.9	7.8	12.6	105.0	157.6	7.3	12.3	101.0	162.3	6.8	12.0	
120DZB	120.2	173.3	7.6	12.1	116.0	178.7	7.1	12.3	—	—	—	—	
130DZB	126.0	180.7	7.7	12.6	121.4	186.1	7.2	12.3	117.1	191.4	6.8	12.0	
140DZB	131.7	187.6	7.6	12.4	126.9	193.1	7.2	12.1	122.3	198.4	6.7	11.8	
155DZB	145.0	206.1	7.7	12.2	139.2	212.0	7.2	11.9	133.6	217.7	6.8	11.6	
170DZB	158.5	228.6	7.7	12.6	151.7	234.8	7.2	12.3	—	—	—	—	
180DZB	175.3	251.9	7.7	12.5	168.7	258.2	7.2	12.2	162.0	264.2	6.8	12.0	
185DZB	182.2	257.2	7.8	12.7	175.3	263.7	7.4	12.5	—	—	—	—	
190DZB	189.6	280.5	7.5	11.3	183.7	286.7	7.1	11.0	—	—	—	—	
200DZB	196.6	287.0	7.6	11.4	190.4	293.3	7.2	11.2	—	—	—	—	
55	021SZB	22.4	27.3	8.8	13.4	21.4	28.2	8.2	13.0	20.5	29.1	7.6	13.0
	024SZB	25.4	33.7	8.2	12.5	24.3	34.9	7.7	12.7	23.3	36.1	7.1	12.4
	027SZB	27.9	36.7	8.4	13.5	26.9	37.9	7.8	13.2	—	—	—	—
	030SZB	32.7	43.6	8.1	12.2	31.5	45.0	7.6	11.9	30.5	46.6	7.1	12.2
	035SZB	36.9	48.8	8.3	12.1	35.6	50.3	7.7	12.5	34.4	51.9	7.3	12.2
	030DZB	33.0	40.8	8.9	14.5	31.4	42.0	8.2	14.0	29.7	43.0	7.6	13.6
	035DZB	38.1	49.3	8.6	13.8	36.5	50.8	8.0	13.4	35.0	52.2	7.5	13.0
	040DZB	43.2	53.8	8.6	13.6	41.4	55.5	8.0	13.3	39.6	57.2	7.5	12.9
	045DZB	47.8	63.3	8.2	13.6	46.0	65.3	7.7	13.2	—	—	—	—
	050DZB	52.9	70.2	8.3	13.0	50.8	72.5	7.7	12.7	—	—	—	—
	052DZB	54.3	74.4	8.1	12.5	52.3	76.7	7.6	12.2	—	—	—	—
	055DZB	58.8	83.0	7.9	11.9	—	—	—	—	—	—	—	—
	062DZB	65.9	87.4	8.1	12.3	63.5	90.4	7.6	12.0	61.3	93.4	7.1	11.7
	070DZB	71.5	97.7	8.0	12.5	68.9	100.7	7.5	12.2	—	—	—	—
	075DZB	77.8	107.1	8.0	12.2	74.9	110.3	7.5	12.1	—	—	—	—
	080DZB	82.7	117.2	7.8	11.3	79.4	120.5	7.3	11.0	—	—	—	—
	085DZB	90.2	119.8	8.2	13.4	86.2	123.5	7.6	13.1	82.1	127.1	7.0	12.8
	090DZB	95.2	125.7	8.2	13.9	91.1	129.4	7.7	13.5	87.0	133.0	7.2	13.2
	100DZB	102.7	141.4	8.0	13.8	98.7	145.9	7.5	13.5	—	—	—	—
	102DZB	107.0	147.4	8.0	13.2	103.0	151.8	7.5	13.5	—	—	—	—
112DZB	118.7	159.9	8.1	13.3	114.3	165.1	7.6	12.9	110.0	170.2	7.1	12.7	
120DZB	130.0	181.7	7.9	13.1	125.7	187.6	7.4	12.9	—	—	—	—	
130DZB	137.1	189.2	8.0	13.2	132.6	195.2	7.5	12.9	—	—	—	—	
140DZB	143.9	196.1	8.0	13.3	138.7	202.1	7.5	13.0	—	—	—	—	
155DZB	158.4	215.7	8.1	12.7	152.2	222.1	7.6	13.0	—	—	—	—	
170DZB	171.5	239.6	8.0	13.1	164.6	246.3	7.4	13.3	—	—	—	—	
180DZB	191.2	264.2	8.0	13.0	184.4	271.0	7.5	12.8	—	—	—	—	
185DZB	197.7	269.6	8.1	13.2	190.8	276.6	7.7	13.0	—	—	—	—	
190DZB	204.8	294.5	7.8	11.7	198.5	301.1	7.4	11.4	—	—	—	—	
200DZB	212.1	301.2	7.9	11.9	—	—	—	—	—	—	—	—	

NOTES: (1) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
(2) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
(3) Interpolation between ratings is permissible but extrapolation is not
(4) KW is for compressor only. EER is for entire unit. See Physical Specs for fan kW
(5) High Ambient Applications over 118°F require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: ENGLISH I. P. UNITS

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		85°F				95°F				105°F			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
60	021SZB	29.8	22.2	14.1	16.7	28.1	24.3	12.3	16.2	26.2	26.4	10.6	15.2
	024SZB	33.8	27.7	13.1	15.2	31.7	30.2	11.4	14.9	29.6	32.6	9.9	14.0
	027SZB	36.7	30.8	13.0	17.1	34.4	33.3	11.3	16.1	32.0	35.8	9.9	15.2
	030SZB	43.5	35.7	12.9	15.4	40.8	38.9	11.2	14.5	38.1	42.1	9.7	13.6
	035SZB	48.9	40.4	13.0	15.3	46.0	43.9	11.3	14.3	43.1	47.4	9.9	13.5
	030DZB	45.2	33.6	14.5	18.5	42.2	36.8	12.5	17.3	39.0	39.8	10.8	16.3
	035DZB	50.9	40.5	13.8	17.5	47.8	44.3	11.9	16.5	44.7	47.9	10.4	15.5
	040DZB	57.9	43.9	13.8	17.3	54.4	48.0	12.0	16.3	50.7	52.0	10.4	15.4
	045DZB	63.4	52.9	12.8	16.9	59.4	57.2	11.2	16.0	55.5	61.6	9.8	15.2
	050DZB	70.0	58.4	13.0	16.2	65.6	63.2	11.3	15.2	61.2	68.1	9.9	14.4
	052DZB	71.5	62.9	12.4	15.2	66.8	67.7	10.8	14.6	62.3	72.6	9.5	13.9
	055DZB	77.0	69.9	12.1	14.5	72.1	75.4	10.6	13.8	67.4	81.0	9.3	13.1
	062DZB	87.9	71.8	13.0	16.0	82.5	78.2	11.3	15.0	76.8	84.6	9.8	14.2
	070DZB	94.0	81.8	12.3	15.1	88.3	88.6	10.8	14.2	82.6	95.3	9.5	13.8
	075DZB	103.1	90.1	12.4	15.8	96.8	97.5	10.8	14.9	90.4	104.7	9.5	14.1
	080DZB	109.1	99.8	12.0	14.7	102.4	107.5	10.5	13.9	95.6	115.0	9.2	13.1
	085DZB	121.7	99.6	13.0	16.6	114.2	108.3	11.3	15.7	106.5	116.7	9.9	14.9
	090DZB	127.6	105.7	12.9	16.4	119.4	114.4	11.3	15.5	111.3	122.8	9.8	15.3
	100DZB	135.9	118.9	12.4	16.0	127.3	128.4	10.8	15.2	118.7	138.1	9.4	15.1
	102DZB	141.1	125.1	12.3	15.9	132.1	134.6	10.8	15.2	123.2	144.2	9.4	14.4
112DZB	156.7	133.2	12.6	15.7	147.1	144.3	11.0	15.3	137.7	155.5	9.6	14.5	
120DZB	170.1	151.5	12.2	15.4	159.6	164.3	10.6	15.0	149.5	177.1	9.3	14.8	
130DZB	179.3	158.2	12.4	15.5	168.5	171.4	10.8	15.4	157.9	184.6	9.4	14.8	
140DZB	188.9	163.9	12.4	16.0	177.7	177.8	10.8	15.2	166.6	191.5	9.5	14.5	
155DZB	208.8	181.1	12.5	16.4	196.4	196.3	10.9	15.6	184.0	211.1	9.6	14.9	
170DZB	227.3	204.0	12.2	15.8	213.4	220.2	10.7	15.0	199.3	235.8	9.4	14.4	
180DZB	248.8	227.4	12.0	15.6	234.5	244.6	10.5	14.8	220.2	260.9	9.3	14.1	
185DZB	257.5	231.6	12.2	15.9	242.5	249.3	10.7	15.1	227.7	266.1	9.5	14.4	
190DZB	262.6	259.7	11.2	14.0	248.1	277.2	9.9	13.2	233.9	293.5	8.9	12.6	
200DZB	271.7	265.2	11.3	14.2	256.7	283.2	10.1	13.4	242.1	300.0	9.0	12.8	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
 (2) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
 (3) Interpolation between ratings is permissible but extrapolation is **not**
 (4) KW is for compressor only. EER is for entire unit. See Physical Specs for fan KW

PERFORMANCE DATA: ENGLISH I. P. UNITS

60 HZ

LWT °F	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE											
		115°F				120°F (See Note 4)				125°F (See Note 4)			
		TONS	KW	EER	APLV	TONS	KW	EER	APLV	TONS	KW	EER	APLV
60	021SZB	24.3	28.3	9.2	14.3	23.3	29.3	8.6	13.9	22.3	30.3	8.0	14.1
	024SZB	27.5	35.2	8.6	14.2	26.3	36.4	8.0	13.7	—	—	—	—
	027SZB	29.8	38.3	8.6	14.5	28.7	39.5	8.1	14.0	—	—	—	—
	030SZB	35.5	45.4	8.5	13.0	34.2	47.0	7.9	13.5	33.1	48.6	7.4	13.1
	035SZB	40.1	50.8	8.7	13.8	38.7	52.5	8.1	13.4	—	—	—	—
	030DZB	35.7	42.4	9.3	15.3	34.0	43.7	8.6	14.9	32.2	44.8	8.0	14.4
	035DZB	41.4	51.3	9.0	14.6	39.8	52.9	8.4	14.2	—	—	—	—
	040DZB	46.9	55.8	9.0	14.5	44.9	57.7	8.4	14.1	43.0	59.5	7.8	13.7
	045DZB	51.5	65.9	8.6	14.4	—	—	—	—	—	—	—	—
	050DZB	56.8	73.1	8.6	13.7	54.6	75.6	8.0	13.3	—	—	—	—
	052DZB	58.0	77.6	8.3	13.2	—	—	—	—	—	—	—	—
	055DZB	63.0	86.7	8.1	12.4	—	—	—	—	—	—	—	—
	062DZB	71.4	91.0	8.5	13.7	68.9	94.2	8.0	13.4	66.4	97.4	7.4	13.0
	070DZB	77.3	101.9	8.3	13.2	74.7	105.1	7.8	12.8	—	—	—	—
	075DZB	84.0	111.6	8.3	13.6	80.8	115.0	7.8	13.3	—	—	—	—
	080DZB	88.7	122.3	8.1	12.4	85.2	125.8	7.6	12.0	—	—	—	—
	085DZB	98.1	125.0	8.5	14.1	93.7	129.0	7.9	13.8	89.2	133.0	7.3	14.0
	090DZB	103.1	131.1	8.6	14.7	98.9	135.1	8.0	14.3	—	—	—	—
	100DZB	110.1	147.7	8.2	14.5	105.7	152.6	7.7	14.2	—	—	—	—
	102DZB	114.5	153.9	8.2	14.5	—	—	—	—	—	—	—	—
112DZB	128.5	166.9	8.4	13.9	124.0	172.5	7.9	13.6	—	—	—	—	
120DZB	139.9	190.0	8.1	14.2	—	—	—	—	—	—	—	—	
130DZB	147.7	197.7	8.3	14.1	142.9	204.2	7.8	13.8	—	—	—	—	
140DZB	156.0	204.8	8.4	13.9	150.8	211.4	7.9	13.6	—	—	—	—	
155DZB	171.5	225.4	8.4	14.3	165.3	232.3	7.9	14.0	—	—	—	—	
170DZB	184.8	250.7	8.2	14.2	—	—	—	—	—	—	—	—	
180DZB	205.9	276.3	8.3	13.6	198.8	283.6	7.8	13.3	—	—	—	—	
185DZB	212.9	282.0	8.4	13.8	205.6	289.6	7.9	13.5	—	—	—	—	
190DZB	220.1	308.6	8.0	12.1	—	—	—	—	—	—	—	—	
200DZB	227.9	315.6	8.1	12.3	—	—	—	—	—	—	—	—	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 10°F water range in evaporator & .0001 fouling factor
 (2) ARI Standard 550/590-98 "NPLV" ("Non-Standard Part Load Value) has replaced ARI Standard 590-92 "APLV" (Applied Part Load Value) ratings.
 (3) Interpolation between ratings is permissible but extrapolation is not
 (4) KW is for compressor only. EER is for entire unit. See Physical Specs for fan kW
 (5) High Ambient Applications over 118°F require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		30°C			35°C			40°C		
		kWo	kWi	COP	kWo	kWi	COP	kWo	kWi	COP
4.5	021SZB	73.5	19.8	3.2	69.3	21.1	2.9	65.1	22.5	2.5
	024SZB	84.3	24.2	3.1	79.4	25.8	2.7	74.5	27.4	2.4
	**027SZB	97.0	27.2	3.2	91.2	28.9	2.8	85.4	30.6	2.5
	**030SZB	114.9	32.1	3.1	107.9	34.3	2.8	101.2	36.5	2.5
	**035SZB	125.5	35.6	3.1	117.9	38.1	2.8	110.5	40.5	2.4
	**030DZB	113.3	30.0	3.4	105.9	32.1	3.0	98.5	34.2	2.6
	**035DZB	133.9	36.6	3.3	125.6	39.1	2.9	117.4	41.6	2.6
	**040DZB	146.7	39.5	3.2	138.3	42.2	2.9	129.9	44.9	2.5
	**045DZB	170.5	47.5	3.2	160.4	50.5	2.8	150.3	53.5	2.5
	**050DZB	182.2	51.6	3.1	171.2	54.8	2.8	160.4	58.0	2.5
	**052DZB	191.4	55.2	3.1	179.9	58.5	2.8	168.3	61.7	2.5
	**055DZB	204.8	60.9	3.0	192.6	64.6	2.7	180.8	68.3	2.4
	**062DZB	229.8	64.2	3.1	215.0	68.5	2.8	200.5	72.6	2.4
	**070DZB	251.0	72.5	3.1	234.7	77.3	2.7	218.8	81.8	2.4
	**075DZB	271.9	79.3	3.1	254.6	84.4	2.7	237.4	89.3	2.4
	**080DZB	291.9	87.4	3.0	273.6	92.7	2.7	255.2	97.8	2.4
	**085DZB	314.8	88.7	3.1	295.9	94.4	2.8	276.8	99.9	2.5
	**090DZB	341.5	94.8	3.2	320.6	100.7	2.8	299.7	106.5	2.5
	**100DZB	363.1	104.8	3.1	340.6	111.2	2.8	318.2	117.4	2.4
	**102DZB	383.2	110.5	3.1	359.8	117.0	2.8	336.1	123.3	2.5
**112DZB	424.7	119.6	3.1	398.0	127.2	2.8	371.9	134.6	2.5	
**120DZB	452.7	132.7	3.0	423.9	141.1	2.7	396.2	149.4	2.4	
**130DZB	475.3	138.9	3.1	445.2	147.8	2.7	416.0	156.6	2.4	
**140DZB	498.2	144.6	3.0	466.7	154.1	2.7	436.0	163.4	2.4	
**155DZB	556.0	160.1	3.1	521.9	170.6	2.8	488.0	180.8	2.4	
**170DZB	596.6	176.5	3.1	560.5	187.7	2.7	524.0	198.4	2.4	
**180DZB	650.5	197.0	3.0	612.0	208.5	2.7	573.9	219.5	2.4	
185DZB	650.5	197.0	3.0	612.0	208.5	2.7	573.9	219.5	2.4	
**190DZB	701.7	223.0	2.9	660.7	234.7	2.6	620.8	245.6	2.3	
200DZB	701.7	223.0	2.9	660.7	234.7	2.6	620.8	245.6	2.3	
5.5	021SZB	76.1	20.0	3.3	71.8	21.4	2.9	67.4	22.8	2.6
	024SZB	87.2	24.6	3.1	82.2	26.2	2.8	77.1	27.8	2.5
	027SZB	97.4	27.3	3.2	91.6	29.0	2.9	85.8	30.6	2.5
	030SZB	111.8	31.7	3.1	105.1	33.9	2.7	98.6	36.0	2.4
	*035SZB	126.2	35.7	3.1	118.6	38.2	2.8	111.1	40.6	2.5
	030DZB	113.1	30.0	3.4	105.8	32.1	3.0	98.5	34.2	2.6
	035DZB	134.7	36.7	3.3	126.5	39.2	2.9	118.2	41.7	2.6
	040DZB	147.3	39.5	3.2	138.9	42.3	2.9	130.5	44.9	2.5
	045DZB	166.0	46.9	3.1	156.4	49.9	2.8	146.7	52.8	2.5
	050DZB	183.2	51.7	3.2	172.4	55.0	2.8	161.7	58.2	2.5
	052DZB	192.1	55.3	3.1	180.9	58.6	2.8	169.4	61.9	2.5
	055DZB	205.3	61.0	3.1	193.4	64.8	2.7	181.7	68.5	2.4
	062DZB	226.5	63.8	3.1	212.8	68.1	2.7	199.3	72.4	2.4
	070DZB	245.7	71.9	3.0	230.6	76.6	2.7	215.9	81.3	2.4
	075DZB	269.1	79.0	3.0	252.9	84.1	2.7	236.7	89.1	2.4
	080DZB	287.3	86.7	3.0	270.3	92.2	2.7	253.0	97.4	2.4
	085DZB	309.6	88.1	3.1	290.7	93.7	2.7	271.6	99.0	2.4
	*090DZB	337.6	94.3	3.2	317.4	100.3	2.8	296.9	106.1	2.5
	100DZB	357.8	104.2	3.1	336.3	110.5	2.7	314.7	116.7	2.4
	102DZB	377.4	109.7	3.1	354.7	116.2	2.8	331.8	122.5	2.5
*112DZB	413.6	118.2	3.1	387.7	125.6	2.7	362.1	132.8	2.4	
120DZB	447.8	132.1	3.0	420.3	140.5	2.7	393.5	148.9	2.4	
130DZB	469.1	138.1	3.0	440.4	147.1	2.7	412.3	155.9	2.4	
140DZB	490.5	143.6	3.0	460.6	153.2	2.7	431.2	162.5	2.4	
155DZB	539.8	158.0	3.1	507.5	168.5	2.7	475.2	178.5	2.4	
170DZB	593.5	176.1	3.0	557.8	187.3	2.7	521.6	197.9	2.4	
180DZB	647.7	196.6	3.0	609.7	208.2	2.6	571.9	219.1	2.4	
185DZB	673.0	200.2	3.0	633.4	212.1	2.7	594.1	223.4	2.4	
190DZB	696.8	222.3	2.9	656.5	234.0	2.6	617.1	244.9	2.3	
200DZB	723.5	226.9	2.9	683.7	239.0	2.6	642.8	250.2	2.4	

- NOTES: (1) Double asterisk (**) indicates ratings with CH3 oversized evaporator for 40°F LWT
 (2) Asterisk (*) indicates ratings with CH2 oversized evaporator for 42°F LWT
 (3) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
 (4) Interpolation between ratings is permissible but extrapolation is not
 (5) KW is for compressor only. COP is for entire unit. See Physical Specs for fan kW

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		45°C			49°C (See Note 6)			52°C (See Note 6)		
		kWo	kWi	COP	kWo	kWi	COP	kWo	kWi	COP
4.5	021SZB	60.0	24.0	2.2	57.3	24.7	2.1	54.6	25.5	1.9
	024SZB	68.6	29.2	2.1	65.6	30.2	2.0	62.6	31.1	1.8
	**027SZB	78.6	32.5	2.2	75.2	33.5	2.1	71.8	34.5	1.9
	**030SZB	93.6	39.1	2.1	90.0	40.4	2.0	86.7	41.7	1.9
	**035SZB	102.1	43.3	2.1	98.1	44.7	2.0	94.4	46.0	1.9
	**030DZB	89.4	36.4	2.2	84.7	37.4	2.1	79.9	38.3	1.9
	**035DZB	107.5	44.3	2.2	102.6	45.6	2.1	97.7	46.8	1.9
	**040DZB	119.5	47.9	2.2	114.1	49.4	2.1	108.7	50.8	1.9
	**045DZB	138.0	56.9	2.2	131.8	58.6	2.0	125.6	60.3	1.9
	**050DZB	147.4	61.8	2.2	140.8	63.7	2.0	134.3	65.6	1.9
	**052DZB	154.5	65.5	2.2	147.6	67.4	2.0	140.7	69.3	1.9
	**055DZB	166.9	72.7	2.1	160.2	74.9	2.0	—	—	—
	**062DZB	184.1	77.5	2.1	176.4	79.9	2.0	169.1	82.3	1.8
	**070DZB	200.7	87.1	2.1	192.2	89.5	1.9	184.1	91.9	1.8
	**075DZB	217.1	94.8	2.1	207.2	97.4	1.9	197.4	99.9	1.8
	**080DZB	232.8	103.6	2.1	221.6	106.3	1.9	210.1	108.9	1.8
	**085DZB	253.4	106.4	2.1	241.4	109.5	2.0	229.3	112.6	1.8
	**090DZB	274.3	113.1	2.2	261.4	116.3	2.0	248.4	119.5	1.9
	**100DZB	291.3	124.7	2.1	277.7	128.3	2.0	263.9	131.9	1.8
	**102DZB	307.7	130.7	2.1	293.4	134.3	2.0	278.9	137.9	1.9
**112DZB	341.5	143.4	2.1	326.9	147.7	2.0	312.6	151.9	1.9	
**120DZB	365.0	159.3	2.1	350.5	164.1	2.0	336.9	169.0	1.8	
**130DZB	382.8	166.8	2.1	367.3	171.7	2.0	352.6	176.6	1.8	
**140DZB	400.8	174.0	2.1	384.3	179.0	1.9	368.5	183.9	1.8	
**155DZB	448.0	192.4	2.1	428.4	198.0	2.0	409.1	203.3	1.8	
**170DZB	479.7	210.5	2.1	457.3	216.3	1.9	434.7	221.8	1.8	
**180DZB	528.7	231.8	2.1	506.4	237.6	2.0	484.1	243.1	1.8	
185DZB	528.7	231.8	2.1	506.4	237.6	2.0	484.1	243.1	1.8	
**190DZB	574.7	257.7	2.1	552.5	263.4	1.9	530.8	268.7	1.8	
200DZB	574.7	257.7	2.1	552.5	263.4	1.9	530.8	268.7	1.8	
5.5	021SZB	62.1	24.4	2.3	59.3	25.2	2.1	56.5	25.9	1.9
	024SZB	71.0	29.8	2.2	67.9	30.7	2.0	64.8	31.7	1.9
	027SZB	79.0	32.6	2.2	75.6	33.6	2.1	72.2	34.6	1.9
	030SZB	91.2	38.6	2.1	87.7	39.9	2.0	84.5	41.1	1.8
	*035SZB	102.7	43.4	2.1	98.7	44.8	2.0	94.9	46.1	1.9
	030DZB	89.5	36.4	2.2	84.8	37.4	2.1	80.1	38.3	1.9
	035DZB	108.3	44.4	2.2	103.3	45.7	2.1	98.4	47.0	1.9
	040DZB	120.0	48.0	2.2	114.7	49.5	2.1	109.3	51.0	1.9
	045DZB	135.0	56.2	2.2	129.0	57.9	2.0	123.0	59.5	1.9
	050DZB	148.8	62.1	2.2	142.3	64.1	2.0	135.8	66.0	1.9
	052DZB	155.7	65.8	2.2	148.9	67.8	2.0	142.1	69.7	1.9
	055DZB	168.1	73.0	2.1	161.5	75.2	2.0	—	—	—
	062DZB	184.0	77.5	2.1	176.8	80.0	2.0	170.0	82.6	1.9
	070DZB	199.2	86.7	2.1	191.3	89.3	1.9	183.8	91.8	1.8
	075DZB	217.7	94.9	2.1	208.4	97.7	1.9	199.2	100.4	1.8
	080DZB	232.1	103.5	2.1	221.6	106.3	1.9	210.9	109.1	1.8
	085DZB	248.3	105.3	2.1	236.2	108.3	2.0	224.0	111.2	1.8
	*090DZB	272.1	112.7	2.2	259.4	115.9	2.0	246.6	119.0	1.9
	100DZB	288.4	124.0	2.1	275.0	127.7	2.0	261.5	131.3	1.8
	102DZB	304.1	129.9	2.1	290.1	133.5	2.0	275.8	137.0	1.8
*112DZB	332.1	141.2	2.1	317.4	145.3	2.0	302.9	149.3	1.8	
120DZB	363.2	158.9	2.1	349.0	163.8	1.9	335.6	168.6	1.8	
130DZB	380.1	166.2	2.1	364.9	171.2	2.0	350.5	176.0	1.8	
140DZB	397.3	173.2	2.1	381.2	178.3	1.9	365.8	183.1	1.8	
155DZB	437.1	190.1	2.1	417.8	195.5	2.0	399.1	200.6	1.8	
170DZB	477.4	210.0	2.1	455.4	215.8	1.9	432.4	221.2	1.8	
180DZB	526.7	231.4	2.1	504.3	237.1	1.9	482.1	242.6	1.8	
185DZB	547.6	236.1	2.1	524.5	242.1	2.0	501.6	247.8	1.9	
190DZB	571.3	256.9	2.1	549.0	262.5	1.9	527.2	267.8	1.8	
200DZB	595.6	262.8	2.1	572.8	268.6	2.0	550.6	274.1	1.9	

NOTES: (1) Double asterisk (**) indicates ratings with CH3 oversized evaporator for 40°F LWT
 (2) Asterisk (*) indicates ratings with CH2 oversized evaporator for 42°F LWT
 (3) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
 (4) Interpolation between ratings is permissible but extrapolation is not
 (5) KW is for compressor only. COP is for entire unit. See Physical Specs for fan kW
 (6) High Ambient Applications over 48°C require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		30°C			35°C			40°C		
		kW _o	kW _i	COP	kW _o	kW _i	COP	kW _o	kW _i	COP
6.5	021SZB	78.7	20.3	3.4	74.2	21.7	3.0	69.7	23.1	2.7
	024SZB	90.2	24.9	3.2	85.0	26.6	2.9	79.7	28.3	2.5
	027SZB	100.4	27.7	3.3	94.4	29.4	2.9	88.5	31.1	2.6
	030SZB	115.4	32.2	3.1	108.5	34.4	2.8	101.8	36.6	2.5
	035SZB	130.3	36.2	3.2	122.4	38.7	2.8	114.8	41.2	2.5
	030DZB	117.5	30.4	3.4	109.9	32.6	3.0	102.3	34.7	2.7
	035DZB	139.4	37.2	3.4	130.9	39.8	3.0	122.4	42.3	2.7
	040DZB	152.3	40.1	3.3	143.6	42.9	2.9	134.9	45.6	2.6
	045DZB	171.3	47.6	3.2	161.4	50.7	2.8	151.5	53.6	2.5
	050DZB	189.1	52.4	3.2	178.0	55.8	2.9	166.9	59.2	2.6
	052DZB	197.2	56.1	3.2	186.1	59.5	2.8	174.6	62.9	2.5
	055DZB	211.4	61.9	3.1	199.1	65.8	2.8	187.1	69.7	2.5
	062DZB	233.9	64.7	3.2	219.6	69.2	2.8	205.8	73.6	2.5
	070DZB	253.6	72.9	3.1	238.1	77.8	2.7	223.0	82.6	2.4
	075DZB	277.8	80.1	3.1	261.0	85.4	2.8	244.4	90.5	2.4
	080DZB	296.5	88.0	3.0	278.9	93.7	2.7	261.1	99.0	2.4
	085DZB	320.4	89.3	3.1	301.0	95.1	2.8	281.3	100.7	2.5
	090DZB	348.7	95.6	3.2	327.8	101.8	2.9	306.8	107.8	2.5
	100DZB	369.7	105.7	3.1	347.4	112.3	2.8	325.1	118.7	2.5
	102DZB	388.0	111.3	3.1	365.7	118.0	2.8	342.2	124.5	2.5
112DZB	427.2	119.9	3.1	400.4	127.6	2.8	374.1	135.0	2.5	
120DZB	462.6	134.1	3.1	434.3	142.9	2.7	406.7	151.5	2.4	
130DZB	484.5	140.2	3.1	455.1	149.4	2.8	426.2	158.5	2.4	
140DZB	506.5	145.7	3.1	475.9	155.5	2.7	445.8	165.1	2.4	
155DZB	557.8	160.4	3.1	524.7	171.1	2.8	491.4	181.5	2.5	
170DZB	613.7	178.9	3.1	576.8	190.4	2.8	539.5	201.4	2.5	
180DZB	669.7	199.7	3.0	630.6	211.7	2.7	591.5	223.0	2.4	
185DZB	695.9	203.4	3.1	655.1	215.7	2.8	614.7	227.4	2.5	
190DZB	718.6	226.0	2.9	679.0	238.1	2.6	638.7	249.4	2.4	
200DZB	744.9	230.8	2.9	704.8	243.2	2.7	665.2	254.9	2.4	
7.0	021SZB	80.0	20.4	3.4	75.5	21.9	3.0	70.9	23.3	2.7
	024SZB	91.7	25.1	3.2	86.4	26.8	2.9	81.0	28.5	2.6
	027SZB	102.0	27.8	3.3	95.8	29.6	2.9	89.8	31.3	2.6
	030SZB	117.2	32.4	3.2	110.3	34.7	2.8	103.5	36.9	2.5
	035SZB	132.3	36.4	3.2	124.4	39.0	2.8	116.7	41.5	2.5
	030DZB	119.7	30.6	3.5	112.0	32.8	3.1	104.3	35.0	2.7
	035DZB	137.0	36.9	3.4	128.7	39.5	3.0	120.3	42.0	2.6
	040DZB	154.8	40.3	3.3	146.0	43.2	2.9	137.1	46.0	2.6
	045DZB	173.9	47.9	3.2	164.0	51.0	2.9	153.9	54.1	2.5
	050DZB	192.1	52.8	3.3	180.8	56.2	2.9	169.5	59.6	2.6
	052DZB	199.9	56.5	3.2	188.6	60.0	2.8	177.2	63.4	2.5
	055DZB	214.5	62.4	3.1	202.0	66.3	2.8	189.8	70.2	2.5
	062DZB	237.6	65.2	3.2	223.1	69.7	2.8	209.1	74.1	2.5
	070DZB	257.5	73.4	3.1	241.8	78.4	2.8	226.4	83.2	2.4
	075DZB	282.2	80.7	3.1	265.1	86.0	2.8	248.3	91.3	2.5
	080DZB	301.3	88.7	3.1	283.3	94.4	2.7	265.2	99.9	2.4
	085DZB	325.9	90.0	3.2	306.2	95.9	2.8	286.2	101.5	2.5
	090DZB	346.5	95.4	3.2	325.2	101.4	2.9	303.7	107.2	2.5
	100DZB	375.6	106.5	3.2	353.0	113.2	2.8	330.3	119.7	2.5
	102DZB	393.3	112.0	3.2	371.1	118.9	2.8	347.5	125.5	2.5
112DZB	427.9	120.1	3.1	402.4	127.9	2.8	377.1	135.6	2.5	
120DZB	470.0	135.2	3.1	441.3	144.1	2.8	413.4	152.8	2.5	
130DZB	492.3	141.2	3.1	462.4	150.6	2.8	433.1	159.9	2.5	
140DZB	514.7	146.7	3.1	483.6	156.7	2.8	453.0	166.4	2.4	
155DZB	567.1	161.6	3.1	533.4	172.4	2.8	499.7	182.9	2.5	
170DZB	623.4	180.3	3.1	586.5	192.0	2.8	548.4	203.2	2.5	
180DZB	680.8	201.3	3.0	641.2	213.4	2.7	601.6	224.9	2.4	
185DZB	707.5	205.0	3.1	666.2	217.5	2.8	625.2	229.3	2.5	
190DZB	729.1	227.9	2.9	690.1	240.2	2.6	649.6	251.6	2.4	
200DZB	755.7	232.7	3.0	715.2	245.3	2.7	675.7	257.2	2.4	

NOTES: (1) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
 (2) Interpolation between ratings is permissible but extrapolation is not
 (3) KW is for compressor only. COP is for entire unit. See Physical Specs for fan kW

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		45°C			49°C (See Note 4)			52°C (See Note 4)		
		kWo	kWi	COP	kWo	kWi	COP	kWo	kWi	COP
6.5	021SZB	64.2	24.8	2.3	61.3	25.6	2.1	—	—	—
	024SZB	73.4	30.3	2.2	70.2	31.3	2.0	—	—	—
	027SZB	81.5	33.2	2.2	78.0	34.2	2.1	—	—	—
	030SZB	94.2	39.2	2.1	90.6	40.6	2.0	—	—	—
	035SZB	106.1	44.1	2.2	101.9	45.5	2.0	—	—	—
	030DZB	93.0	37.0	2.3	88.2	38.0	2.1	—	—	—
	035DZB	112.2	45.2	2.3	107.1	46.5	2.1	—	—	—
	040DZB	124.1	48.8	2.3	118.6	50.3	2.1	—	—	—
	045DZB	139.4	57.2	2.2	133.2	58.9	2.0	—	—	—
	050DZB	153.6	63.2	2.2	146.9	65.2	2.1	—	—	—
	052DZB	160.6	66.9	2.2	153.6	68.9	2.0	—	—	—
	055DZB	173.3	74.3	2.2	166.6	76.6	2.0	—	—	—
	062DZB	190.0	78.8	2.2	182.6	81.4	2.0	—	—	—
	070DZB	205.7	88.1	2.1	197.6	90.8	2.0	—	—	—
	075DZB	224.7	96.5	2.1	215.1	99.3	2.0	—	—	—
	080DZB	239.5	105.2	2.1	228.8	108.2	1.9	—	—	—
	085DZB	257.0	107.2	2.1	244.5	110.3	2.0	—	—	—
	090DZB	281.2	114.6	2.2	268.2	118.0	2.1	—	—	—
	100DZB	297.9	126.3	2.1	284.2	130.1	2.0	—	—	—
	102DZB	313.9	132.2	2.2	299.5	135.9	2.0	—	—	—
112DZB	343.1	143.8	2.2	328.0	148.0	2.0	—	—	—	
120DZB	375.3	161.8	2.1	360.7	166.9	2.0	—	—	—	
130DZB	393.0	169.1	2.1	377.4	174.3	2.0	—	—	—	
140DZB	410.9	176.1	2.1	394.3	181.4	2.0	—	—	—	
155DZB	451.8	193.3	2.1	432.3	198.9	2.0	—	—	—	
170DZB	494.1	214.0	2.1	470.7	219.7	2.0	—	—	—	
180DZB	545.2	235.7	2.1	522.2	241.6	2.0	—	—	—	
185DZB	566.8	240.5	2.2	543.1	246.6	2.0	—	—	—	
190DZB	591.7	261.8	2.1	568.9	267.6	2.0	—	—	—	
200DZB	616.8	267.8	2.1	593.4	273.8	2.0	—	—	—	
7.0	021SZB	65.3	25.0	2.3	62.4	25.8	2.2	59.4	26.6	2.0
	024SZB	74.6	30.6	2.2	71.3	31.6	2.1	68.0	32.6	1.9
	027SZB	82.7	33.4	2.3	79.2	34.5	2.1	75.7	35.5	2.0
	030SZB	95.7	39.6	2.2	92.1	40.9	2.0	88.6	42.2	1.9
	035SZB	107.8	44.5	2.2	103.6	45.9	2.0	99.6	47.3	1.9
	030DZB	94.8	37.3	2.3	89.8	38.3	2.1	84.8	39.3	2.0
	035DZB	110.3	44.8	2.3	105.3	46.2	2.1	100.3	47.4	2.0
	040DZB	126.2	49.2	2.3	120.6	50.7	2.1	114.8	52.3	2.0
	045DZB	141.6	57.6	2.2	135.4	59.4	2.1	129.1	61.1	1.9
	050DZB	156.0	63.7	2.2	149.2	65.8	2.1	142.4	67.8	1.9
	052DZB	163.1	67.5	2.2	156.0	69.5	2.1	—	—	—
	055DZB	175.8	75.0	2.2	169.0	77.3	2.0	—	—	—
	062DZB	193.0	79.5	2.2	185.5	82.1	2.0	178.3	84.8	1.9
	070DZB	208.9	88.8	2.1	200.8	91.5	2.0	192.9	94.2	1.9
	075DZB	228.3	97.3	2.1	218.5	100.2	2.0	208.9	102.9	1.9
	080DZB	243.4	106.1	2.1	232.4	109.1	2.0	221.3	112.0	1.8
	085DZB	261.4	108.2	2.2	248.8	111.3	2.0	235.9	114.5	1.9
	090DZB	277.6	113.9	2.2	264.3	117.1	2.0	250.8	120.2	1.9
	100DZB	302.8	127.5	2.2	288.9	131.3	2.0	274.8	135.1	1.9
	102DZB	318.8	133.3	2.2	304.3	137.2	2.0	289.7	140.9	1.9
112DZB	347.4	144.7	2.2	332.9	149.2	2.0	318.6	153.6	1.9	
120DZB	381.6	163.3	2.1	366.7	168.5	2.0	352.6	173.6	1.9	
130DZB	399.6	170.6	2.1	383.8	175.9	2.0	368.7	181.0	1.9	
140DZB	417.7	177.6	2.1	401.0	183.0	2.0	384.8	188.1	1.9	
155DZB	459.5	195.0	2.2	439.6	200.7	2.0	419.9	206.2	1.9	
170DZB	502.2	215.8	2.1	478.7	221.7	2.0	454.8	227.5	1.8	
180DZB	554.6	237.8	2.1	531.3	243.8	2.0	508.0	249.5	1.9	
185DZB	576.5	242.7	2.2	552.5	248.9	2.0	528.5	254.9	1.9	
190DZB	602.1	264.3	2.1	579.0	270.1	2.0	—	—	—	
200DZB	627.5	270.3	2.1	603.9	276.5	2.0	—	—	—	

NOTES: (1) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
 (2) Interpolation between ratings is permissible but extrapolation is not
 (3) kW is for compressor only. COP is for entire unit. See Physical Specs for fan kW
 (4) High Ambient Applications over 48°C require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		30°C			35°C			40°C		
		kW _o	kW _i	COP	kW _o	kW _i	COP	kW _o	kW _i	COP
8.0	021SZB	82.6	20.7	3.5	78.0	22.2	3.1	73.2	23.7	2.7
	024SZB	94.7	25.5	3.3	89.2	27.2	2.9	83.7	29.0	2.6
	027SZB	105.1	28.2	3.3	98.7	30.0	3.0	92.5	31.8	2.6
	030SZB	121.0	32.8	3.2	113.8	35.2	2.9	106.8	37.5	2.5
	035SZB	136.6	36.9	3.3	128.4	39.5	2.9	120.4	42.1	2.6
	030DZB	124.1	31.0	3.6	116.2	33.3	3.1	108.2	35.5	2.8
	035DZB	141.7	37.4	3.4	133.1	40.1	3.0	124.5	42.7	2.7
	040DZB	159.9	40.8	3.4	150.9	43.8	3.0	141.7	46.6	2.7
	045DZB	179.0	48.5	3.3	169.0	51.7	2.9	158.7	54.9	2.6
	050DZB	198.2	53.5	3.3	186.5	57.0	2.9	174.8	60.5	2.6
	052DZB	205.3	57.3	3.2	193.6	60.8	2.9	182.2	64.4	2.6
	055DZB	220.7	63.3	3.2	207.8	67.4	2.8	195.2	71.4	2.5
	062DZB	245.0	66.1	3.2	230.1	70.7	2.9	215.6	75.3	2.5
	070DZB	265.6	74.4	3.2	249.4	79.5	2.8	233.6	84.5	2.5
	075DZB	291.0	81.8	3.2	273.6	87.3	2.8	256.2	92.7	2.5
	080DZB	310.7	90.0	3.1	292.3	95.9	2.8	273.8	101.5	2.5
	085DZB	337.1	91.2	3.2	316.7	97.3	2.9	295.9	103.2	2.6
	090DZB	357.8	96.7	3.3	335.8	102.9	2.9	313.6	108.9	2.6
	100DZB	386.9	108.0	3.2	364.3	114.9	2.9	340.9	121.7	2.5
	102DZB	404.0	113.6	3.2	381.1	120.6	2.9	358.2	127.5	2.6
112DZB	441.4	121.8	3.2	415.1	129.8	2.9	389.1	137.8	2.5	
120DZB	484.0	137.3	3.2	455.6	146.5	2.8	426.9	155.5	2.5	
130DZB	508.2	143.4	3.2	477.5	153.0	2.8	447.4	162.5	2.5	
140DZB	531.3	148.8	3.2	499.4	159.1	2.8	468.0	169.1	2.5	
155DZB	585.8	163.9	3.2	551.2	175.1	2.8	516.5	185.9	2.5	
170DZB	641.8	183.1	3.2	605.7	195.1	2.8	566.9	206.6	2.5	
180DZB	703.2	204.5	3.1	662.5	217.0	2.8	622.0	228.8	2.5	
185DZB	730.3	208.3	3.2	688.5	221.1	2.8	646.4	233.3	2.5	
190DZB	750.1	231.8	3.0	710.3	244.4	2.7	671.4	256.2	2.4	
200DZB	777.4	236.6	3.0	736.0	249.6	2.7	695.7	261.8	2.5	
9.0	021SZB	85.4	20.9	3.5	80.5	22.5	3.1	75.7	24.0	2.8
	024SZB	97.8	25.8	3.4	92.1	27.6	3.0	86.4	29.4	2.7
	027SZB	107.9	28.6	3.4	101.7	30.4	3.0	95.3	32.3	2.7
	030SZB	124.8	33.3	3.3	117.4	35.7	2.9	110.3	38.0	2.6
	035SZB	140.9	37.4	3.3	132.5	40.1	3.0	124.3	42.7	2.6
	030DZB	128.5	31.4	3.7	120.4	33.8	3.2	112.2	36.0	2.8
	035DZB	146.4	37.9	3.5	137.5	40.7	3.1	128.7	43.3	2.7
	040DZB	165.1	41.3	3.5	155.8	44.4	3.1	146.3	47.3	2.7
	045DZB	184.3	49.1	3.3	173.9	52.5	3.0	163.5	55.7	2.6
	050DZB	204.2	54.2	3.4	192.3	57.8	3.0	180.2	61.5	2.7
	052DZB	210.7	58.1	3.3	198.7	61.7	2.9	186.9	65.4	2.6
	055DZB	226.7	64.2	3.2	213.7	68.4	2.9	200.8	72.6	2.5
	062DZB	252.7	66.9	3.3	237.4	71.7	2.9	222.5	76.4	2.6
	070DZB	273.8	75.4	3.2	257.2	80.6	2.9	241.0	85.8	2.5
	075DZB	299.6	83.0	3.2	282.2	88.6	2.9	264.2	94.1	2.6
	080DZB	319.3	91.4	3.2	301.4	97.3	2.8	282.3	103.1	2.5
	085DZB	348.5	92.5	3.3	327.3	98.8	2.9	305.9	104.9	2.6
	090DZB	369.4	98.0	3.3	346.6	104.4	3.0	323.7	110.6	2.6
	100DZB	397.8	109.6	3.3	375.4	116.7	2.9	351.7	123.7	2.6
	102DZB	415.0	115.2	3.2	391.3	122.4	2.9	367.8	129.5	2.6
112DZB	455.2	123.4	3.3	428.1	131.8	2.9	401.4	140.0	2.6	
120DZB	497.6	139.4	3.2	469.3	148.8	2.9	440.8	158.2	2.5	
130DZB	524.0	145.5	3.2	492.9	155.4	2.9	462.0	165.2	2.6	
140DZB	548.2	150.9	3.2	515.5	161.5	2.9	483.3	171.7	2.5	
155DZB	604.9	166.3	3.3	569.2	177.8	2.9	533.4	188.9	2.6	
170DZB	660.4	186.0	3.2	623.1	198.3	2.9	585.7	210.1	2.6	
180DZB	725.9	207.7	3.2	684.5	220.5	2.8	642.8	232.7	2.5	
185DZB	751.4	211.5	3.2	710.7	224.7	2.9	668.0	237.3	2.6	
190DZB	771.3	235.6	3.0	730.7	248.5	2.7	690.9	260.7	2.4	
200DZB	799.3	240.5	3.0	757.0	253.9	2.7	715.9	266.4	2.5	

NOTES: (1) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
 (2) Interpolation between ratings is permissible but extrapolation is not
 (3) KW is for compressor only. COP is for entire unit. See Physical Specs for fan kW

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		45°C			49°C (See Note 4)			52°C (See Note 4)		
		kW _o	kW _i	COP	kW _o	kW _i	COP	kW _o	kW _i	COP
8.0	021SZB	67.4	25.4	2.4	64.4	26.2	2.2	61.4	27.0	2.0
	024SZB	77.0	31.1	2.3	73.6	32.2	2.1	70.2	33.2	1.9
	027SZB	85.2	34.0	2.3	81.6	35.0	2.1	78.0	36.1	2.0
	030SZB	98.8	40.2	2.2	95.1	41.6	2.1	91.5	43.0	1.9
	035SZB	111.3	45.2	2.2	107.0	46.6	2.1	102.9	48.1	2.0
	030DZB	98.4	37.9	2.4	93.3	39.0	2.2	87.9	39.9	2.0
	035DZB	114.2	45.6	2.3	109.0	46.9	2.2	103.8	48.3	2.0
	040DZB	130.4	49.9	2.3	124.5	51.6	2.2	118.6	53.1	2.0
	045DZB	146.1	58.6	2.3	139.7	60.4	2.1	—	—	—
	050DZB	160.9	64.8	2.3	153.9	66.9	2.1	146.9	69.0	2.0
	052DZB	168.0	68.6	2.2	160.8	70.7	2.1	—	—	—
	055DZB	180.8	76.3	2.2	173.9	78.7	2.0	—	—	—
	062DZB	199.1	80.8	2.2	191.3	83.5	2.1	184.0	86.2	1.9
	070DZB	215.6	90.3	2.2	207.1	93.1	2.0	199.0	95.8	1.9
	075DZB	235.6	98.8	2.2	225.5	101.8	2.0	215.6	104.7	1.9
	080DZB	251.1	107.9	2.1	239.7	111.0	2.0	228.2	113.9	1.9
	085DZB	270.4	110.1	2.2	257.3	113.4	2.0	244.0	116.6	1.9
	090DZB	286.7	115.8	2.2	273.1	119.1	2.1	259.2	122.4	1.9
	100DZB	312.6	129.8	2.2	298.2	133.8	2.0	283.8	137.7	1.9
	102DZB	328.8	135.6	2.2	314.0	139.6	2.1	—	—	—
112DZB	358.6	147.2	2.2	343.7	151.9	2.1	329.1	156.4	1.9	
120DZB	394.3	166.3	2.2	379.0	171.7	2.0	364.5	177.0	1.9	
130DZB	412.9	173.7	2.2	396.6	179.1	2.0	381.1	184.3	1.9	
140DZB	431.7	180.6	2.2	414.4	186.1	2.0	397.7	191.4	1.9	
155DZB	474.9	198.3	2.2	454.4	204.2	2.0	434.0	209.9	1.9	
170DZB	519.2	219.6	2.2	494.8	225.8	2.0	470.1	231.7	1.9	
180DZB	573.7	242.0	2.2	549.7	248.2	2.0	525.6	254.2	1.9	
185DZB	596.3	247.1	2.2	571.5	253.5	2.1	546.9	259.7	1.9	
190DZB	622.8	269.3	2.1	599.2	275.3	2.0	—	—	—	
200DZB	649.1	275.4	2.2	625.1	281.8	2.1	—	—	—	
9.0	021SZB	69.6	25.8	2.4	66.6	26.6	2.2	63.4	27.5	2.1
	024SZB	79.5	31.6	2.3	75.9	32.7	2.1	72.4	33.9	2.0
	027SZB	87.8	34.5	2.3	84.1	35.6	2.2	80.4	36.7	2.0
	030SZB	102.0	40.9	2.2	98.1	42.3	2.1	94.4	43.7	2.0
	035SZB	114.9	45.9	2.3	110.4	47.4	2.1	106.2	48.8	2.0
	030DZB	101.9	38.5	2.4	96.6	39.6	2.2	91.2	40.6	2.1
	035DZB	118.1	46.3	2.4	112.7	47.7	2.2	107.4	49.1	2.0
	040DZB	134.6	50.7	2.4	128.6	52.4	2.2	122.5	54.0	2.0
	045DZB	150.6	59.5	2.3	144.0	61.4	2.1	—	—	—
	050DZB	165.8	65.8	2.3	158.7	68.0	2.1	151.5	70.2	2.0
	052DZB	173.0	69.8	2.3	165.6	72.0	2.1	—	—	—
	055DZB	186.0	77.6	2.2	178.9	80.1	2.1	—	—	—
	062DZB	205.4	82.1	2.2	197.4	84.9	2.1	189.8	87.7	2.0
	070DZB	222.4	91.7	2.2	213.7	94.6	2.1	205.3	97.3	1.9
	075DZB	243.0	100.4	2.2	232.6	103.5	2.1	222.3	106.4	1.9
	080DZB	259.0	109.7	2.2	247.2	112.8	2.0	235.3	115.9	1.9
	085DZB	279.5	112.0	2.2	266.0	115.4	2.1	252.2	118.8	1.9
	090DZB	296.0	117.8	2.3	282.0	121.2	2.1	267.9	124.5	2.0
	100DZB	322.5	132.1	2.2	307.7	136.2	2.1	292.9	140.3	1.9
	102DZB	338.9	138.0	2.3	323.8	142.1	2.1	—	—	—
112DZB	370.0	149.7	2.2	354.7	154.5	2.1	339.7	159.3	1.9	
120DZB	407.2	169.4	2.2	391.4	174.9	2.1	—	—	—	
130DZB	426.5	176.7	2.2	409.7	182.3	2.1	393.7	187.8	1.9	
140DZB	446.0	183.6	2.2	428.2	189.3	2.1	411.1	194.8	1.9	
155DZB	490.8	201.7	2.2	469.6	207.8	2.1	448.6	213.6	1.9	
170DZB	536.4	223.5	2.2	511.3	229.9	2.1	—	—	—	
180DZB	593.2	246.3	2.2	568.3	252.8	2.1	543.5	258.9	1.9	
185DZB	616.5	251.5	2.3	591.0	258.1	2.1	565.6	264.5	2.0	
190DZB	644.1	274.3	2.2	619.9	280.5	2.1	—	—	—	
200DZB	668.3	280.5	2.2	645.3	287.0	2.1	—	—	—	

NOTES: (1) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
 (2) Interpolation between ratings is permissible but extrapolation is not
 (3) kW is for compressor only. COP is for entire unit. See Physical Specs for fan kW
 (4) High Ambient Applications over 48°C require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		30°C			35°C			40°C		
		kW _o	kW _i	COP	kW _o	kW _i	COP	kW _o	kW _i	COP
10.0	021SZB	88.1	21.1	3.6	83.2	22.8	3.2	78.1	24.3	2.8
	024SZB	100.9	26.1	3.4	95.0	28.0	3.1	89.1	29.9	2.7
	027SZB	110.8	28.9	3.5	104.5	30.9	3.1	98.1	32.8	2.7
	030SZB	128.7	33.7	3.3	121.1	36.2	3.0	113.7	38.6	2.6
	035SZB	145.2	37.9	3.4	136.6	40.7	3.0	128.2	43.4	2.7
	030DZB	132.9	31.8	3.7	124.6	34.3	3.3	116.1	36.6	2.9
	035DZB	151.1	38.4	3.6	142.0	41.2	3.2	132.9	44.0	2.8
	040DZB	170.4	41.8	3.5	160.8	44.9	3.1	151.0	48.0	2.8
	045DZB	189.5	49.8	3.4	178.9	53.2	3.0	168.2	56.5	2.7
	050DZB	210.1	54.9	3.4	198.0	58.7	3.0	185.7	62.4	2.7
	052DZB	216.2	58.9	3.3	203.8	62.6	3.0	191.7	66.4	2.6
	055DZB	232.7	65.2	3.3	219.5	69.4	2.9	206.4	73.7	2.6
	062DZB	260.5	67.8	3.4	244.7	72.7	3.0	229.4	77.5	2.6
	070DZB	282.2	76.5	3.3	265.1	81.8	2.9	248.5	87.0	2.6
	075DZB	308.3	84.1	3.3	290.4	89.9	2.9	272.5	95.5	2.6
	080DZB	328.0	92.7	3.2	309.6	98.8	2.9	291.1	104.7	2.6
	085DZB	359.9	93.7	3.4	338.2	100.3	3.0	316.1	106.6	2.7
	090DZB	381.2	99.3	3.4	357.6	105.9	3.0	334.0	112.3	2.7
	100DZB	408.8	111.1	3.3	385.7	118.4	2.9	362.5	125.7	2.6
	102DZB	426.1	116.8	3.3	401.6	124.2	2.9	377.5	131.5	2.6
112DZB	469.5	125.1	3.3	441.6	133.6	3.0	413.9	142.1	2.6	
120DZB	511.4	141.5	3.3	482.4	151.2	2.9	454.1	160.8	2.6	
130DZB	538.6	147.6	3.3	508.3	157.8	2.9	476.8	167.9	2.6	
140DZB	565.5	153.1	3.3	532.0	163.8	2.9	498.9	174.4	2.6	
155DZB	624.4	168.7	3.3	587.7	180.5	2.9	550.9	191.9	2.6	
170DZB	679.0	188.9	3.3	641.1	201.4	2.9	602.6	213.5	2.6	
180DZB	746.7	210.8	3.2	706.6	224.0	2.9	664.0	236.6	2.6	
185DZB	772.8	214.7	3.3	731.0	228.3	2.9	689.6	241.3	2.6	
190DZB	792.6	239.4	3.0	751.2	252.7	2.7	710.7	265.3	2.5	
200DZB	821.3	244.4	3.1	778.2	258.2	2.8	736.2	271.1	2.5	
12.5	021SZB	95.2	21.7	3.8	89.9	23.5	3.4	84.4	25.1	3.0
	024SZB	108.7	27.0	3.6	102.6	29.0	3.2	96.1	31.0	2.8
	027SZB	118.2	29.9	3.6	111.4	31.9	3.2	104.7	33.9	2.8
	030SZB	138.8	34.8	3.5	130.6	37.4	3.1	122.6	40.0	2.7
	035SZB	156.7	39.1	3.6	147.4	42.1	3.2	138.5	44.9	2.8
	030DZB	144.0	32.8	3.9	135.1	35.4	3.5	126.0	37.9	3.0
	035DZB	163.3	39.5	3.8	153.7	42.6	3.3	143.9	45.5	2.9
	040DZB	184.0	43.0	3.7	173.6	46.3	3.3	163.1	49.6	2.9
	045DZB	203.2	51.3	3.5	191.7	55.0	3.1	180.2	58.5	2.8
	050DZB	225.3	56.6	3.6	212.3	60.7	3.2	199.3	64.7	2.8
	052DZB	230.4	60.8	3.4	217.1	64.8	3.1	204.0	68.8	2.7
	055DZB	248.1	67.5	3.4	234.0	72.0	3.0	220.3	76.6	2.7
	062DZB	280.7	69.9	3.5	263.7	75.1	3.1	247.2	80.4	2.8
	070DZB	302.3	79.0	3.4	285.4	84.7	3.0	268.0	90.3	2.7
	075DZB	330.6	87.0	3.4	311.5	93.1	3.0	292.4	99.1	2.7
	080DZB	350.4	96.0	3.3	330.8	102.5	3.0	311.0	108.8	2.6
	085DZB	389.6	96.8	3.6	366.1	103.8	3.1	342.1	110.7	2.8
	090DZB	409.1	102.5	3.6	385.4	109.6	3.2	360.6	116.5	2.8
	100DZB	437.0	114.9	3.4	412.0	122.8	3.0	387.1	130.6	2.7
	102DZB	454.5	120.7	3.4	428.3	128.6	3.0	402.4	136.6	2.7
112DZB	503.8	129.2	3.5	475.7	138.4	3.1	446.5	147.5	2.7	
120DZB	546.9	146.5	3.4	516.0	157.0	3.0	486.0	167.4	2.7	
130DZB	576.2	152.8	3.4	544.0	163.8	3.0	512.6	174.6	2.7	
140DZB	606.9	158.3	3.4	573.4	169.9	3.0	539.6	181.2	2.7	
155DZB	669.6	174.8	3.5	633.1	187.3	3.1	596.3	199.6	2.7	
170DZB	728.0	196.0	3.4	687.5	209.5	3.0	646.1	222.4	2.7	
180DZB	799.3	218.8	3.3	756.9	232.9	3.0	714.5	246.4	2.7	
185DZB	827.2	222.8	3.4	783.0	237.4	3.0	739.0	251.3	2.7	
190DZB	846.7	249.0	3.1	803.2	263.3	2.8	760.7	276.7	2.5	
200DZB	877.0	254.2	3.2	831.7	268.9	2.9	787.7	282.8	2.6	

NOTES: (1) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
 (2) Interpolation between ratings is permissible but extrapolation is not
 (3) KW is for compressor only. COP is for entire unit. See Physical Specs for fan kW

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		45°C			49°C (See Note 4)			52°C (See Note 4)		
		kWo	kWi	COP	kWo	kWi	COP	kWo	kWi	COP
10.0	021SZB	71.9	26.2	2.5	68.7	27.0	2.3	65.5	27.9	2.1
	024SZB	81.9	32.1	2.3	78.3	33.3	2.2	74.6	34.5	2.0
	027SZB	90.4	35.1	2.4	86.6	36.2	2.2	—	—	—
	030SZB	105.2	41.5	2.3	101.2	43.0	2.1	97.4	44.5	2.0
	035SZB	118.5	46.6	2.3	113.9	48.1	2.2	109.6	49.6	2.0
	030DZB	105.5	39.1	2.5	100.0	40.2	2.3	94.3	41.2	2.1
	035DZB	122.0	47.1	2.4	116.5	48.5	2.2	111.0	49.9	2.1
	040DZB	138.9	51.5	2.4	132.7	53.2	2.2	126.3	54.9	2.1
	045DZB	155.2	60.4	2.3	148.5	62.4	2.2	—	—	—
	050DZB	170.9	66.9	2.3	163.5	69.2	2.2	—	—	—
	052DZB	177.4	70.9	2.3	170.4	73.2	2.1	—	—	—
	055DZB	191.2	78.9	2.2	184.0	81.5	2.1	—	—	—
	062DZB	211.9	83.4	2.3	203.6	86.3	2.1	195.7	89.2	2.0
	070DZB	229.4	93.1	2.2	220.4	96.1	2.1	211.7	98.9	2.0
	075DZB	250.6	102.0	2.3	239.9	105.2	2.1	—	—	—
	080DZB	267.0	111.5	2.2	254.9	114.7	2.1	—	—	—
	085DZB	288.8	113.9	2.3	274.8	117.5	2.1	260.6	121.0	2.0
	090DZB	305.5	119.7	2.3	291.2	123.2	2.1	276.5	126.7	2.0
	100DZB	332.5	134.4	2.3	317.4	138.7	2.1	—	—	—
	102DZB	348.8	140.3	2.3	333.8	144.6	2.1	—	—	—
112DZB	381.7	152.2	2.3	366.0	157.2	2.1	350.6	162.1	2.0	
120DZB	420.4	172.4	2.2	404.1	178.2	2.1	—	—	—	
130DZB	440.4	179.8	2.3	423.2	185.5	2.1	—	—	—	
140DZB	460.7	186.7	2.2	442.3	192.5	2.1	424.8	198.2	2.0	
155DZB	507.0	205.1	2.3	485.2	211.4	2.1	463.5	217.4	2.0	
170DZB	554.1	227.5	2.3	528.2	234.0	2.1	—	—	—	
180DZB	612.8	250.7	2.2	587.3	257.3	2.1	561.9	263.6	2.0	
185DZB	637.0	255.9	2.3	610.8	262.8	2.1	—	—	—	
190DZB	663.5	279.2	2.2	640.6	285.7	2.1	—	—	—	
200DZB	687.6	285.5	2.2	664.1	292.3	2.1	—	—	—	
12.5	021SZB	77.7	27.1	2.6	74.2	28.1	2.4	70.7	29.0	2.2
	024SZB	88.3	33.4	2.4	84.3	34.7	2.2	80.3	35.9	2.1
	027SZB	97.0	36.4	2.5	93.0	37.7	2.3	—	—	—
	030SZB	113.5	43.2	2.4	109.2	44.8	2.2	105.1	46.4	2.1
	035SZB	128.1	48.4	2.4	123.2	50.0	2.3	118.5	51.6	2.1
	030DZB	114.4	40.5	2.6	108.4	41.7	2.4	102.3	42.8	2.2
	035DZB	132.2	48.9	2.5	126.3	50.5	2.3	120.4	52.0	2.2
	040DZB	150.0	53.4	2.5	143.3	55.2	2.3	136.4	57.0	2.2
	045DZB	166.4	62.8	2.4	159.4	64.9	2.2	—	—	—
	050DZB	183.8	69.6	2.4	175.8	72.0	2.2	—	—	—
	052DZB	188.8	73.7	2.4	181.3	76.2	2.2	—	—	—
	055DZB	204.6	82.2	2.3	—	—	—	—	—	—
	062DZB	228.3	86.6	2.4	219.4	89.8	2.2	210.9	92.9	2.1
	070DZB	247.6	96.8	2.3	237.9	99.9	2.2	—	—	—
	075DZB	269.8	106.0	2.3	258.6	109.4	2.2	—	—	—
	080DZB	286.9	116.0	2.3	274.6	119.5	2.1	—	—	—
	085DZB	312.7	118.6	2.4	297.5	122.5	2.2	282.1	126.3	2.0
	090DZB	330.0	124.5	2.4	314.5	128.4	2.2	298.9	132.2	2.1
	100DZB	357.1	140.1	2.3	341.9	144.8	2.2	—	—	—
	102DZB	371.9	146.0	2.3	356.8	150.7	2.2	—	—	—
112DZB	412.0	158.4	2.4	395.0	163.9	2.2	—	—	—	
120DZB	451.6	179.9	2.3	435.4	186.2	2.2	—	—	—	
130DZB	476.4	187.4	2.3	458.2	193.7	2.2	—	—	—	
140DZB	498.8	194.3	2.3	479.2	200.7	2.2	—	—	—	
155DZB	549.1	213.7	2.4	525.7	220.4	2.2	—	—	—	
170DZB	595.4	237.2	2.3	569.6	244.4	2.2	—	—	—	
180DZB	663.8	261.6	2.3	636.5	268.8	2.2	—	—	—	
185DZB	686.6	267.0	2.4	660.6	274.5	2.2	—	—	—	
190DZB	711.1	291.6	2.3	687.0	298.5	2.1	—	—	—	
200DZB	736.6	298.2	2.3	—	—	—	—	—	—	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
(2) Interpolation between ratings is permissible but extrapolation is not
(3) KW is for compressor only. COP is for entire unit. See Physical Specs for fan kW
(4) High Ambient Applications over 48°C require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		30°C			35°C			40°C		
		kWo	kWi	COP	kWo	kWi	COP	kWo	kWi	COP
15.5	021SZB	103.8	22.4	4.1	98.3	24.3	3.6	92.3	26.1	3.2
	024SZB	117.4	27.9	3.8	111.0	30.1	3.3	104.4	32.3	2.9
	027SZB	127.6	31.0	3.7	120.1	33.2	3.3	112.8	35.4	2.9
	030SZB	151.2	36.0	3.7	142.7	38.8	3.3	134.0	41.7	2.9
	035SZB	169.8	40.6	3.7	160.6	43.8	3.3	151.4	46.9	2.9
	030DZB	157.1	33.9	4.2	147.5	36.7	3.6	137.5	39.4	3.2
	035DZB	177.0	40.8	4.0	167.2	44.1	3.5	157.4	47.4	3.1
	040DZB	201.2	44.2	4.0	189.8	47.9	3.5	178.2	51.5	3.1
	045DZB	220.3	53.2	3.7	207.7	57.1	3.3	195.2	60.9	2.9
	050DZB	243.2	58.7	3.7	229.3	63.0	3.3	215.6	67.4	2.9
	052DZB	248.2	63.2	3.6	233.5	67.5	3.2	219.4	71.8	2.8
	055DZB	267.3	70.2	3.5	252.0	75.2	3.1	237.1	80.1	2.7
	062DZB	305.1	72.2	3.7	287.7	77.9	3.3	269.9	83.6	2.9
	070DZB	326.2	82.1	3.6	308.1	88.2	3.2	290.3	94.2	2.8
	075DZB	357.5	90.5	3.6	337.6	97.0	3.2	317.3	103.4	2.8
	080DZB	378.2	100.1	3.5	357.0	107.0	3.1	335.5	113.7	2.7
	085DZB	422.6	100.2	3.7	398.9	107.9	3.3	374.6	115.5	2.9
	090DZB	442.9	106.3	3.7	417.0	114.0	3.3	391.3	121.5	2.9
	100DZB	472.0	119.5	3.6	444.9	128.0	3.2	417.5	136.6	2.8
	102DZB	490.1	125.6	3.5	461.6	134.1	3.1	433.5	142.7	2.8
112DZB	544.7	134.0	3.6	514.3	143.9	3.2	484.3	153.9	2.9	
120DZB	590.9	152.4	3.5	557.7	163.8	3.1	525.7	175.1	2.8	
130DZB	622.9	159.0	3.6	588.7	170.8	3.2	555.0	182.6	2.8	
140DZB	656.4	164.8	3.6	621.1	177.2	3.2	585.9	189.4	2.8	
155DZB	725.7	182.1	3.6	686.3	195.6	3.2	646.9	208.8	2.8	
170DZB	789.1	204.9	3.5	745.2	219.3	3.1	700.5	233.2	2.8	
180DZB	864.5	228.4	3.5	819.1	243.6	3.1	773.7	258.2	2.8	
185DZB	894.6	232.6	3.5	847.2	248.3	3.1	800.1	263.3	2.8	
190DZB	912.8	260.6	3.2	866.8	276.0	2.9	821.8	290.5	2.6	
200DZB	944.2	266.0	3.3	896.9	282.0	3.0	850.3	297.0	2.7	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
(2) Interpolation between ratings is permissible but extrapolation is **not**
(3) KW is for compressor only. COP is for entire unit. See Physical Specs for fan kW

PERFORMANCE DATA: METRIC S. I. UNITS

60 HZ

LWT °C	ACDR-B MODEL	ENTERING CONDENSER AIR TEMPERATURE								
		45°C			49°C (See Note 4)			52°C (See Note 4)		
		kWo	kWi	COP	kWo	kWi	COP	kWo	kWi	COP
15.5	021SZB	84.9	28.2	2.7	81.1	29.3	2.5	77.3	30.3	2.3
	024SZB	96.1	35.0	2.5	91.7	36.3	2.3	—	—	—
	027SZB	104.4	38.1	2.5	100.3	39.4	2.4	—	—	—
	030SZB	124.1	45.1	2.5	119.3	46.9	2.3	114.9	48.6	2.2
	035SZB	140.2	50.6	2.5	134.8	52.4	2.4	—	—	—
	030DZB	125.1	42.3	2.7	118.5	43.5	2.5	111.7	44.7	2.3
	035DZB	144.8	51.0	2.6	138.4	52.8	2.5	—	—	—
	040DZB	163.8	55.6	2.6	156.6	57.6	2.5	149.1	59.5	2.3
	045DZB	180.2	65.5	2.5	—	—	—	—	—	—
	050DZB	198.9	72.7	2.5	190.4	75.4	2.3	—	—	—
	052DZB	202.9	77.1	2.4	—	—	—	—	—	—
	055DZB	220.3	86.2	2.4	—	—	—	—	—	—
	062DZB	249.3	90.4	2.5	239.6	93.9	2.3	230.2	97.3	2.2
	070DZB	269.7	101.3	2.4	259.8	104.7	2.3	—	—	—
	075DZB	292.8	110.9	2.4	280.8	114.5	2.3	—	—	—
	080DZB	309.4	121.4	2.4	296.1	125.1	2.2	—	—	—
	085DZB	342.4	124.2	2.5	325.7	128.5	2.3	—	—	—
	090DZB	360.3	130.3	2.5	343.9	134.6	2.3	—	—	—
	100DZB	384.9	146.9	2.4	368.5	152.0	2.2	—	—	—
	102DZB	400.6	153.0	2.4	—	—	—	—	—	—
112DZB	449.3	165.9	2.5	432.0	171.9	2.3	—	—	—	
120DZB	488.8	188.8	2.4	—	—	—	—	—	—	
130DZB	516.3	196.6	2.4	497.7	203.4	2.3	—	—	—	
140DZB	545.1	203.7	2.5	525.5	210.6	2.3	—	—	—	
155DZB	599.6	224.1	2.5	576.0	231.5	2.3	—	—	—	
170DZB	645.6	249.1	2.4	—	—	—	—	—	—	
180DZB	719.4	274.7	2.4	692.3	282.5	2.3	—	—	—	
185DZB	743.9	280.3	2.5	716.0	288.4	2.3	—	—	—	
190DZB	768.7	306.7	2.3	—	—	—	—	—	—	
200DZB	796.0	313.8	2.4	—	—	—	—	—	—	

- NOTES: (1) Ratings based on ARI Standard 550/590-98, 5°C water range in evaporator & .018 fouling factor
(2) Interpolation between ratings is permissible but extrapolation is not
(3) KW is for compressor only. COP is for entire unit. See Physical Specs for fan kW
(4) High Ambient Applications over 48°C require High Pressure Limiting Option. HPL (High Pressure Limiting Control) is found in the ACM (Auxiliary Control Module) option on page 12.

PHYSICAL SPECIFICATIONS: ENGLISH I.P. UNITS

ACDR-B 021S, 024S, 027S, 030S, 035S

ACDR-B MODEL	021S	024S	027S	030S	035S
Nominal Tons ⁽¹⁾	21	24	27	30	35
Quantity of Compressors	(1) 4D25	(1) 4D30	(1) 6D30	(1) 6D35	(1) 6D40
STANDARD EVAPORATOR	CHS007601A	CHS007601A	CHS007601A	CHS007601B	CHS008601A
Nominal Tons	21	24	27	30	35
Water Volume, Gallons	5.5	5.5	5.5	5.5	7.0
Minimum Flow Rate, GPM	37	37	37	50	56
Maximum Flow Rate, GPM	104	104	104	168	172
Water Conn. Size In/Out (Type)	3" NPTE	3" NPTE	3" NPTE	3" NPTE	3" NPTE
EVAPORATOR FOR 42° LWT (CH2 OPT)⁽²⁾	NR	NR	NR	NR	NR
Water Volume, Gallons	—	—	—	—	—
Minimum Flow Rate, GPM	—	—	—	—	—
Maximum Flow Rate, GPM	—	—	—	—	—
Water Conn. Size In/Out (Type)	—	—	—	—	—
EVAPORATOR FOR 40° LWT (CH3 OPT)⁽³⁾	NR	NR	CHS008602A	CHS010601A	CHS010601A
Water Volume, Gallons	—	—	7.0	9.4	9.4
Minimum Flow Rate, GPM	—	—	42	62	62
Maximum Flow Rate, GPM	—	—	114	205	205
Water Conn. Size In/Out (Type)	—	—	4" NPTE	4" NPTE	4" NPTE
CONDENSER	L216	L312	L312	L216	L312
Fan Quantity - All 30" Diameter	2	2	2	3	3
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(1) 2	(1) 2	(1) 2	(1) 3	(1) 3
HP ⁽⁴⁾	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5
GENERAL					
Minimum Starting/Operating Ambient °F ⁽⁵⁾	30	30	30	30	30
with HGBP, °F ⁽⁵⁾	40	40	40	40	40
Low Ambient Option, °F ⁽⁶⁾	0	0	0	0	0
Extra Low Ambient Option, °F ⁽⁷⁾	-20	-20	-20	-20	-20
Number of Circuits	1	1	1	1	1
Refrigerant Charge, lbs. R-22	50	58	65	72	84
Shipping Weight, lbs. Alum. Fin/Cu. Fin	1712/1942	1852/2201	1929/2278	2259/2604	2328/2672
Operating Weight, lbs. Alum. Fin/Cu. Fin	1762/1992	1903/2252	1994/2342	2345/2690	2413/2758

- NOTES: (1) Based on GPM per Performance Data. 95°F Ambient, 44°F LWT. (10°F range) **NR - Not Required**
 (2) CH2 - Oversized cooler required where indicated for 42°F LWT. **NPTE - National Pipe Thread External**
 (3) CH3 - Oversized cooler required where indicated for 40°F LWT.
 (4) Units with Low Ambient Option use (1) 1 HP in lieu of (1) 1 1/2 HP fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 5 MPH wind across coil & minimum load per Table 6.
 (6) Low Ambient Option requires (1) 1 HP variable speed fan motor
 (7) Extra Low Ambient Option requires electronic expansion valve(s), variable speed fan, 50% glycol, 50% minimum load and maximum 5 MPH wind across coil

PHYSICAL SPECIFICATIONS: ENGLISH I.P. UNITS

ACDR-B 030D, 035D, 040D, 045D, 050D

ACDR-B MODEL	030D	035D	040D	045D	050D
Nominal Tons ⁽¹⁾	30	35	40	45	50
Quantity of Compressors	(2) 4D20	(2) 4D22	(2) 4D25	(1) 4D25 (1) 6D30	(1) 4D30 (1) 6D30
STANDARD EVAPORATOR	CHD008601A	CHD008601A	CHD010601A	CHD010601B	CHD011601B
Nominal Tons	30	35	40	45	50
Water Volume, Gallons	7.7	7.7	10.7	10.7	12.9
Minimum Flow Rate, GPM	56	56	62	78	86
Maximum Flow Rate, GPM	168	168	205	315	315
Water Conn. Size In/Out (Type)	4" NPTE	4" NPTE	4" NPTE	4" NPTE	4" NPTE
EVAPORATOR FOR 42° LWT (CH2 OPT)⁽²⁾	NR	CHD010601A	NR	NR	NR
Water Volume, Gallons	—	10.7	—	—	—
Minimum Flow Rate, GPM	—	62	—	—	—
Maximum Flow Rate, GPM	—	205	—	—	—
Water Conn. Size In/Out (Type)	—	4" NPTE	—	—	—
EVAPORATOR FOR 42° LWT (CH3 OPT)⁽³⁾	CHD010602A	CHD011601A	CHD011601A	CHD013601A	CHD013601A
Water Volume, Gallons	10.7	12.9	12.9	18.1	18.1
Minimum Flow Rate, GPM	47	69	69	80	80
Maximum Flow Rate, GPM	116	206	206	220	220
Water Conn. Size In/Out (Type)	4" NPTE	4" NPTE	4" NPTE	4" NPTE	4" NPTE
CONDENSER	L216	L216	L216	L216	L216
Fan Quantity - All 30" Diameter	4	4	4	4	4
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(2) 4	(2) 4	(2) 4	(2) 4	(2) 4
HP ⁽⁴⁾	1.0	1.0	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5
GENERAL					
Minimum Starting/Operating Ambient °F ⁽⁵⁾	30	30	30	30	30
with HGBP, °F ⁽⁵⁾	40	40	40	40	40
Low Ambient Option, °F ⁽⁶⁾	0	0	0	0	0
Extra Low Ambient Option, °F ⁽⁷⁾	-20	-20	-20	-20	-20
Number of Circuits	2	2	2	2	2
Refrigerant Charge, lbs. R-22	72	84	96	108	120
Shipping Weight, lbs. Alum. Fin/Cu. Fin	3567/4019	3677/4129	3691/4143	3914/4366	4010/4462
Operating Weight, lbs. Alum. Fin/Cu. Fin	3665/4117	3796/4248	3809/4261	4080/4532	4176/4628

- NOTES: (1) Based on GPM per Performance Data. 95°F Ambient, 44°F LWT. (10°F range) NR - Not Required
 (2) CH2 - Oversized cooler required where indicated for 42°F LWT. NPTE - National Pipe Thread External
 (3) CH3 - Oversized cooler required where indicated for 40°F LWT.
 (4) Units with Low Ambient Option use (1) 1 HP in lieu of (1) 1 1/2 HP fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 5 MPH wind across coil & minimum load per Table 6.
 (6) Low Ambient Option requires (2) 1 HP variable speed fan motor
 (7) Extra Low Ambient Option requires electronic expansion valve(s), variable speed fan, 50% glycol, 50% minimum load and maximum 5 MPH wind across coil

PHYSICAL SPECIFICATIONS: ENGLISH I.P. UNITS

ACDR-B 052D, 055D, 062D, 070D, 075D

ACDR-B MODEL	052D	055D	062D	070D	075D
Nominal Tons ⁽¹⁾	52	55	62	70	75
Quantity of Compressors	(2) 6D30	(1) 6D35 (1) 6D30	(2) 6D35	(2) 6D40	(1) 6D40 (1) 8D50
STANDARD EVAPORATOR	CHD011601B	CHD011601B	CHD012601B	CHD012601B	CHD013601B
Nominal Tons	52	55	62	70	75
Water Volume, Gallons	12.9	12.9	15.4	15.4	18.1
Minimum Flow Rate, GPM	86	86	94	94	101
Maximum Flow Rate, GPM	315	315	377	377	420
Water Conn Size In/Out (Type)	4" NPTE	4" NPTE	4" NPTE	4" NPTE	4" NPTE
EVAPORATOR FOR 42°LWT (CH2 OPT)⁽²⁾	NR	NR	NR	NR	NR
Water Volume, Gallons	—	—	—	—	—
Minimum Flow Rate, GPM	—	—	—	—	—
Maximum Flow Rate, GPM	—	—	—	—	—
Water Conn Size In/Out (Type)	—	—	—	—	—
EVAPORATOR FOR 40°LWT (CH3 OPT)⁽³⁾	CHD013601A	CHD013601A	EXD16092J11	EXD16092J11	EXD16092J11
Water Volume, Gallons	18.1	18.1	36.2	36.2	36.2
Minimum Flow Rate, GPM	80	80	116	116	116
Maximum Flow Rate, GPM	220	220	366	366	366
Water Conn Size In/Out (Type)	4" NPTE	4" NPTE	6" VIC	6" VIC	6" VIC
CONDENSER	L216	L312	L216	L216	L312
Fan Quantity - All 30" Diameter	4	4	6	6	6
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(2) 4	(2) 4	(2) 4	(2) 4	(2) 6
HP ⁽⁴⁾	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5
GENERAL					
Minimum Starting/Operating Ambient °F ⁽⁵⁾	30	30	30	30	30
with HGBP, °F ⁽⁵⁾	40	40	40	40	40
Low Ambient Option, °F ⁽⁶⁾	0	0	0	0	0
Extra Low Ambient Option, °F ⁽⁷⁾	-20	-20	-20	-20	-20
Number of Circuits	2	2	2	2	2
Refrigerant Charge, lbs. R-22	125	132	149	168	180
Shipping Weight, lbs. Alum. Fin./Cu. Fin	4092/4544	4100/4552	5733/6410	5864/6541	6510/7544
Operating Weight, lbs. Alum. Fin./Cu. Fin	4258/4710	4266/4718	6065/6742	6196/6873	6842/7876

- NOTES: (1) Based on GPM per Performance Data. 95°F Ambient, 44°F LWT. (10°F range) NR - Not Required
 (2) CH2 - Oversized cooler required where indicated for 42°F LWT. NPTE - National Pipe Thread External
 (3) CH3 - Oversized cooler required where indicated for 40°F LWT. VIC - Victaulic
 (4) Units with Low Ambient Option use (2) 1 HP, balance 1 1/2 HP fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 5 MPH wind across coil & minimum load per Table 6.
 (6) Low Ambient Option requires (1) 1 HP variable speed fan motor
 (7) Extra Low Ambient Option requires electronic expansion valve(s), variable speed fan, 50% glycol, 50% minimum load and maximum 5 MPH wind across coil

PHYSICAL SPECIFICATIONS: ENGLISH I.P. UNITS

ACDR-B 080D, 085D, 090D, 100D, 102D

ACDR-B MODEL	080D	085D	090D	100D	102D
Nominal Tons ⁽¹⁾	80	85	90	100	102
Quantity of Compressors	(2) 8D50	(2) 4D30 (2) 4D25	(2) 6D30 (2) 4D25	(2) 6D30 (2) 4D30	(4) 6D30
STANDARD EVAPORATOR	CHD013601B	EXD12102J07	EXD12102J07	EXD12122J09	EXD12122J09
Nominal Tons	80	85	90	100	102
Water Volume, Gallons	18.1	26	26	31.1	31.1
Minimum Flow Rate, GPM	101	158	158	153	153
Maximum Flow Rate, GPM	420	444	444	442	442
Water Conn Size In/Out (Type)	4" NPTE	4" VIC	4" VIC	4" VIC	4" VIC
EVAPORATOR FOR 42°LWT (CH2 OPT)⁽²⁾	NR	NR	EXD12122J09	NR	NR
Water Volume, Gallons	—	—	31.1	—	—
Minimum Flow Rate, GPM	—	—	153	—	—
Maximum Flow Rate, GPM	—	—	442	—	—
Water Conn Size In/Out (Type)	—	—	4" VIC	—	—
EVAPORATOR FOR 40°LWT (CH3 OPT)⁽³⁾	EXD16092J11	EXD14122J11	EXD16122J11	EXD16122J11	EXD16122J11
Water Volume, Gallons	36.2	36.2	48.2	48.2	48.2
Minimum Flow Rate, GPM	116	140	159	159	159
Maximum Flow Rate, GPM	366	391	443	443	443
Water Conn Size In/Out (Type)	6" VIC	5" VIC	6" VIC	6" VIC	6" VIC
CONDENSER	L312	L216	L216	L216	L216
Fan Quantity - All 30" Diameter	6	8	8	8	8
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(4) 6	(6) 8	(6) 8	(6) 8	(6) 8
HP ⁽⁴⁾	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5
GENERAL					
Minimum Starting/Operating Ambient, °F ⁽⁵⁾	30	30	30	30	30
with HGBP, °F ⁽⁵⁾	40	40	40	40	40
Low Ambient Option, °F ⁽⁶⁾	0	0	0	0	0
Extra Low Ambient Option, °F ⁽⁷⁾	-20	-20	-20	-20	-20
Number of Circuits	2	2	2	2	2
Refrigerant Charge, lbs. R-22	192	204	216	240	245
Shipping Weight, lbs. Alum. Fin/Cu. Fin	6772/7810	7577/8480	8168/11003	8205/11041	9129/11965
Operating Weight, lbs. Alum. Fin/Cu. Fin	7108/8142	7909/8812	8610/11446	8647/11483	9694/12530

- NOTES: (1) Based on GPM per Performance Data. 95°F Ambient, 44°F LWT. (10°F range) NR - Not Required
(2) CH2 - Oversized cooler required where indicated for 42°F LWT. NPTE - National Pipe Thread External
(3) CH3 - Oversized cooler required where indicated for 40°F LWT. VIC - Victaulic
(4) Units with Low Ambient Option use (1) 1 HP in lieu of (1) 1 1/2 HP fan motor per circuit
(5) Minimum Starting/Operation Ambient with a maximum of 5 MPH wind across coil & minimum load per Table 6.
(6) Low Ambient Option requires (1) 1 HP variable speed fan motor
(7) Extra Low Ambient Option requires electronic expansion valve(s), variable speed fan, 50% glycol, 50% minimum load and maximum 5 MPH wind across coil

PHYSICAL SPECIFICATIONS: ENGLISH I.P. UNITS

ACDR-B 112D, 120D, 130D, 140D, 155D

ACDR-B MODEL	112D	120D	130D	140D	155D
Nominal Tons ⁽¹⁾	112	120	130	140	155
Quantity of Compressors	(2) 6D35 (2) 6D30	(4) 6D35	(2) 6D40 (2) 6D35	(4) 6D40	(2) 6D40 (2) 8D50
STANDARD EVAPORATOR	EXD12122J09	EXD14122J09	EXD14122J09	EXD14122J09	EXD16122J07
Nominal Tons	112	120	130	140	155
Water Volume, Gallons	31.1	36.2	36.2	36.2	48.2
Minimum Flow Rate, GPM	153	169	169	169	236
Maximum Flow Rate, GPM	442	484	484	484	697
Water Conn. Size In/Out (Type)	4" VIC	5" VIC	5" VIC	5" VIC	6" VIC
EVAPORATOR FOR 42°LWT (CH2 OPT)⁽²⁾	EXD14102J09	NR	NR	NR	NR
Water Volume, Gallons	30.3	—	—	—	—
Minimum Flow Rate, GPM	177	—	—	—	—
Maximum Flow Rate, GPM	440	—	—	—	—
Water Conn. Size In/Out (Type)	5" VIC	—	—	—	—
EVAPORATOR FOR 40°LWT (CH3 OPT)⁽³⁾	EXD18122J11	EXD18122J09	EXD18122J09	EXD18122J09	EXD20122J09
Water Volume, Gallons	61.6	61.6	61.6	61.6	73.8
Minimum Flow Rate, GPM	177	213	213	213	237
Maximum Flow Rate, GPM	604	740	740	740	800
Water Conn. Size In/Out (Type)	8" VIC	8" VIC	8" VIC	8" VIC	10" VIC
CONDENSER	L216	L216	L312	L216	L312
Fan Quantity - All 30" Diameter	10	10	10	12	12
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(8) 10	(8) 10	(8) 10	(10) 12	(10) 12
HP ⁽⁴⁾	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5
GENERAL					
Minimum Starting/Operating Ambient, °F ⁽⁵⁾	30	30	30	30	30
with HGBP, °F ⁽⁵⁾	40	40	40	40	40
Low Ambient Option, °F ⁽⁶⁾	0	0	0	0	0
Extra Low Ambient Option, °F ⁽⁷⁾	-20	-20	-20	-20	-20
Number of Circuits	2	2	2	2	2
Refrigerant Charge, lbs. R-22	269	288	312	336	372
Shipping Weight, lbs. Alum. Fin/Cu. Fin	9666/13210	9687/13231	10457/12179	11220/12574	13032/15100
Operating Weight, lbs. Alum Fin/Cu. Fin	10231/13775	10252/13796	11022/12745	11897/13251	13708/15776

- NOTES: (1) Based on GPM per Performance Data. 95°F Ambient, 44°F LWT. (10°F range) NR - Not Required
 (2) CH2 - Oversized cooler required where indicated for 42°F LWT. VIC - Victaulic
 (3) CH3 - Oversized cooler required where indicated for 40°F LWT.
 (4) Units with Low Ambient Option use (1) 1 HP in lieu of (1) 1 1/2 HP fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 5 MPH wind across coil & minimum load per Table 6.
 (6) Low Ambient Option requires (1) 1 HP variable speed fan motor
 (7) Extra Low Ambient Option requires electronic expansion valve(s), variable speed fan, 50% glycol, 50% minimum load and maximum 5 MPH wind across coil

PHYSICAL SPECIFICATIONS: ENGLISH I.P. UNITS

ACDR-B 170D, 180D, 185D, 190D, 200D

ACDR-B MODEL	170D	180D	185D	190D	200D
Nominal Tons ⁽¹⁾	170	180	185	190	200
Quantity of Compressors	(4) 8D50	(2) 8D50 (2) 8D60	(2) 8D50 (2) 8D60	(4) 8D60	(4) 8D60
STANDARD EVAPORATOR	EXD18122J07	EXD18122J07	EXD20122J07	EXD18122J07	EXD20122J07
Nominal Tons	170	180	185	190	200
Water Volume, Gallons	61.6	61.6	73.8	61.6	73.8
Minimum Flow Rate, GPM	267	267	298	267	298
Maximum Flow Rate, GPM	1060	1060	816	1060	816
Water Conn. Size In/Out (Type)	8" VIC	8" VIC	10" VIC	8" VIC	10" VIC
EVAPORATOR FOR 42°LWT (CH2 OPT)⁽²⁾	NR	NR	NR	NR	NR
Water Volume, Gallons	—	—	—	—	—
Minimum Flow Rate, GPM	—	—	—	—	—
Maximum Flow Rate, GPM	—	—	—	—	—
Water Conn. Size In/Out (Type)	—	—	—	—	—
EVAPORATOR FOR 40° LWT (CH3 OPT)⁽³⁾	EXD20122J09	EXD20122J07	NR	EXD20122J07	NR
Water Volume, Gallons	73.8	73.8	—	73.8	—
Minimum Flow Rate, GPM	237	298	—	298	—
Maximum Flow Rate, GPM	800	816	—	816	—
Water Conn. Size In/Out (Type)	10" VIC	10" VIC	—	10" VIC	—
CONDENSER	L312	L312	L312	L312	L312
Fan Quantity - All 30" Diameter	12	14	14	14	14
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(10) 12	(12) 14	(12) 14	(12) 14	(12) 14
HP ⁽⁴⁾	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5	(1.0) 1.5
GENERAL					
Minimum Starting/Operating Ambient, °F ⁽⁵⁾	30	30	30	30	30
with HGBP, °F ⁽⁵⁾	40	40	40	40	40
Low Ambient Option, °F ⁽⁶⁾	0	0	0	0	0
Extra Low Ambient Option, °F ⁽⁷⁾	-20	-20	-20	-20	-20
Number of Circuits	2	2	2	2	2
Refrigerant Charge, lbs. R-22	408	432	444	456	480
Shipping Weight, lbs. Alum. Fin/Cu. Fin	13071/15139	13770/16182	13783/16195	13796/16209	13823/16235
Operating Weight, lbs. Alum. Fin/Cu. Fin	13748/15816	14446/16859	14460/16872	14473/16885	14499/16911

- NOTES: (1) Based on GPM per Performance Data. 95°F Ambient, 44°F LWT. (10°F range) NR - Not Required
 (2) CH2 - Oversized cooler required where indicated for 42°F LWT. VIC - Victaulic
 (3) CH3 - Oversized cooler required where indicated for 40°F LWT.
 (4) Units with Low Ambient Option use (1) 1 HP, in lieu of (1) 1 1/2 HP fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 5 MPH wind across coil & minimum load per Table 6.
 (6) Low Ambient Option requires (1) 1 HP variable speed fan motor
 (7) Extra Low Ambient Option requires electronic expansion valve(s), variable speed fan, 50% glycol, 50% minimum load and maximum 5 MPH wind across coil

PHYSICAL SPECIFICATIONS: METRIC S.I. UNITS

ACDR-B 021S, 024S, 027S, 030S, 035S

ACDR-B MODEL	021S	024S	027S	030S	035S
Nominal kW ⁽¹⁾	74	84	95	105	123
Quantity of Compressors	(1) 4D25	(1) 4D30	(1) 6D30	(1) 6D35	(1) 6D40
STANDARD EVAPORATOR	CHS07601A	CHS007601A	CHS007601A	CHS007601B	CHS008601A
Nominal kW _o	74	84	95	105	123
Water Volume, Liters	21	21	21	21	26.6
Minimum Flow Rate, Liters/sec	2.34	2.34	2.34	3.16	3.54
Maximum Flow Rate, Liters/sec	6.39	6.39	6.39	10.38	10.63
Water Conn. Size In/Out (mm) (Type)	76.2 *NPTE	76.2 *NPTE	76.2 *NPTE	76.2 *NPTE	76.2 *NPTE
EVAPORATOR FOR 5.5°C LWT (CH2 OPT)⁽²⁾	NR	NR	NR	NR	NR
Water Volume, Liters	—	—	—	—	—
Minimum Flow Rate, Liters/sec.	—	—	—	—	—
Maximum Flow Rate, Liters/sec.	—	—	—	—	—
Water Conn. Size In/Out (mm) (Type)	—	—	—	—	—
EVAPORATOR FOR 4.5°C LWT (CH3 OPT)⁽³⁾	NR	NR	CHS008602A	CHS010601A	CHS010601A
Water Volume, Liters	—	—	26.6	35.7	35.7
Minimum Flow Rate, Liters/sec.	—	—	2.66	3.92	3.92
Maximum Flow Rate, Liters/sec.	—	—	7.21	12.97	12.97
Water Conn. Size In/Out (mm) (Type)	—	—	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE
CONDENSER	L216	L312	L312	L216	L312
Fan Quantity - All 760 mm Diameter	2	2	2	3	3
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(1) 2	(1) 2	(1) 2	(1) 3	(1) 3
kW ⁽⁴⁾	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15
GENERAL					
Minimum Starting/Operating Ambient °C ⁽⁵⁾	-1.1	-1.1	-1.1	-1.1	-1.1
with HGBP °C ⁽⁵⁾	4.4	4.4	4.4	4.4	4.4
Low Ambient Option °C ⁽⁶⁾	-18	-18	-18	-18	-18
Extra Low Ambient Option °C ⁽⁷⁾	-29	-29	-29	-29	-29
Number of Circuits	1	1	1	1	1
Refrigerant Charge, kgs R-22	22	27	30	33	38
Shipping Weight, kgs Alum. Fin/Cu. Fin	777/881	840/998	875/1033	1025/1181	1056/1212
Operating Weight, kgs Alum. Fin/Cu. Fin	799/904	863/1022	904/1063	1064/1220	1095/1251

- NOTES: (1) Based on Liters/sec. per Performance Data. 35 C Ambient, 6.7°C LWT NR - Not Required
- (2) CH2 - Oversized cooler required where indicated for 5.5°C LWT *NPTE - National Pipe Thread External
- (3) CH3 - Oversized cooler required where indicated for 4.5°C LWT
- (4) Units with Low Ambient Option use (1) .76 kW in lieu of (1) 1.15 kW fan motor per circuit
- (5) Minimum Starting/Operation Ambient with a maximum of 8 km/hr wind across coil and minimum load per Table 6.
- (6) Low Ambient Option requires (1) .76 kW variable speed fan motor per circuit
- (7) Extra Low Ambient Option requires electronic expansion valve, variable speed fan, 50% Glycol, 50% minimum load and maximum 8km/hr wind across coil.

PHYSICAL SPECIFICATIONS: METRIC S.I. UNITS

ACDR-B 030D, 035D, 040D, 045D, 050D

ACDR-B MODEL	030D	035D	040D	045D	050D
Nominal kW ⁽¹⁾	105	123	141	158	176
Quantity of Compressors	(2) 4D20	(2) 4D22	(2) 4D25	(1) 4D25 (1) 6D30	(1) 4D30 (1) 6D30
STANDARD EVAPORATOR	CHD008601A	CHD008601A	CHD010601A	CHD010601B	CHD011601B
Nominal kW _o	105	123	141	158	176
Water Volume, Liters	29.2	29.2	40.5	40.5	49
Minimum Flow Rate, Liters/sec	3.54	3.54	3.92	4.93	5.44
Maximum Flow Rate, Liters/sec	10.63	10.63	12.97	19.23	19.23
Water Conn. Size In/Out (mm) (Type)	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE
EVAPORATOR FOR 5.5°C LWT (CH2 OPT)⁽²⁾	NR	CHD010601A	NR	NR	NR
Water Volume, Liters	—	40.5	—	—	—
Minimum Flow Rate, Liters/sec.	—	3.92	—	—	—
Maximum Flow Rate, Liters/sec.	—	12.97	—	—	—
Water Conn. Size In/Out (mm) (Type)	—	101.6 *NPTE	—	—	—
EVAPORATOR FOR 4.5°C LWT (CH3 OPT)⁽³⁾	CHD010602A	CHD011601A	CHD011601A	CHD013601A	CHD013601A
Water Volume, Liters	40.5	49	49	68.5	68.5
Minimum Flow Rate, Liters/sec.	2.97	4.36	4.36	5.06	5.06
Maximum Flow Rate, Liters/sec.	7.34	13.03	13.03	13.91	13.91
Water Conn. Size In/Out (mm) (Type)	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE
CONDENSER	L216	L216	L216	L216	L216
Fan Quantity - All 760 mm Diameter	4	4	4	4	4
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(2) 4	(2) 4	(2) 4	(2) 4	(2) 4
KW ⁽⁴⁾	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15
GENERAL					
Minimum Starting/Operating Ambient °C ⁽⁵⁾	-1.1	-1.1	-1.1	-1.1	-1.1
with HGBP °C ⁽⁵⁾	4.4	4.4	4.4	4.4	4.4
Low Ambient Option °C ⁽⁶⁾	-18	-18	-18	-18	-18
Extra Low Ambient Option °C ⁽⁷⁾	-29	-29	-29	-29	-29
Number of Circuits	2	2	2	2	2
Refrigerant Charge, kgs R-22	33	38	44	49	55
Shipping Weight, kgs Alum. Fin/Cu. Fin	1618/1823	1668/1873	1674/1879	1775/1980	1819/2024
Operating Weight, kgs Alum. Fin/Cu. Fin	1662/1867	1722/1927	1728/1933	1851/2056	1894/2099

- NOTES: (1) Based on Liters/sec. per Performance Data. 35°C Ambient, 6.7°C LWT NR - Not Required
 (2) CH2 - Oversized cooler required where indicated for 5.5°C LWT *NPTE - National Pipe Thread External
 (3) CH3 - Oversized cooler required where indicated for 4.5°C LWT
 (4) Units with Low Ambient Option use (1) .76 kW in lieu of (1) 1.15 kW fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 8 km/hr wind across coil and minimum load per Table 6.
 (6) Low Ambient Option requires (1) .76 kW variable speed fan motor per circuit
 (7) Extra Low Ambient Option requires electronic expansion valve, variable speed fan, 50% Glycol, 50% minimum load and maximum 8km/hr wind across coil.

PHYSICAL SPECIFICATIONS: METRIC S.I. UNITS

ACDR-B 052D, 055D, 062D, 070D, 075D

ACDR-B MODEL	052D	055D	062D	070D	075D
Nominal kW ⁽¹⁾	183	193	218	246	264
Quantity of Compressors	(2) 6D30	(1) 6D35 (1) 6D30	(2) 6D35	(2) 6D40	(1) 6D40 (10 8D50)
STANDARD EVAPORATOR	CHD011601B	CHD011601B	CHD012601B	CHD012601B	CHD013601B
Nominal kW _o	183	193	218	246	264
Water Volume, Liters	49	49	58.3	58.3	68.5
Minimum Flow Rate, Liters/Sec	5.44	5.44	5.95	5.95	6.39
Maximum Flow Rate, Liters/Sec	19.23	19.23	23.22	23.22	25.75
Water Conn. Size In/Out (mm) (Type)	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE	101.6 *NPTE
EVAPORATOR FOR 5.5°C LWT (CH2 OPT⁽²⁾)	NR	NR	NR	NR	NR
Water Volume, Liters	—	—	—	—	—
Minimum Flow Rate, Liters/sec.	—	—	—	—	—
Maximum Flow Rate, Liters/sec.	—	—	—	—	—
Water Conn. Size In/Out (mm) (Type)	—	—	—	—	—
EVAPORATOR FOR 4.5°C LWT (CH3 OPT⁽³⁾)	CHD013601A	CHD013601A	EXD16092J11	EXD16092J11	EXD16092J11
Water Volume, Liters	68.5	68.5	137	137	137
Minimum Flow Rate, Liters/sec.	5.06	5.06	7.34	7.34	7.34
Maximum Flow Rate, Liters/sec.	13.92	13.92	23.16	23.16	23.16
Water Conn. Size In/Out (mm) (Type)	101.6 *NPTE	101.6 *NPTE	152.4 VIC	152.4 VIC	152.4 VIC
CONDENSER	L216	L312	L216	L216	L312
Fan Quantity - All 760 mm Diameter	4	4	6	6	6
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(2) 4	(2) 4	(2) 6	(2) 6	(2) 6
KW ⁽⁴⁾	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15
GENERAL					
Minimum Starting/Operating Ambient °C ⁽⁵⁾	-1.1	-1.1	-1.1	-1.1	-1.1
with HGBP °C ⁽⁵⁾	4.4	4.4	4.4	4.4	4.4
Low Ambient Option °C ⁽⁶⁾	-18	-18	-18	-18	-18
Extra Low Ambient Option °C ⁽⁷⁾	-29	-29	-29	-29	-29
Number of Circuits	2	2	2	2	2
Refrigerant Charge, kgs R-22	57	60	68	76	82
Shipping Weight, kgs Alum. Fin/Cu. Fin	1856/2061	1860/2065	2600/2908	2660/2967	2953/3422
Operating Weight, kgs Alum. Fin/Cu. Fin	1931/2136	1935/2140	2751/3058	2811/3118	3104/3573

- NOTES: (1) Based on Liters/sec. per Performance Data. 35°C Ambient, 6.7°C LWT NR - Not Required
 (2) CH2 - Oversized cooler required where indicated for 5.5°C LWT *NPTE - National Pipe Thread External
 (3) CH3 - Oversized cooler required where indicated for 4.5°C LWT VIC - Victaulic
 (4) Units with Low Ambient Option use (1) .76 kW in lieu of (1) 1.15 kW fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 8 km/hr wind across coil and minimum load per Table 6.
 (6) Low Ambient Option requires (1) .76 kW variable speed fan motor per circuit
 (7) Extra Low Ambient Option requires electronic expansion valve, variable speed fan, 50% Glycol, 50% minimum load and maximum 8km/hr wind across coil.

PHYSICAL SPECIFICATIONS: METRIC S.I. UNITS

ACDR-B 080D, 085D, 090D, 100D, 102D

ACDR-B MODEL	080D	085D	090D	100D	102D
Nominal kW ⁽¹⁾	281	299	316	352	359
Quantity of Compressors	(2) 8D50	(2) 4D30 (2) 4D25	(2) 6D30 (2) 4D25	(2) 6D30 (2) 4D30	(4) 6D30
STANDARD EVAPORATOR	CHD013601B	EXD12102J07	EXD12102J07	EXD12122J09	EXD12122J09
Nominal kWo	281	299	316	352	359
Water Volume, Liters	68.5	98.2	98.2	117.5	117.5
Minimum Flow Rate, Liters/Sec	6.39	10.0	10.0	9.68	9.68
Maximum Flow Rate, Liters/Sec	25.75	28.1	28.1	27.96	27.96
Water Conn. Size In/Out (mm) (Type)	101.6 *NPTE	101.6 VIC	101.6 VIC	101.6 VIC	101.6 VIC
EVAPORATOR FOR 5.5°C LWT (CH2 OPT)⁽²⁾	NR	NR	EXD12122J09	NR	NR
Water Volume, Liters	—	—	117.5	—	—
Minimum Flow Rate, Liters/sec.	—	—	9.68	—	—
Maximum Flow Rate, Liters/sec.	—	—	27.96	—	—
Water Conn. Size In/Out (mm) (Type)	—	—	101.6 VIC	—	—
EVAPORATOR FOR 4.5°C LWT (CH3 OPT)⁽³⁾	EXD16092J11	EXD14122J11	EXD16122J11	EXD16122J11	EXD16122J11
Water Volume, Liters	137	137	182.3	182.3	182.3
Minimum Flow Rate, Liters/sec.	7.34	8.86	10.06	10.06	10.06
Maximum Flow Rate, Liters/sec.	23.16	24.74	28.03	28.03	28.03
Water Conn. Size In/Out (mm) (Type)	152.4 VIC	152.4 VIC	152.4 VIC	152.4 VIC	152.4 VIC
CONDENSER	L312	L216	L216	L216	L216
Fan Quantity - All 760 mm Diameter	6	8	8	8	8
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(2) 6	(2) 8	(2) 8	(2) 8	(2) 8
KW ⁽⁴⁾	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15
GENERAL					
Minimum Starting/Operating Ambient °C ⁽⁵⁾	-1.1	-1.1	-1.1	-1.1	-1.1
with HGBP °C ⁽⁵⁾	4.4	4.4	4.4	4.4	4.4
Low Ambient Option °C ⁽⁶⁾	-18	-18	-18	-18	-18
Extra Low Ambient Option °C ⁽⁷⁾	-29	-29	-29	-29	-29
Number of Circuits	2	2	2	2	2
Refrigerant Charge, kgs R-22	87	93	98	109	112
Shipping Weight, kgs Alum. Fin/Cu. Fin	3074/3543	3437/3847	3705/4991	3722/5008	4141/5427
Operating Weight, kgs Alum. Fin/Cu. Fin	3224/3693	3588/3997	3905/5192	3922/5209	4397/5684

- NOTES: (1) Based on Liters/sec. per Performance Data. 35°C Ambient, 6.7°C LWT NR - Not Required
- (2) CH2 - Oversized cooler required where indicated for 5.5°C LWT *NPTE - National Pipe Thread External
- (3) CH3 - Oversized cooler required where indicated for 4.5°C LWT VIC - Victaulic
- (4) Units with Low Ambient Option use (1) .76 kW in lieu of (1) 1.15 kW fan motor per circuit
- (5) Minimum Starting/Operation Ambient with a maximum of 8 km/hr wind across coil and minimum load per Table 6.
- (6) Low Ambient Option requires (1) .76 kW variable speed fan motor per circuit
- (7) Extra Low Ambient Option requires electronic expansion valve, variable speed fan, 50% Glycol, 50% minimum load and maximum 8km/hr wind across coil.

PHYSICAL SPECIFICATIONS: METRIC S.I. UNITS

ACDR-B 112D, 120D, 130D, 140D, 155D

ACDR-B MODEL	112D	120D	130D	140D	155D
Nominal kW ⁽¹⁾	394	422	457	492	545
Quantity of Compressors	(2) 6D35 (2) 6D30	(4) 6D35	(2) 6D40 (2) 6D35	(4) 6D40	(2) 6D40 (2) 6D50
STANDARD EVAPORATOR	EXD12122J09	EXD14122J09	EXD14122J09	EXD14122J09	EXD16122J07
Nominal kW _o	394	422	457	492	545
Water Volume, Liters	117.5	137	137	137	182.3
Minimum Flow Rate, Liters/Sec	9.68	10.69	10.69	10.69	14.93
Maximum Flow Rate, Liters/Sec	27.96	30.62	30.62	30.62	44.10
Water Conn. Size In/Out (mm) (Type)	101.6 VIC	127 VIC	127 VIC	127 VIC	152.4 VIC
EVAPORATOR FOR 5.5°C LWT (CH2 OPT)⁽²⁾	EXD14102J09	NR	NR	NR	NR
Water Volume, Liters	114.7	—	—	—	—
Minimum Flow Rate, Liters/sec.	8.86	—	—	—	—
Maximum Flow Rate, Liters/sec.	27.84	—	—	—	—
Water Conn. Size In/Out (mm) (Type)	127 VIC	—	—	—	—
EVAPORATOR FOR 4.5°C LWT (CH3 OPT)⁽³⁾	EXD18122J11	EXD18122J09	EXD18122J09	EXD18122J09	EXD20122J09
Water Volume, Liters	233.3	233.3	233.3	233.3	269.5
Minimum Flow Rate, Liters/sec.	11.20	13.48	13.48	13.48	15.00
Maximum Flow Rate, Liters/sec.	38.22	46.82	46.82	46.82	50.62
Water Conn. Size In/Out (mm) (Type)	203.2 VIC	203.2 VIC	203.2 VIC	203.2 VIC	254 VIC
CONDENSER	L216	L216	L312	L216	L312
Fan Quantity - All 760 mm Diameter	10	10	10	12	12
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(2) 6	(2) 10	(2) 10	(2) 10	(2) 10
KW ⁽⁴⁾	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15
GENERAL					
Minimum Starting/Operating Ambient °C ⁽⁵⁾	-1.1	-1.1	-1.1	-1.1	-1.1
with HGBP °C ⁽⁵⁾	4.4	4.4	4.4	4.4	4.4
Low Ambient Option °C ⁽⁶⁾	-18	-18	-18	-18	-18
Extra Low Ambient Option °C ⁽⁷⁾	-29	-29	-29	-29	-29
Number of Circuits	2	2	2	2	2
Refrigerant Charge, kgs R-22	122	131	142	153	169
Shipping Weight, kgs Alum. Fin/Cu. Fin	4384/5992	4394/6002	4743/5524	5089/5704	5911/6849
Operating Weight, kgs Alum. Fin/Cu. Fin	4641/6248	4650/6258	5000/5781	5396/6011	6218/7156

- NOTES: (1) Based on Liters/sec. per Performance Data. 35°C Ambient, 6.7°C LWT NR - Not Required
 (2) CH2 - Oversized cooler required where indicated for 5.5°C LWT VIC - Victaulic
 (3) CH3 - Oversized cooler required where indicated for 4.5°C LWT
 (4) Units with Low Ambient Option use (1) .76 kW in lieu of (1) 1.15 kW fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 8 km/hr wind across coil and minimum load per Table 6.
 (6) Low Ambient Option requires (1) .76 kW variable speed fan motor per circuit
 (7) Extra Low Ambient Option requires electronic expansion valve, variable speed fan, 50% Glycol, 50% minimum load and maximum 8km/hr wind across coil.


PHYSICAL SPECIFICATIONS: METRIC S.I. UNITS

ACDR-B 170D, 180D, 185D, 190D, 200D


ACDR-B MODEL	170D	180D	185D	190D	200D
Nominal kW ⁽¹⁾	598	633	650	668	703
Quantity of Compressors	(4) 8D50	(2) 8D50 (2) 8D60	(2) 8D50 (2) 8D60	(4) 8D60	(4) 8D60
STANDARD EVAPORATOR	EXD18122J07	EXD18122J07	EXD20122J07	EXD18122J07	EXD20122J07
Nominal kWo	598	633	650	668	703
Water Volume, Liters	233.3	233.3	279.5	233.3	279.5
Minimum Flow Rate, Liters/Sec	16.89	16.89	18.85	16.89	18.85
Maximum Flow Rate, Liters/Sec	67.07	67.07	51.63	67.07	51.63
Water Conn. Size In/Out (mm) (Type)	203.2 VIC	203.2 VIC	254 VIC	203.2 VIC	254 VIC
EVAPORATOR FOR 5.5°C LWT (CH2 OPT)⁽²⁾	NR	NR	NR	NR	NR
Water Volume, Liters	—	—	—	—	—
Minimum Flow Rate, Liters/sec.	—	—	—	—	—
Maximum Flow Rate, Liters/sec.	—	—	—	—	—
Water Conn. Size In/Out (mm) (Type)	—	—	—	—	—
EVAPORATOR FOR 4.5°C LWT (CH3 OPT)⁽³⁾	EXD20122J09	EXD20122J07	NR	EXD20122J07	NR
Water Volume, Liters	279.5	279.5	—	279.5	—
Minimum Flow Rate, Liters/sec.	14.10	18.85	—	18.85	—
Maximum Flow Rate, Liters/sec.	50.62	51.63	—	51.63	—
Water Conn. Size In/Out (mm) (Type)	254 VIC	254 VIC	—	254 VIC	—
CONDENSER	L312	L312	L312	L312	L312
Fan Quantity - All 760 mm Diameter	12	14	14	14	14
Nominal RPM	1140	1140	1140	1140	1140
Motor Quantity ⁽⁴⁾	(2) 12	(2) 14	(2) 14	(2) 14	(2) 14
KW ⁽⁴⁾	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15	(.76) 1.15
GENERAL					
Minimum Starting/Operating Ambient °C ⁽⁵⁾	-1.1	-1.1	-1.1	-1.1	-1.1
with HGBP °C ⁽⁵⁾	4.4	4.4	4.4	4.4	4.4
Low Ambient Option °C ⁽⁶⁾	-18	-18	-18	-18	-18
Extra Low Ambient Option °C ⁽⁷⁾	-29	-29	-29	-29	-29
Number of Circuits	2	2	2	2	2
Refrigerant Charge, kgs R-22	185	196	202	207	218
Shipping Weight, kgs Alum. Fin/Cu. Fin	5929/6867	6246/7340	6252/7356	6258/7352	6270/7364
Operating Weight, kgs Alum. Fin/Cu. Fin	6236/7174	6553/7647	6559/7653	6565/7659	6577/7671

- NOTES: (1) Based on Liters/sec. per Performance Data. 35°C Ambient, 6.7°C LWT NR - Not Required
 (2) CH2 - Oversized cooler required where indicated for 5.5°C LWT VIC - Victaulic
 (3) CH3 - Oversized cooler required where indicated for 4.5°C LWT
 (4) Units with Low Ambient Option use (1) .76 kW in lieu of (1) 1.15 kW fan motor per circuit
 (5) Minimum Starting/Operation Ambient with a maximum of 8 km/hr wind across coil and minimum load per Table 6.
 (6) Low Ambient Option requires (1) .76 kW variable speed fan motor per circuit
 (7) Extra Low Ambient Option requires electronic expansion valve, variable speed fan, 50% Glycol, 50% minimum load and maximum 8km/hr wind across coil.


DIMENSIONAL DATA: ACDR-B 021S TO 027S

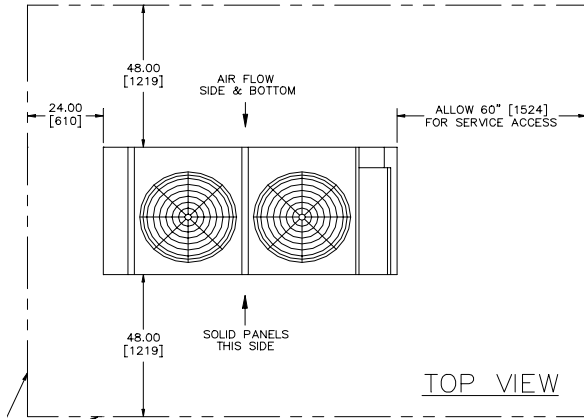

— CLEARANCE, SERVICE AND ACCESS REQUIREMENTS (NOT WALL OR WELL DIMENSIONS).

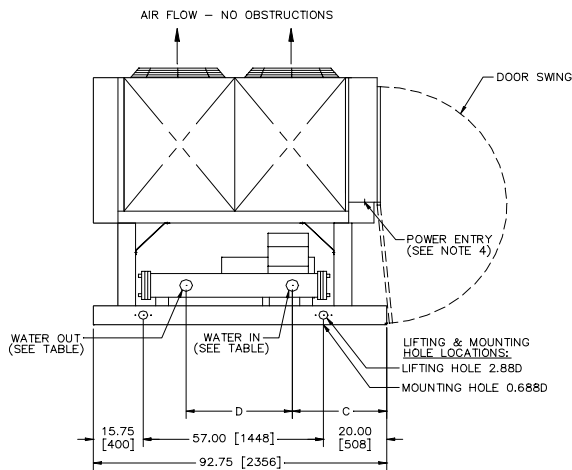

LEFT SIDE VIEW

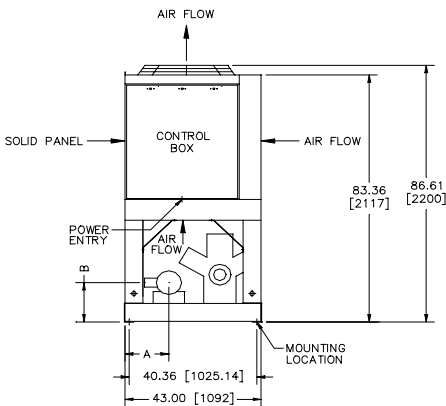

CONTROL BOX END




NOTE:

- 1 - ALL DIMENSIONS ARE IN INCHES AND MILLIMETERS.
- 2 - VENT & DRAIN CONNECTIONS PROVIDED ON COOLER.
- 3 - ALLOW 60 [1524] CLEARANCE AT CONTROL PANEL END OF UNIT FOR SERVICE.
- 4 - USE MINIMUM 3/8 [914] FLEXIBLE CONDUIT TO CONTROL BOX TO ISOLATE UNIT.
- 5 - WATER PIPING TO BE SUPPORTED TO MINIMIZE LOAD ON UNIT.
- 6 - ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
- 7 - REFERENCE DIMENSIONAL DRAWING 021682A0.

STANDARD CHILLER (CHR44) & OPTIONAL CHILLER (CHR42)						
2-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB-021S						
ACDRB-024S	CHS007601A	3" MPT	10.87 [276]	13.12 [333]	20.18 [513]	56.12 [1425]
ACDRB-027S						

OPTIONAL CHILLER (CHR40)						
2-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB-021S						
ACDRB-024S	CHS007601A	3" MPT	10.87 [276]	13.12 [333]	20.18 [513]	56.12 [1425]
ACDRB-027S	CHS008602A	3" MPT	10.21 [262]	13.68 [347]	21.49 [546]	53.50 [1359]

DIMENSIONAL DATA: ACDR-B 030S TO 035S

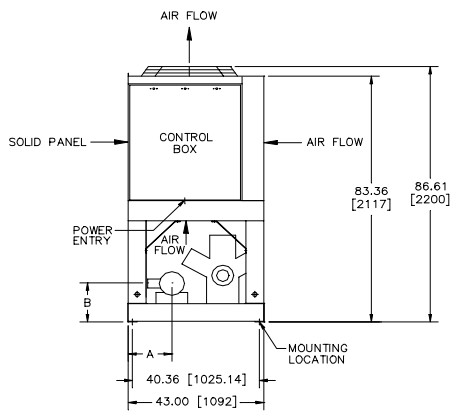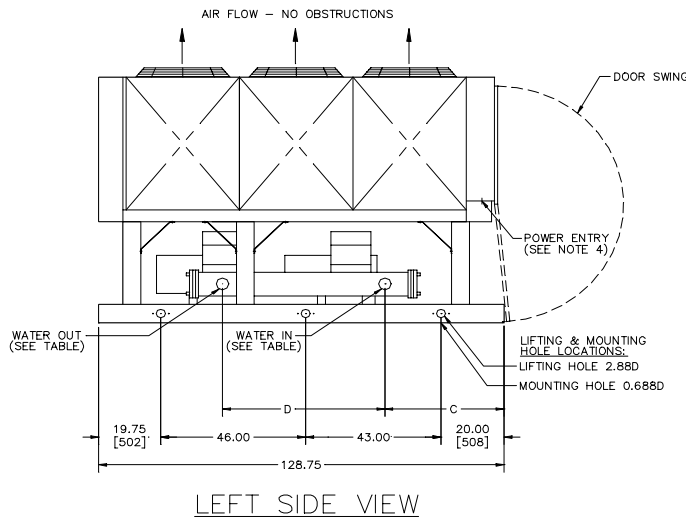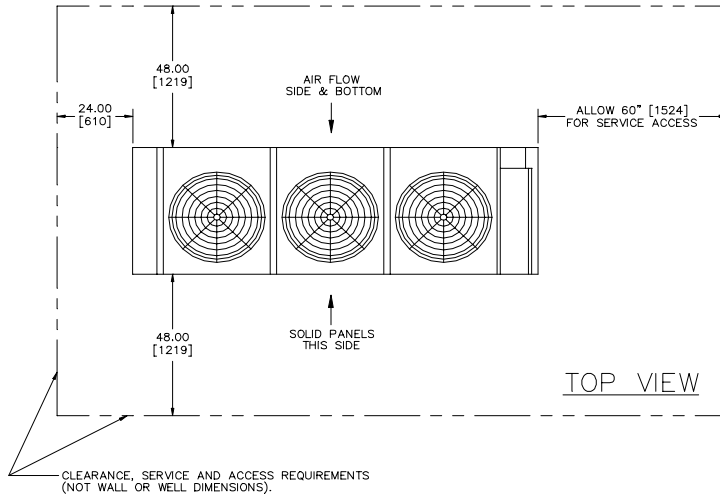


NOTE:

- 1 - ALL DIMENSIONS ARE IN INCHES AND MILLIMETERS.
- 2 - VENT & DRAIN CONNECTIONS PROVIDED ON COOLER.
- 3 - ALLOW 60 [1524] CLEARANCE AT CONTROL PANEL END OF UNIT FOR SERVICE.
- 4 - USE MINIMUM 3/8 [914] FLEXIBLE CONDUIT TO CONTROL BOX TO ISOLATE UNIT.
- 5 - WATER PIPING TO BE SUPPORTED TO MINIMIZE LOAD ON UNIT.
- 6 - ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
- 7 - REFERENCE DIMENSIONAL DRAWING 021683A0.


STANDARD CHILLER (CHR44) & OPTIONAL CHILLER (CHR42)							
3-FAN UNIT	CHILLER	CONN.	A		B		D
ACDRB-030S	CHS007601B	3" MPT	10.87 [276]	13.12 [333]	35.56 [903]	56.12 [1425]	
ACDRB-035S	CHS008601A	3" MPT	10.31 [262]	13.68 [347]	36.88 [937]	53.50 [1359]	

OPTIONAL CHILLER (CHR40)							
3-FAN UNIT	CHILLER	CONN.	A		B		D
ACDRB-030S	CHS010601A	4" MPT	13.18 [335]	14.24 [362]	36.88 [937]	53.50 [1359]	
ACDRB-035S							


DIMENSIONAL DATA: ACDR-B 030D TO 055D

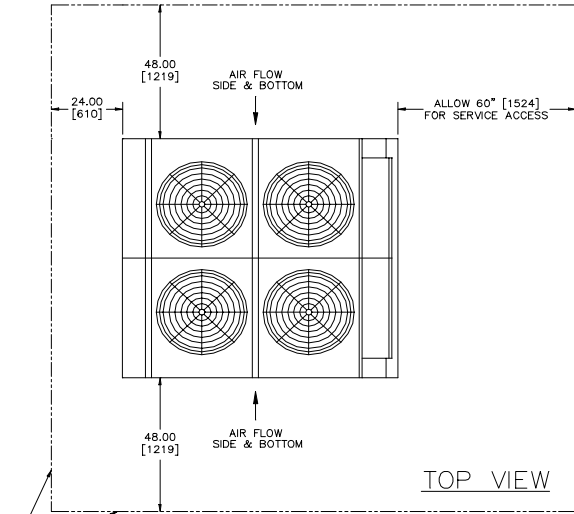

CLEARANCE, SERVICE AND ACCESS REQUIREMENTS (NOT WALL OR WELL DIMENSIONS).

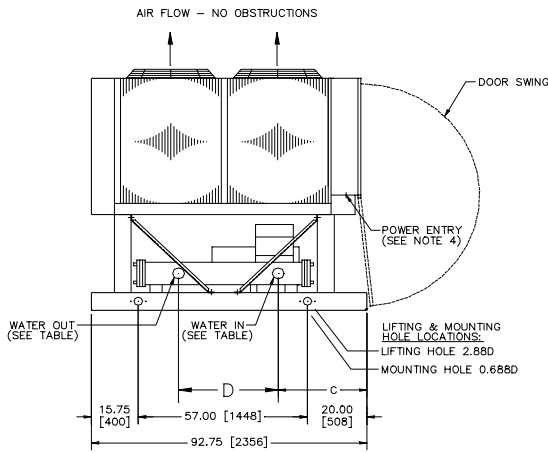

LEFT SIDE VIEW

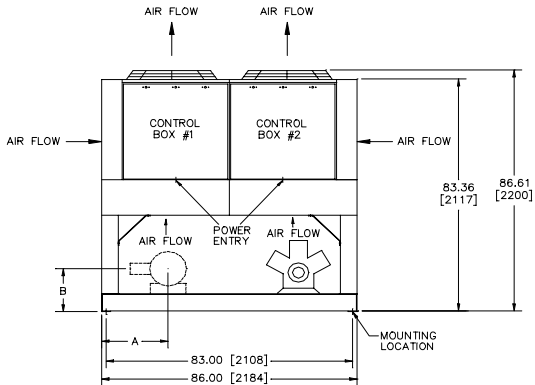

CONTROL BOX END

NOTE:




- 1 - ALL DIMENSIONS ARE IN INCHES AND MILLIMETERS.
- 2 - VENT & DRAIN CONNECTIONS PROVIDED ON COOLER.
- 3 - ALLOW 60 [1524] CLEARANCE AT CONTROL PANEL END OF UNIT FOR SERVICE.
- 4 - USE MINIMUM 36 [914] FLEXIBLE CONDUIT TO CONTROL BOX TO ISOLATE UNIT.
- 5 - WATER PIPING TO BE SUPPORTED TO MINIMIZE LOAD ON UNIT.
- 6 - ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
- 7 - REFERENCE DIMENSIONAL DRAWING 021684A0.

STANDARD CHILLER (CHR44)							
4-FAN UNIT	CHILLER	CONN	A	B	C	D	
ACDRB-030D	CHD008601A	3" MPT	29.90 [759]	11.50 [292]	21.24 [539]	53.50 [1359]	
ACDRB-035D	CHD010601A	4" MPT	21.88 [556]	12.06 [306]	21.24 [539]	53.50 [1359]	
ACDRB-040D	CHD010601B	4" MPT	21.88 [556]	12.06 [306]	21.24 [539]	53.50 [1359]	
ACDRB-045D	CHD010601B	4" MPT	21.88 [556]	12.06 [306]	21.24 [539]	53.50 [1359]	
ACDRB-050D	CHD011601B	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	
ACDRB-052D	CHD011601B	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	
ACDRB-055D	CHD011601B	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	

OPTIONAL CHILLER (CHR42)							
4-FAN UNIT	CHILLER	CONN	A	B	C	D	
ACDRB-030D	CHD008601A	3" MPT	29.90 [759]	11.50 [292]	21.24 [539]	53.50 [1359]	
ACDRB-035D	CHD010601A	4" MPT	21.88 [556]	12.06 [306]	21.24 [539]	53.50 [1359]	
ACDRB-040D	CHD010601A	4" MPT	21.88 [556]	12.06 [306]	21.24 [539]	53.50 [1359]	
ACDRB-045D	CHD010601A	4" MPT	21.88 [556]	12.06 [306]	21.24 [539]	53.50 [1359]	
ACDRB-050D	CHD011601B	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	
ACDRB-052D	CHD011601B	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	
ACDRB-055D	CHD011601B	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	

OPTIONAL CHILLER (CHR40)							
4-FAN UNIT	CHILLER	CONN	A	B	C	D	
ACDRB-030D	CHD010602A	4" MPT	21.88 [556]	12.06 [306]	21.24 [539]	53.50 [1359]	
ACDRB-035D	CHD011601A	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	
ACDRB-040D	CHD011601A	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	
ACDRB-045D	CHD011601A	4" MPT	22.07 [561]	12.63 [321]	21.24 [539]	53.50 [1359]	
ACDRB-050D	CHD013601A	4" MPT	27.58 [701]	15.93 [405]	22.24 [565]	53.50 [1359]	
ACDRB-052D	CHD013601A	4" MPT	27.58 [701]	15.93 [405]	22.24 [565]	53.50 [1359]	
ACDRB-055D	CHD013601A	4" MPT	27.58 [701]	15.93 [405]	22.24 [565]	53.50 [1359]	

DIMENSIONAL DATA: ACDR-B 062D TO 080D

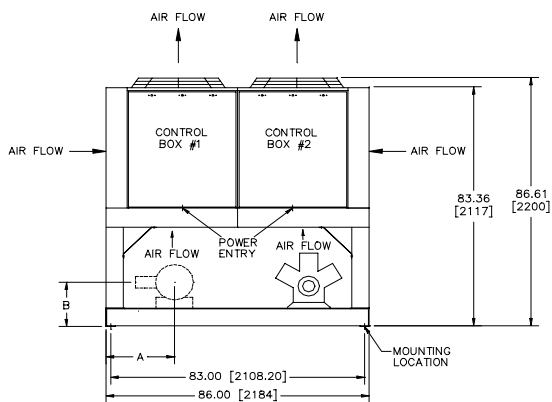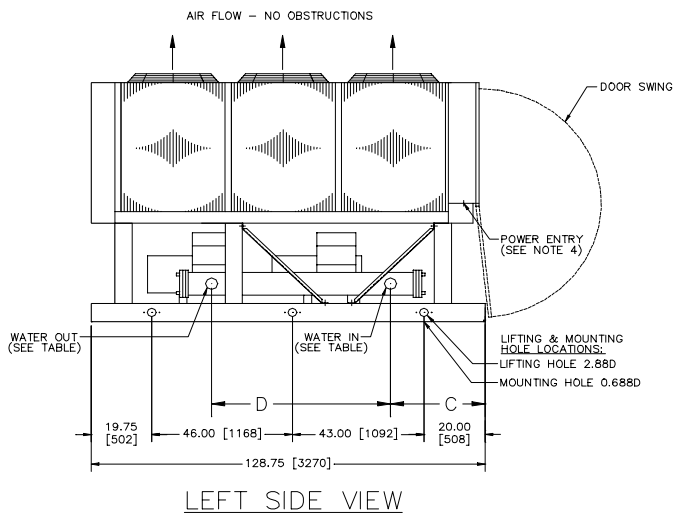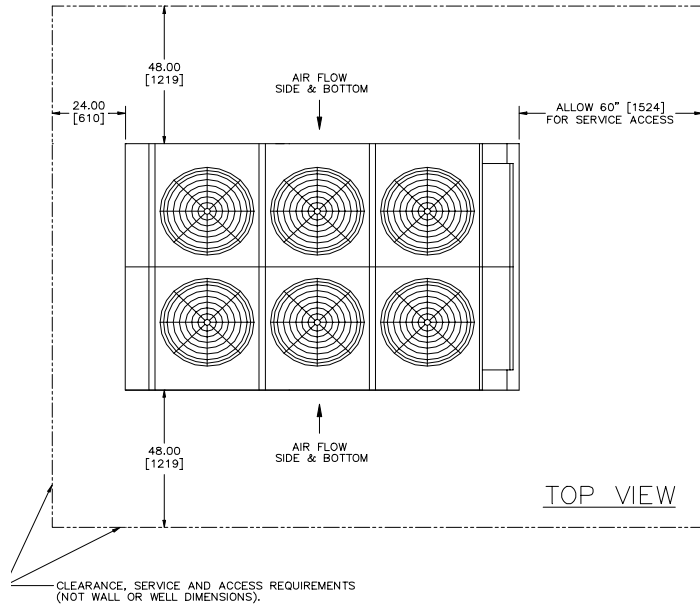


NOTE:

- 1 - ALL DIMENSIONS ARE IN INCHES AND MILLIMETERS.
- 2 - VENT & DRAIN CONNECTIONS PROVIDED ON COOLER.
- 3 - ALLOW 60 [1524] CLEARANCE AT CONTROL PANEL END OF UNIT FOR SERVICE.
- 4 - USE MINIMUM 3/8 [914] FLEXIBLE CONDUIT TO CONTROL BOX TO ISOLATE UNIT.
- 5 - WATER PIPING TO BE SUPPORTED TO MINIMIZE LOAD ON UNIT.
- 6 - ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
- 7 - REFERENCE DIMENSIONAL DRAWING 021685A0.



STANDARD CHILLER (CHR44) & OPTIONAL CHILLER (CHR42)						
6-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB-062D						
ACDRB-062D	CHD012601B	4" MPT	22.39 [569]	15.37 [390]	22.00 [559]	53.50 [1359]
ACDRB-070D						
ACDRB-075D						
ACDRB-080D	CHD013601B	4" MPT	27.58 [701]	15.93 [405]	22.00 [559]	53.50 [1359]

OPTIONAL CHILLER (CHR40)						
6-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB-062D						
ACDRB-070D						
ACDRB-075D	EXD16092J11	4" MPT	26.33 [669]	17.17 [436]	21.60 [548]	79.75 [2026]
ACDRB-080D						

DIMENSIONAL DATA: ACDR-B 085D TO 102D

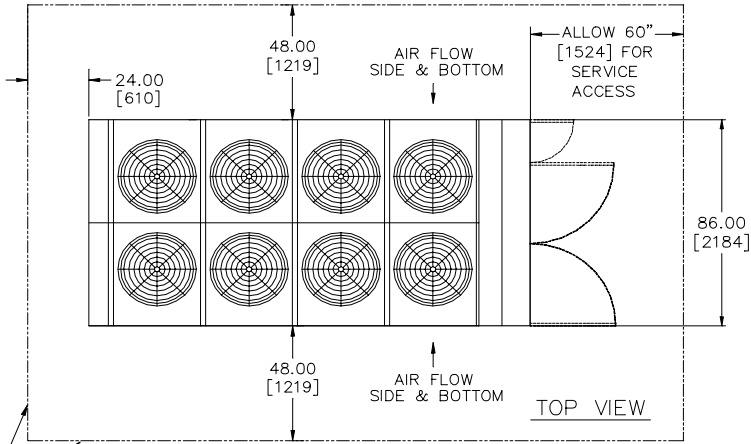

CLEARANCE, SERVICE AND ACCESS REQUIREMENTS (NOT WALL OR WELL DIMENSIONS).

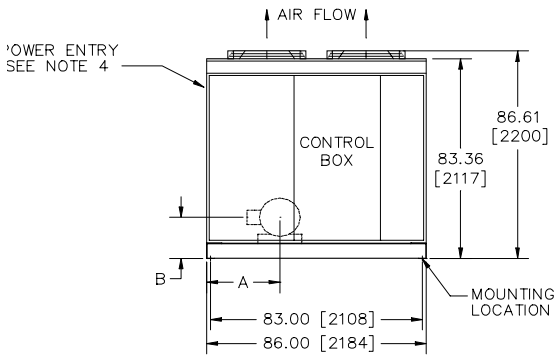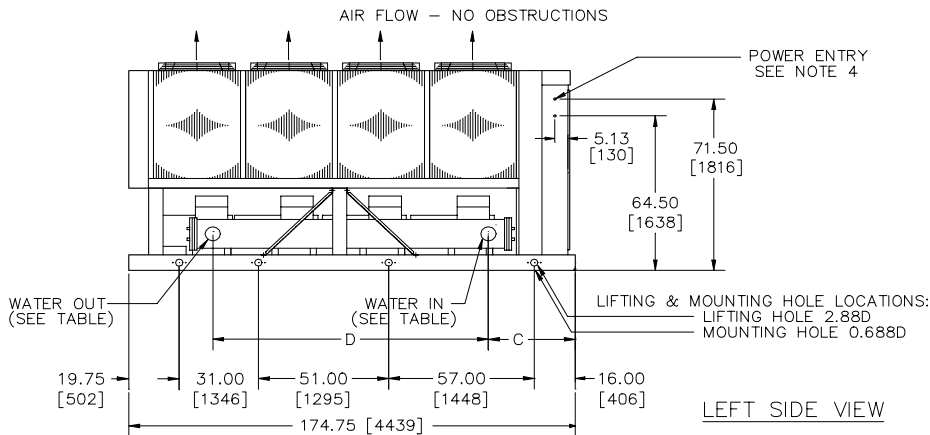


- NOTE:**
- 1 - ALL DIMENSIONS ARE IN INCHES AND MILLIMETERS.
 - 2 - VENT & DRAIN CONNECTIONS PROVIDED ON COOLER.
 - 3 - ALLOW 60 [1524] CLEARANCE AT CONTROL PANEL END OF UNIT FOR SERVICE.
 - 4 - USE MINIMUM 3/8 [914] FLEXIBLE CONDUIT TO CONTROL BOX TO ISOLATE UNIT.
 - 5 - WATER PIPING TO BE SUPPORTED TO MINIMIZE LOAD ON UNIT.
 - 6 - ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
 - 7 - REFERENCE DIMENSIONAL DRAWING 021686A0.

STANDARD CHILLER (CHR44) & OPTIONAL CHILLER (CHR42)						
8-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB085D	EXD12102J07	4" VIC	27.96 [710]	15.74 [400]	42.38 [1076]	91.63 [2327]
ACDRB090D						
ACDRB100D	EXD12122J09	4" VIC	27.96 [710]	15.74 [400]	42.38 [1076]	111.63 [2835]
ACDRB102D						



OPTIONAL CHILLER (CHR42)						
8-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB090D	EXD12122J09	4" VIC	27.96 [710]	15.74 [400]	42.38 [1076]	111.63 [2835]

OPTIONAL CHILLER (CHR40)						
8-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB085D	EXD14122J11	5" VIC	28.58 [726]	16.36 [415]	42.38 [1076]	110.63 [2810]
ACDRB090D						
ACDRB100D	EXD16122J11	6" VIC	29.58 [751]	17.36 [441]	42.38 [1076]	109.75 [2788]
ACDRB102D						

DIMENSIONAL DATA: ACDR-B 112D TO 130D.....

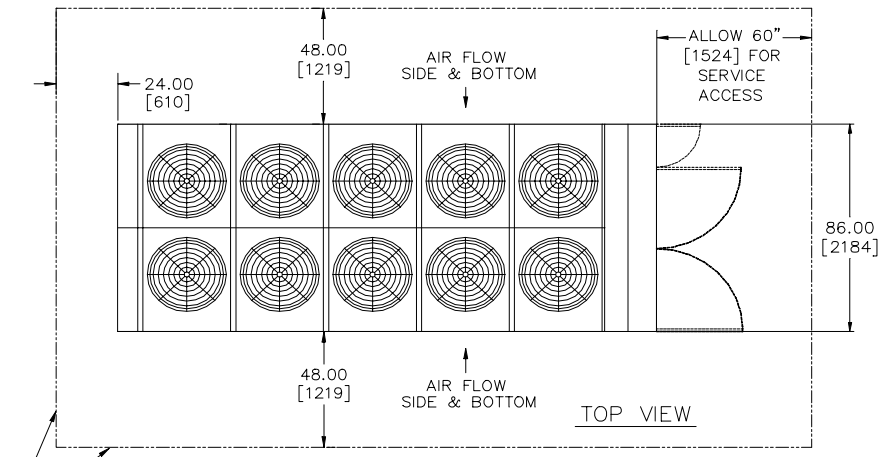

— CLEARANCE, SERVICE AND ACCESS REQUIREMENTS (NOT WALL OR WELL DIMENSIONS).

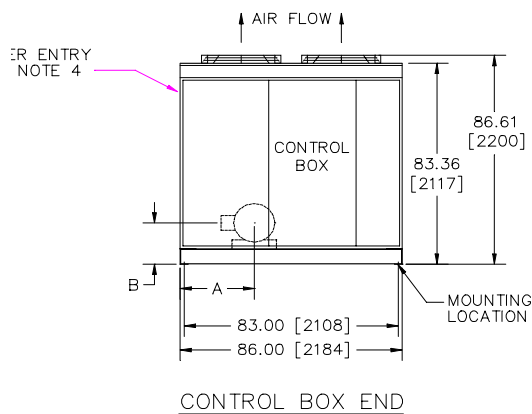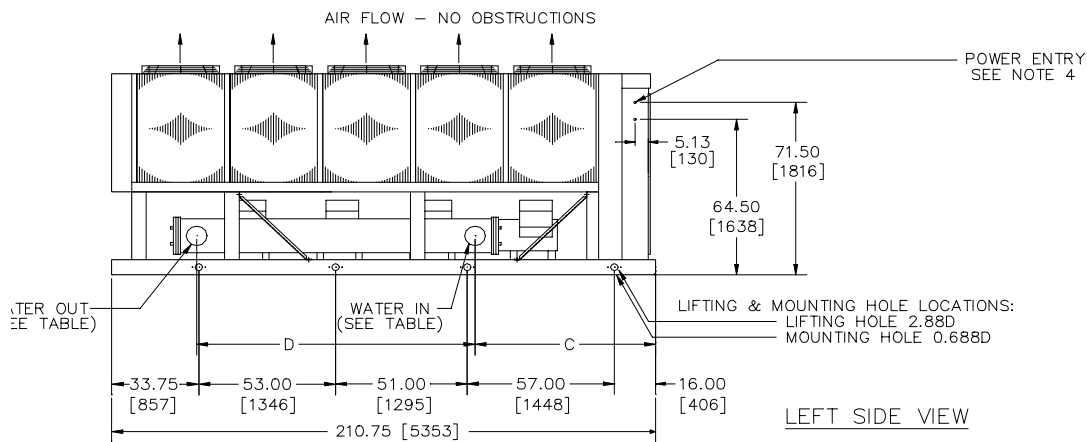


- NOTE:**
- 1 - ALL DIMENSIONS ARE IN INCHES AND MILLIMETERS.
 - 2 - VENT & DRAIN CONNECTIONS PROVIDED ON COOLER.
 - 3 - ALLOW 60 [1524] CLEARANCE AT CONTROL PANEL END OF UNIT FOR SERVICE.
 - 4 - USE MINIMUM 36 [914] FLEXIBLE CONDUIT TO CONTROL BOX TO ISOLATE UNIT.
 - 5 - WATER PIPING TO BE SUPPORTED TO MINIMIZE LOAD ON UNIT.
 - 6 - ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
 - 7 - REFERENCE DIMENSIONAL DRAWING 021687A0.

STANDARD CHILLER (CHR44)							
10-FAN UNIT	CHILLER	CONN	A	B	C	D	
ACDRB112D	EXD12122J09	4" VIC	27.96 [710]	15.17 [385]	67.13 [1705]	111.63 [2835]	
ACDRB120D	EXD14122J09	5" VIC	27.33 [694]	16.17 [411]	67.13 [1705]	110.63 [2810]	



OPTIONAL CHILLER (CHR42)							
10-FAN UNIT	CHILLER	CONN	A	B	C	D	
ACDRB112D	EXD14102J09	5" VIC	27.96 [710]	15.17 [385]	67.13 [1705]	90.63 [2302]	
ACDRB120D	EXD14122J09	5" VIC	27.33 [694]	16.17 [411]	67.13 [1705]	110.63 [2810]	

OPTIONAL CHILLER (CHR40)							
10-FAN UNIT	CHILLER	CONN	A	B	C	D	
ACDRB112D	EXD18122J11	8" VIC	23.90 [607]	18.36 [466]	67.13 [1705]	105.50 [2680]	
ACDRB120D	EXD18122J09	8" VIC	23.90 [607]	18.36 [466]	67.13 [1705]	105.50 [2680]	

DIMENSIONAL DATA: ACDR-B 140D TO 170D.....

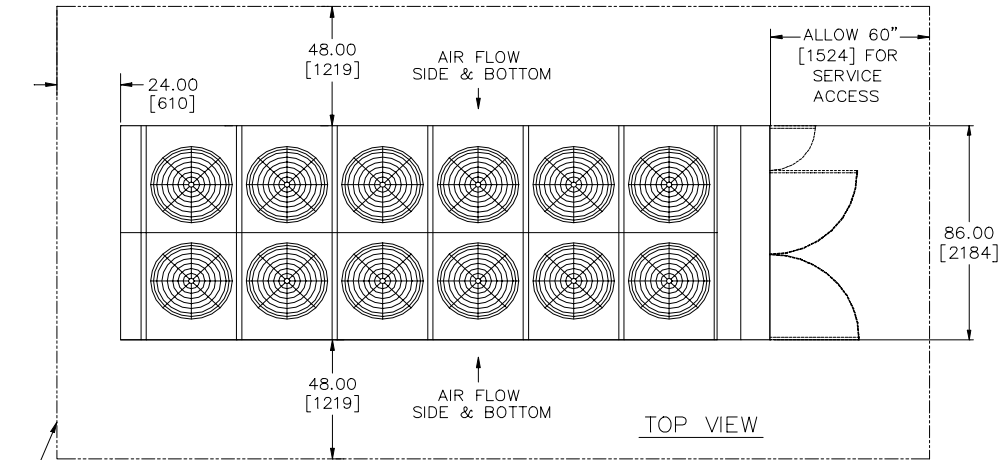

CLEARANCE, SERVICE AND ACCESS REQUIREMENTS (NOT WALL OR WELL DIMENSIONS).


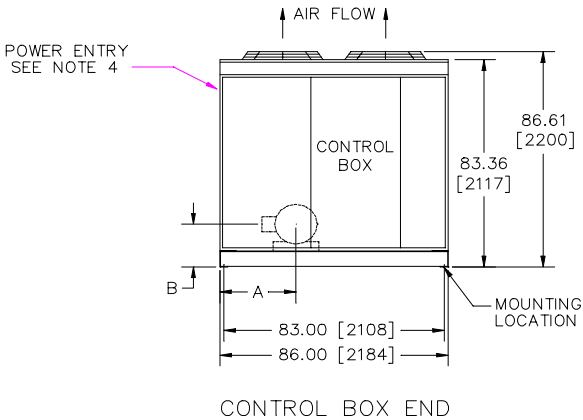
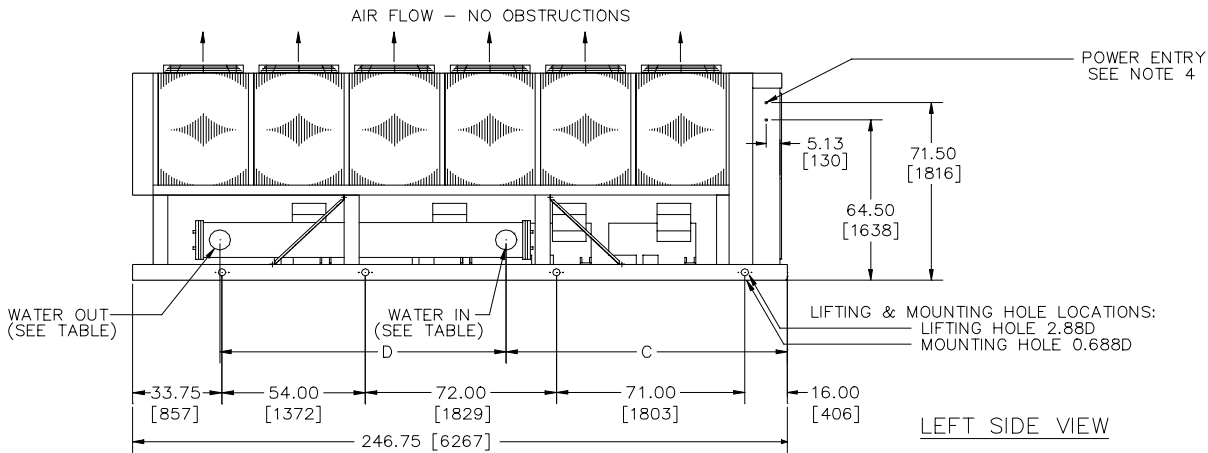


- NOTE:**
- 1 - ALL DIMENSIONS ARE IN INCHES AND MILLIMETERS.
 - 2 - VENT & DRAIN CONNECTIONS PROVIDED ON COOLER.
 - 3 - ALLOW 60 [1524] CLEARANCE AT CONTROL PANEL END OF UNIT FOR SERVICE.
 - 4 - USE MINIMUM 3/6 [914] FLEXIBLE CONDUIT TO CONTROL BOX TO ISOLATE UNIT.
 - 5 - WATER PIPING TO BE SUPPORTED TO MINIMIZE LOAD ON UNIT.
 - 6 - ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
 - 7 - REFERENCE DIMENSIONAL DRAWING 021688A0.

STANDARD CHILLER (CHR44) & OPTIONAL CHILLER (CHR42)							
12-FAN UNIT	CHILLER	CONN	A	B	C	D	
ACDRB140D	EXD14122J09	5" VIC	27.33 [694]	16.17 [411]	101.88 [2588]	110.63 [2810]	
ACDRB155D	EXD16122J07	6" VIC	26.33 [669]	17.17 [436]	101.88 [2588]	109.75 [2788]	
ACDRB170D	EXD18122J07	8" VIC	23.90 [607]	18.17 [462]	105.88 [2689]	105.50 [2680]	

OPTIONAL CHILLER (CHR40)							
12-FAN UNIT	CHILLER	CONN	A	B	C	D	
ACDRB140D	EXD18122J09	8" VIC	23.90 [607]	18.17 [462]	105.88 [2689]	105.50 [2680]	
ACDRB155D	EXD20122J09	10" VIC	23.90 [607]	19.17 [487]	105.88 [2689]	102.88 [2613]	
ACDRB170D	EXD20122J09	10" VIC	23.90 [607]	19.17 [487]	105.88 [2689]	102.88 [2613]	

DIMENSIONAL DATA: ACDR-B 180D TO 200D.....

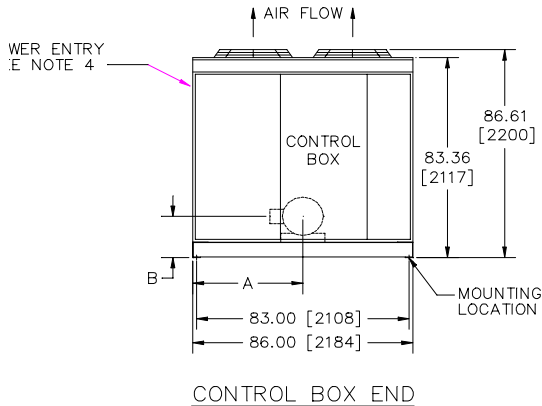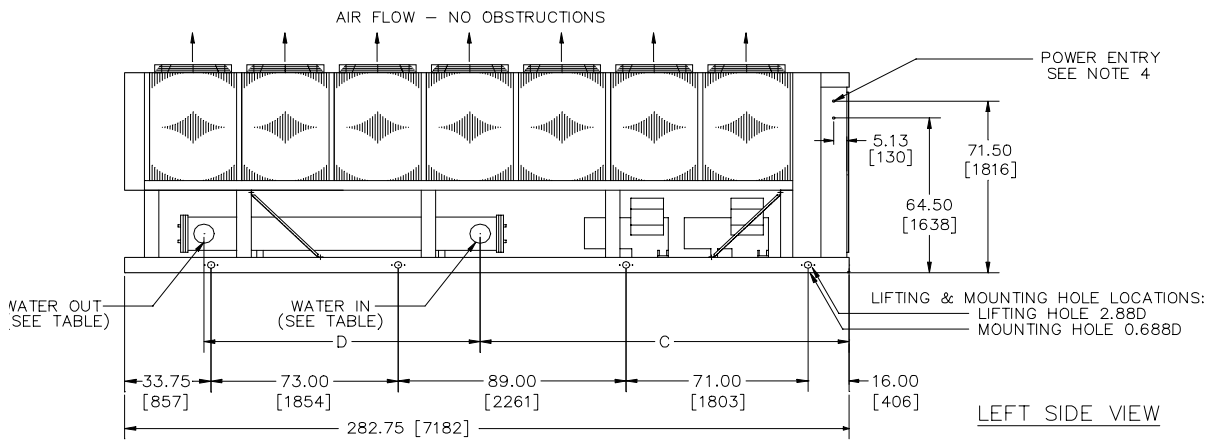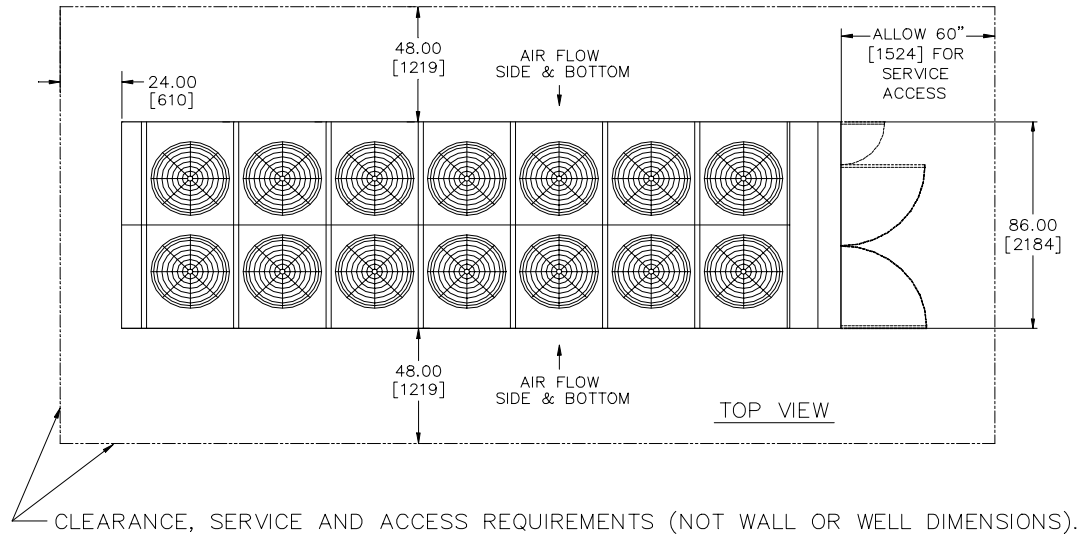

- NOTE:**
- 1 - ALL DIMENSIONS ARE IN INCHES AND MILLIMETERS.
 - 2 - VENT & DRAIN CONNECTIONS PROVIDED ON COOLER.
 - 3 - ALLOW 60 [1524] CLEARANCE AT CONTROL PANEL END OF UNIT FOR SERVICE.
 - 4 - USE MINIMUM 3/8 [914] FLEXIBLE CONDUIT TO CONTROL BOX TO ISOLATE UNIT.
 - 5 - WATER PIPING TO BE SUPPORTED TO MINIMIZE LOAD ON UNIT.
 - 6 - ALL DIMENSIONS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
 - 7 - REFERENCE DIMENSIONAL DRAWING 021689A0.

STANDARD CHILLER (CHR44) & OPTIONAL CHILLER (CHR42)						
14-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB180D	EXD18122J07	8" VIC	43.00 [1092]	18.17 [462]	141.69 [3599]	105.50 [2680]
ACDRB185D	EXD20122J07	10" VIC	43.00 [1092]	19.17 [487]	143.06 [3634]	102.88 [2613]
ACDRB190D	EXD18122J07	8" VIC	43.00 [1092]	18.17 [462]	141.69 [3599]	105.50 [2680]
ACDRB200D	EXD20122J07	10" VIC	43.00 [1092]	19.17 [487]	143.06 [3634]	102.88 [2613]

OPTIONAL CHILLER (CHR40)						
14-FAN UNIT	CHILLER	CONN	A	B	C	D
ACDRB180D						
ACDRB185D	EXD20122J07	10" VIC	43.00 [1092]	19.17 [487]	143.06 [3634]	102.88 [2613]
ACDRB190D						
ACDRB200D						

ELECTRICAL DATA: (60Hz/3PH)

ACDR-B Model	Nom. Volts	Unit							Each Compressor				Condenser Fan Motors			
		Circ. #1			Circ. #2				Qty / Circuit	RLA	LRA-XL	LRA-PW	Qty	HP	Total kW	FLA Each
		RLA	MCA	MFS/HACR	RLA	MCA	MFS/HACR									
021S	AK	200	86	104	175	—	—	—	1	73.7	428	250	2	1.5	2.9	5.9
	AN	230	86	104	175	—	—	—		73.7	428	250				5.9
	AR	460	43	53	80	—	—	—		36.9	214	132				3.0
	AS	575	35	43	70	—	—	—		30.8	172	N/A				2.1
024S	AK	200	97	118	200	—	—	—	1	84.4	470	292	2	1.5	2.9	5.9
	AN	230	97	118	200	—	—	—		84.4	470	292				5.9
	AR	460	49	59	100	—	—	—		42.2	235	141				3.0
	AS	575	40	49	80	—	—	—		35.3	200	N/A				2.1
027S	AK	200	106	130	200	—	—	—	1	94.2	565	340	2	1.5	2.9	5.9
	AN	230	106	130	200	—	—	—		94.2	565	340				5.9
	AR	460	54	65	110	—	—	—		47.1	283	156				3.0
	AS	575	41	50	80	—	—	—		35.9	230	N/A				2.1
030S	AK	200	139	170	250	—	—	—	1	121.2	650	400	3	1.5	4.35	5.9
	AN	230	130	158	250	—	—	—		112.2	594	340				5.9
	AR	460	69	83	125	—	—	—		59.2	297	195				3.0
	AS	575	48	58	90	—	—	—		41.3	245	N/A				2.1
035S	AK	200	153	186	300	—	—	—	1	134.6	754	463	3	1.5	4.35	5.9
	AN	230	145	177	300	—	—	—		126.9	594	340				5.9
	AR	460	73	89	150	—	—	—		63.5	297	195				3.0
	AS	575	55	67	110	—	—	—		48.0	245	N/A				2.1
030D	AK	200	139	148	200	—	—	—	1	59.7	308	188	4*	1	4.0	4.8
	AN	230	139	148	200	—	—	—		59.7	308	188				4.8
	AR	460	70	75	100	—	—	—		30.1	154	104				2.4
	AS	575	52	58	80	—	—	—		22.7	135	N/A				1.5
035D	AK	200	138	146	200	—	—	—	1	59.2	374	222	4*	1	4.0	4.8
	AN	230	138	146	200	—	—	—		59.2	374	222				4.8
	AR	460	69	73	100	—	—	—		29.6	187	108				2.4
	AS	575	50	55	70	—	—	—		21.7	135	N/A				1.5
040D	AK	200	171	190	250	—	—	—	1	73.7	428	250	4*	1.5	5.8	5.9
	AN	230	171	190	250	—	—	—		73.7	428	250				5.9
	AR	460	86	96	125	—	—	—		36.9	214	132				3.0
	AS	575	70	78	100	—	—	—		30.8	172	N/A				2.1
045D	AK	200	192	216	300	—	—	—	1 ea.	73.7/94.2	428/565	250/340	4*	1.5	5.8	5.9
	AN	230	192	216	300	—	—	—		73.7/94.2	428/565	250/340				5.9
	AR	460	96	108	150	—	—	—		36.9/47.1	214/283	132/156				3.0
	AS	575	76	85	110	—	—	—		30.8/35.9	172/230	N/A				2.1
050D	AK	200	203	226	300	—	—	—	1 ea.	84.4/94.2	470/565	292/340	4*	1.5	5.8	5.9
	AN	230	203	226	300	—	—	—		84.4/94.2	470/565	292/340				5.9
	AR	460	102	114	150	—	—	—		42.2/47.1	235/283	141/156				3.0
	AS	575	80	89	110	—	—	—		35.3/35.9	200/230	N/A				2.1
052D	AK	200	212	236	300	—	—	—	1	94.2	565	340	4*	1.5	5.8	5.9
	AN	230	212	236	300	—	—	—		94.2	565	340				5.9
	AR	460	107	118	150	—	—	—		47.1	283	156				3.0
	AS	575	81	90	125	—	—	—		35.9	230	N/A				2.1
055D	AK	200	239	270	350	—	—	—	1 ea.	121.2/94.2	650/565	400/340	4*	2	5.8	5.9
	AN	230	230	259	350	—	—	—		112.2/94.2	594/565	340/340				5.9
	AR	460	119	134	175	—	—	—		59.2/47.1	297/283	195/156				3.0
	AS	575	86	96	125	—	—	—		41.3/35.9	245/230	N/A				2.1

NOTES: RLA - Rated Load Amps at ARI Conditions of Service *Replace (2) 1.5 HP motors with (2) 1 HP motors on units with Low Ambient Option
MCA - Minimum Circuit Ampacity
MFS / HACR - Maximum fuse or HACR breaker size, protective device N/A - Not Available
LRA-XL - Locked Rotor Amps Standard Across the Line Starting
LRA-PW - Locked Rotor Amps Q Option Part Wind Starting

IMPORTANT: See additional notes on pages 66 and 67.

ELECTRICAL DATA: FIELD WIRING (60Hz/3PH)

ACDR-B Model	Nominal Voltage	Standard Field Wiring Data Wire Size Range and Quantity Single / Dual Point Power Source				Optional Field Wiring Wire Size Range and Quantity Single Point Power Source		
		Standard		Optional		Optional		
		Terminal Block		Unit Mtd. Disc. Swt.		Terminal Block		
		Wire		Wire		Wire		
		Qty	Size Range	Qty	Size range	Qty	Size range	
021S	AK	200	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AN	230	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AR	460	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AS	575	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
024S	AK	200	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AN	230	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AR	460	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AS	575	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
027S	AK	200	1	#12 TO 2 / 0	1	#6 TO 350MCM	1	#6 TO 350MCM
	AN	230	1	#12 TO 2 / 0	1	#6 TO 350MCM	1	#6 TO 350MCM
	AR	460	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AS	575	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
030S	AK	200	1	#4 TO 500 MCM	1	#6 TO 350MCM	1	#6 TO 350MCM
	AN	230	1	#4 TO 500 MCM	1	#6 TO 350MCM	1	#6 TO 350MCM
	AR	460	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AS	575	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
035S	AK	200	1	#4 TO 500 MCM	1	#6 TO 350MCM	1	#6 TO 350MCM
	AN	230	1	#4 TO 500 MCM	1	#6 TO 350MCM	1	#6 TO 350MCM
	AR	460	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
	AS	575	1	#12 TO 2 / 0	1	#3 TO 3 / 0	1	#3 TO 3 / 0
030D	AK	200	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AN	230	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AR	460	1	#4 TO 500 MCM	1	#10 TO 1 / 0		N/A
	AS	575	1	#12 TO 2 / 0	1	#10 TO 1 / 0		N/A
035D	AK	200	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AN	230	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AR	460	1	#4 TO 500 MCM	1	#10 TO 1 / 0		N/A
	AS	575	1	#12 TO 2 / 0	1	#10 TO 1 / 0		N/A
040D	AK	200	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AN	230	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AR	460	1	#4 TO 500 MCM	1	#10 TO 1 / 0		N/A
	AS	575	1	#12 TO 2 / 0	1	#10 TO 1 / 0		N/A
045D	AK	200	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AN	230	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AR	460	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AS	575	1	#12 TO 2 / 0	1	#10 TO 1 / 0		N/A
050D	AK	200	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AN	230	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AR	460	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AS	575	1	#12 TO 2 / 0	1	#10 TO 1 / 0		N/A
052D	AK	200	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AN	230	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AR	460	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AS	575	1	#12 TO 2 / 0	1	#10 TO 1 / 0		N/A
055D	AK	200	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AN	230	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AR	460	1	#4 TO 500 MCM	2	3 / 0 TO 500MCM		N/A
	AS	575	1	#12 TO 2 / 0	1	#10 TO 1 / 0		N/A

N/A = Not Available

NOTE: Single point power is standard for all voltages listed on ACDR-B 021-090.

ELECTRICAL DATA: (60Hz/3PH)

ACDR-B Model	Nom. Volts	Unit						Unit			Each Compressor				Condenser Fan Motors				
		Circ. #1			Circ. #2			Option Single Point Power			Qty / Circuit	RLA	LRA-XL	LRA-PW	Qty	HP	Total kW	FLA Each	
		RLA	MCA	MFS/HACR	RLA	MCA	MFS/HACR	RLA	MCS	MFS/HACR									
062D	AK	200	278	309	400	—	—	—	—	—	—	1	121.2	650	400	6*	1.5	8.7	5.9
	AN	230	260	288	400	—	—	—	—	—	112.2		594	340	5.9				
	AR	460	137	152	200	—	—	—	—	—	59.1		297	195	3.0				
	AS	575	99	110	150	—	—	—	—	—	43.0		245	N/A	2.1				
070D	AK	200	305	339	450	—	—	—	—	—	1	134.6	754	463	6*	1.5	8.7	5.9	
	AN	230	290	321	400	—	—	—	—	—		126.9	594	340				5.9	
	AR	460	145	161	200	—	—	—	—	—		63.5	297	195				3.0	
	AS	575	109	121	150	—	—	—	—	—		48.0	245	N/A				2.1	
075D	AK	200	332	373	500	—	—	—	—	—	1 ea.	134.6/162	754/1070	463/654	6*	1.5	8.7	5.9	
	AN	230	325	365	500	—	—	—	—	—		126.9/162	594/1070	340/654				5.9	
	AR	460	169	191	250	—	—	—	—	—		63.5/87	297/535	195/330				3.0	
	AS	575	128	145	200	—	—	—	—	—		48.0/67	245/405	N/A				2.1	
080D	AK	200	360	400	500	—	—	—	—	—	1	162	1070	654	6	1.5	8.7	5.9	
	AN	230	360	400	500	—	—	—	—	—		162	1070	654				5.9	
	AR	460	192	214	300	—	—	—	—	—		87	535	330				3.0	
	AS	575	147	164	225	—	—	—	—	—		67	405	N/A				2.1	
085D	AK	200	364	385	450	—	—	—	—	—	1 ea.	84.4/73.7	470/428	292/250	8*	1.5	11.6	5.9	
	AN	230	364	385	450	—	—	—	—	—		84.4/73.7	470/428	292/250				5.9	
	AR	460	196	207	250	—	—	—	—	—		45.0/40.6	235/214	141/132				3.0	
	AS	575	155	164	200	—	—	—	—	—		38.0/30.8	200/172	N/A				2.1	
090D	AK	200	383	407	500	—	—	—	—	—	1 ea.	94.2/73.7	565/428	340/250	8*	1.5	11.6	5.9	
	AN	230	383	407	500	—	—	—	—	—		94.2/73.7	565/428	340/250				5.9	
	AR	460	192	204	250	—	—	—	—	—		47.1/36.9	283/214	156/132				3.0	
	AS	575	159	169	200	—	—	—	—	—		40.0/30.8	230/172	N/A				2.1	
100D	AK	200	203	226	300	203	226	300	405	428	500	1 ea.	94.2/84.4	565/470	340/292	8*	1.5	11.6	5.9
	AN	230	203	226	300	203	226	300	405	428	500		94.2/84.4	565/470	340/292				5.9
	AR	460	203	215	250	—	—	—	—	—	—		47.1/42.2	283/235	156/141				3.0
	AS	575	160	169	200	—	—	—	—	—	—		35.9/35.3	230/200	N/A				2.1
102D	AK	200	236	263	350	236	263	350	472	498	600	2	106	565	340	8*	1.5	11.6	5.9
	AN	230	236	263	350	236	263	350	472	498	600		106	565	340				5.9
	AR	460	236	250	300	—	—	—	—	—	—		53	283	156				3.0
	AS	575	161	170	200	—	—	—	—	—	—		35.9	230	N/A				2.1
112D	AK	200	245	273	350	245	276	350	490	521	600	1 ea.	121.2/94.2	650/565	400/340	10*	1.5	14.5	5.9
	AN	230	226	264	350	226	264	350	452	500	600		112.2/94.2	594/565	340/340				5.9
	AR	460	243	258	300	—	—	—	—	—	—		59.2/47.1	297/283	195/156				3.0
	AS	575	176	186	225	—	—	—	—	—	—		41.3/35.9	245/230	N/A				2.1
120D	AK	200	276	307	400	276	307	400	551	582	700	2	123	650	400	10*	1.5	14.5	5.9
	AN	230	276	307	400	276	307	400	551	582	700		123	594	340				5.9
	AR	460	274	290	350	—	—	—	—	—	—		61	297	195				3.0
	AS	575	197	208	250	—	—	—	—	—	—		44	245	N/A				2.1
130D	AK	200	286	319	450	286	319	450	571	605	700	1 ea.	134.6/121.2	650/754	463/400	10*	1.5	14.5	5.9
	AN	230	271	303	400	271	303	400	542	574	700		129.0/112.2	594/594	340/340				5.9
	AR	460	276	292	350	—	—	—	—	—	—		63.5/59.2	297/297	195/195				3.0
	AS	575	200	212	250	—	—	—	—	—	—		48.0/41.3	245/245	N/A				2.1
140D	AK	200	314	349	450	314	349	450	627	662	800	2	139	754	463	12*	1.5	17.4	5.9
	AN	230	314	349	450	314	349	450	627	662	800		139	594	340				5.9
	AR	460	318	336	400	—	—	—	—	—	—		70.5	297	195				3.0
	AS	575	241	254	300	—	—	—	—	—	—		53.8	245	N/A				2.1

NOTES: RLA - Rated Load Amps at ARI Conditions of Service *Replace (2) 1.5 HP motors with (2) 1 HP motors on units with Low Ambient Option
MCA - Minimum Circuit Ampacity
MFS / HACR - Maximum fuse or HACR breaker size, protective device N/A - Not Available
LRA-XL - Locked Rotor Amps Standard Across the Line Starting
LRA-PW - Locked Rotor Amps Q Option Part Wind Starting

IMPORTANT: See additional notes on pages 66 and 67.

ELECTRICAL DATA: FIELD WIRING (60Hz/3PH)

ACDR-B Model	Nominal Voltage	Standard Field Wiring Data Wire Size Range and Quantity Single / Dual Point Power Source					Optional Field Wiring Wire Size Range and Quantity Single Point Power Source			
		Standard			Optional		Optional		Optional	
		Terminal Block			Unit Mtd. Disc. Swt.		Terminal Block		Unit Mtd. Disc. Swt.	
		Wire			Wire		Wire		Wire	
		Qty	Size Range		Qty	Size range	Qty	Size range	Qty	Size Range
062D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AR	460	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AS	575	1	#12 TO 2 / 0	1	#6 TO 350MCM		N/A		N/A
070D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AR	460	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AS	575	1	#12 TO 2 / 0	1	#6 TO 350MCM		N/A		N/A
075D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AR	460	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AS	575	1	#12 TO 2 / 0	1	#6 TO 350MCM		N/A		N/A
080D	AK	200	2	1 / 0 /TO 600MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AN	230	2	1 / 0 /TO 600MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AR	460	1	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AS	575	1	#6 TO 400MCM	1	#6 TO 350MCM		N/A		N/A
085D	AK	200	2	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AN	230	2	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AR	460	1	1 / 0 /TO 600MCM	1	#6 TO 350MCM		N/A		N/A
	AS	575	1	#4 TO 500MCM	1	#6 TO 350MCM		N/A		N/A
090D	AK	200	2	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AN	230	2	#4 TO 500MCM	2	3 / 0 TO 500MCM		N/A		N/A
	AR	460	1	1 / 0 /TO 600MCM	1	#6 TO 350MCM		N/A		N/A
	AS	575	1	#4 TO 500MCM	1	#6 TO 350MCM		N/A		N/A
100D	AK	200	1	#4 TO 500MCM	1	#6 TO 350MCM	2	1 / 0 /TO 600MCM	2	3/0 TO 500MCM
			1	#4 TO 500MCM	1	#6 TO 350MCM				
	AN	230	1	#4 TO 500MCM	1	#6 TO 350MCM	2	1 / 0 /TO 600MCM	2	3/0 TO 500MCM
			1	#4 TO 500MCM	1	#6 TO 350MCM				
	AR	460	2	1 / 0 /TO 600MCM	1	#6 TO 350MCM		1 / 0 /TO 600MCM		#6 TO 350MCM
102D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 /TO 600MCM	2	3/0 TO 500MCM
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 /TO 600MCM	2	3/0 TO 500MCM
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				
	AR	460	2	1 / 0 /TO 600MCM	2	3 / 0 TO 500MCM		1 / 0 /TO 600MCM		3 / 0 TO 500MCM
112D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 /TO 600MCM	2	3/0 TO 500MCM
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 /TO 600MCM	2	3/0 TO 500MCM
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				
	AR	460	2	1 / 0 /TO 600MCM	2	3 / 0 TO 500MCM		1 / 0 /TO 600MCM		3 / 0 TO 500MCM
120D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 /TO 600MCM	3	#1 TO 500MCM
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 /TO 600MCM	3	#1 TO 500MCM
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				
	AR	460	2	1 / 0 /TO 600MCM	2	3 / 0 TO 500MCM		1 / 0 /TO 600MCM		3 / 0 TO 500MCM
130D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 /TO 600MCM		N/A
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				N/A
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 /TO 600MCM		N/A
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				N/A
	AR	460	2	1 / 0 /TO 600MCM	2	3 / 0 TO 500MCM		1 / 0 /TO 600MCM		3 / 0 TO 500MCM
140D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	#4 TO 500MCM		N/A
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				N/A
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	#4 TO 500MCM		N/A
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM				N/A
	AR	460	2	1 / 0 /TO 600MCM	2	3 / 0 TO 500MCM		1 / 0 /TO 600MCM		3 / 0 TO 500MCM

N/A = Not Available

- NOTE:
1. Single point power is standard for all voltages listed on ACDR-B 021-090.
 2. Dual point power is standard for 200 and 230 volt ACDR-B 100-200.
 3. Single point power is standard for 460 and 575 volt ACDR-B 021-200.

ELECTRICAL DATA: (60Hz/3PH)

ACDR-B Model	Nom. Volts	Unit						Unit			Each Compressor				Condenser Fan Motors				
		Circ. #1			Circ. #2			Option Single Point Power			Qty/Circ.	RLA	LRA-XL	LRA-PW	Qty	HP	Total kW	FLA Each	
		RLA	MCA	MFS/HACR	RLA	MCA	MFS/HACR	RLA	MCS	MFS/HACR									
155D	AK	200	332	373	500	332	373	500	664	705	800	1 ea.	134.6/162	754/1070	463/654	12*	1.5	17.4	5.9
	AN	230	325	365	500	325	365	500	649	690	800		126.9/162	594/1070	340/654				
	AR	460	341	364	450	—	—	—	—	—	—		63.5/89	297/535	195/330				
	AS	575	264	281	350	—	—	—	—	—	—		48.0/71	245/405	NA				
170D	AK	200	392	436	600	392	436	600	783	828	1000	2	178	1070	654	12*	1.5	17.4	5.9
	AN	230	392	436	600	392	436	600	783	828	1000		178	1070	654				
	AR	460	392	415	500	—	—	—	—	—	—		89	535	330				
	AS	575	314	332	400	—	—	—	—	—	—		72	405	NA				
180D	AK	200	405	455	600	405	455	600	809	859	1000	1 ea.	162/201	1070/1070	654/654	14*	1.5	20.3	5.9
	AN	230	405	455	600	405	455	600	809	859	1000		162/201	1070/1070	654/654				
	AR	460	460	488	600	—	—	—	—	—	—		97/112	535/535	330/330				
	AS	575	310	328	400	—	—	—	—	—	—		67/73	405/405	NA				
185D	AK	200	405	455	600	405	455	600	809	859	1000	1 ea.	162/201	1070/1070	654/654	14*	1.5	20.3	5.9
	AN	230	405	455	600	405	455	600	809	859	1000		162/201	1070/1070	654/654				
	AR	460	460	488	600	—	—	—	—	—	—		97/112	535/535	330/330				
	AS	575	310	328	400	—	—	—	—	—	—		67/73	405/405	N/A				
190D	AK	200	470	523	700	470	523	700	939	993	1200	2	214	1070	654	14*	1.5	20.3	5.9
	AN	230	470	523	700	470	523	700	939	993	1200		214	1070	654				
	AR	460	482	510	600	—	—	—	—	—	—		110	535	330				
	AS	575	318	336	400	—	—	—	—	—	—		72	405	N/A				
200D	AK	200	470	523	700	470	523	700	939	993	1200	2	214	1070	654	14*	1.5	20.3	5.9
	AN	230	470	523	700	470	523	700	939	993	1200		214	1070	654				
	AR	460	482	510	600	—	—	—	—	—	—		110	535	330				
	AS	575	318	336	400	—	—	—	—	—	—		72	405	N/A				

NOTES: RLA - Rated Load Amps at ARI Conditions of Service *Replace (2) 1.5 HP motors with (2) 1 HP motors on units with Low Ambient Option
MCA - Minimum Circuit Ampacity
MFS / HACR - Maximum fuse or HACR breaker size, protective device N/A - Not Available
LRA-XL - Locked Rotor Amps Standard Across the Line Starting
LRA-PW - Locked Rotor Amps Q Option Part Wind Starting

General Electrical Notes

1. Main power must be supplied from a single or dual power source field-supplied fused disconnect(s) using dual element time delay fuses. Unit models 100D thru 200D using 200 or 230 volt power require two separate power sources (dual power sources). Power supply is three phase unless otherwise shown.
2. The maximum incoming wire size is 500 mcm. On units having a MCA greater than 500 mcm wire, the factory-supplied field power terminal block will accept two parallel field wires per pole.
3. Compressor starting is XL or PWS only.
4. Control circuit power (115VAC) must be field-supplied from a separate field-mounted fused disconnect (15 amp max. fuse size) unless the factory-mounted and wired control transformer option is ordered.
5. Cooler heater power (115 VAC) must be field-supplied from a separate field-mounted fused disconnect (15 amp max. fuse size).

TABLE 66A COOLER HEATER

UNIT MODELS					
Standard Cooler	CH1 - Optional 42°F (5.5°C) Cooler	CH2 - Optional 40°F (4.5°C) Cooler	Qty.	Watts	FLA Ea.
021S, 024S, 027S, 030S, 035S, 030D, 035D		027S	1	280	2.3
040D, 045D, 050D, 052D, 055D, 062D, 070D	035D	030S, 035S, 030D, 035D, 040D	1	420	3.5
120D, 130D, 140	112D	085D			
075D, 080D, 085D, 090D, 100D, 102D, 112D	090D	045D, 050D,	1	560	4.7
155D, 170D, 180D, 185D, 190D, 200D		062D, 070D, 075D, 080D, 090D, 100D, 102D, 112D, 120D, 130D, 140D, 155D, 170D, 180D, 185D, 190D, 200D	2	560	4.7

ELECTRICAL DATA: FIELD WIRING (60Hz/3PH)

ACDR-B Model	Nominal Voltage	Standard Field Wiring Data Wire Size Range and Quantity Single / Dual Point Power Source				Optional Field Wiring Wire Size Range and Quantity Single Point Power Source			
		Standard		Optional		Optional		Optional	
		Terminal Block		Unit Mtd. Disc. Swt.		Terminal Block		Unit Mtd. Disc. Swt.	
		Wire		Wire		Wire		Wire	
		Qty	Size Range	Qty	Size range	Qty	Size range	Qty	Size Range
155D	AK	200	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	#4 TO 500MCM	N/A
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM			N/A
	AN	230	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	#4 TO 500MCM	N/A
			1	#4 TO 500MCM	2	3 / 0 TO 500MCM			N/A
	AR	460	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	2
AS	575	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	2	3 / 0 TO 500MCM
170D	AK	200	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AN	230	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AR	460	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	2
AS	575	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	2	3 / 0 TO 500MCM
180D	AK	200	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AN	230	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AR	460	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	#4 TO 500MCM	2
AS	575	1	#4 TO 500MCM		3 / 0 TO 500MCM	1	#4 TO 500MCM	2	3 / 0 TO 500MCM
185D	AK	200	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AN	230	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AR	460	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	#4 TO 500MCM	2
AS	575	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	2	3 / 0 TO 500MCM
190D	AK	200	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AN	230	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AR	460	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	#4 TO 500MCM	2
AS	575	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	2	3 / 0 TO 500MCM
200D	AK	200	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AN	230	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	1 / 0 TO 600MCM	N/A
			2	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	N/A
	AR	460	2	#4 TO 500MCM	2	3 / 0 TO 500MCM	2	#4 TO 500MCM	2
AS	575	1	#4 TO 500MCM	2	3 / 0 TO 500MCM	1	#4 TO 500MCM	2	3 / 0 TO 500MCM

N/A = Not Available

- NOTE: 1. Dual point power is standard for 200 and 230 volt ACDR-B 100-200.
2. Single point power is standard for 460 and 575 volt ACDR-B 021-200.

- Crankcase heaters are wired in the control circuit. On units with field-supplied control circuit power, the 15 amp fused disconnect switch must be closed (on) at all times for heater operation. **On units ordered with the control transformer option, the main unit power field fused disconnect (and local safety switch if used) must be closed (on) at all times for heater operation.**
- The compressor crankcase heaters must be energized for 24 hours before the unit is initially started or after a prolonged open disconnect.
- All field wiring must be in accordance with all applicable local and national codes.
- Minimum and maximum unit supply voltages are shown in the following tabulated data.


TABLE 67A CRANKCASE HEATER

UNIT MODELS	Qty.	Watts	FLA Each
021S, 024S, 027S, 030S	1	100	.8
035S	1	200	1.6
030D, 035D, 040D, 045D, 050D, 052D, 055D, 062D	2	100	.8
070D, 075D, 080D	2	200	1.6
085D, 090D, 100D, 102D, 112D, 120D	4	100	.8
130D	2	100	.8
	2	200	1.6
140D, 155D, 170D, 180D, 185D, 190D, 195D, 200D	4	200	1.6


Supply Voltage

Nominal	Minimum	Maximum
200V	187V	220V
230V	207V	253V
460V	414V	506V
575V	518V	632V


TYPICAL POWER WIRING DIAGRAM (TWO COMPRESSOR MODEL) •••••

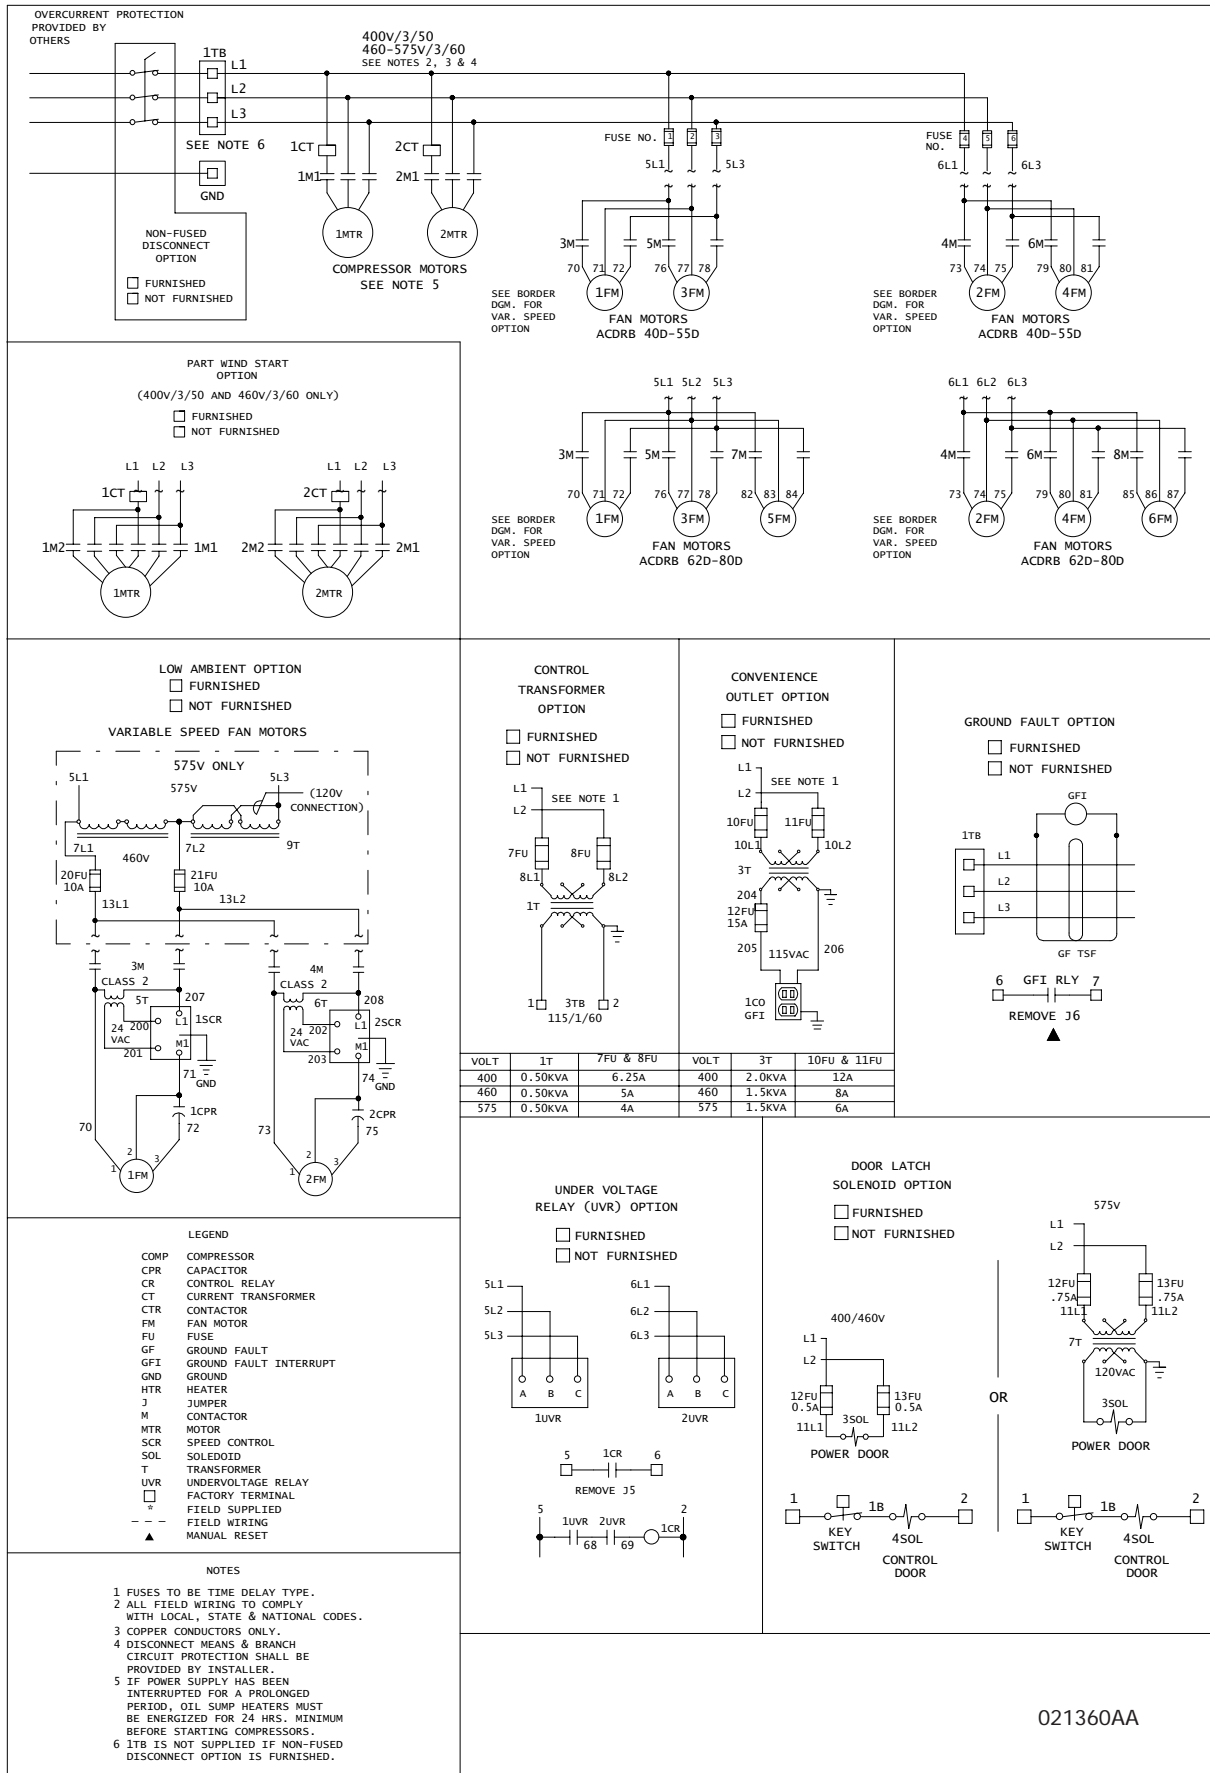

TYPICAL CONTROL WIRING DIAGRAM (TWO COMPRESSOR MODEL) ••••

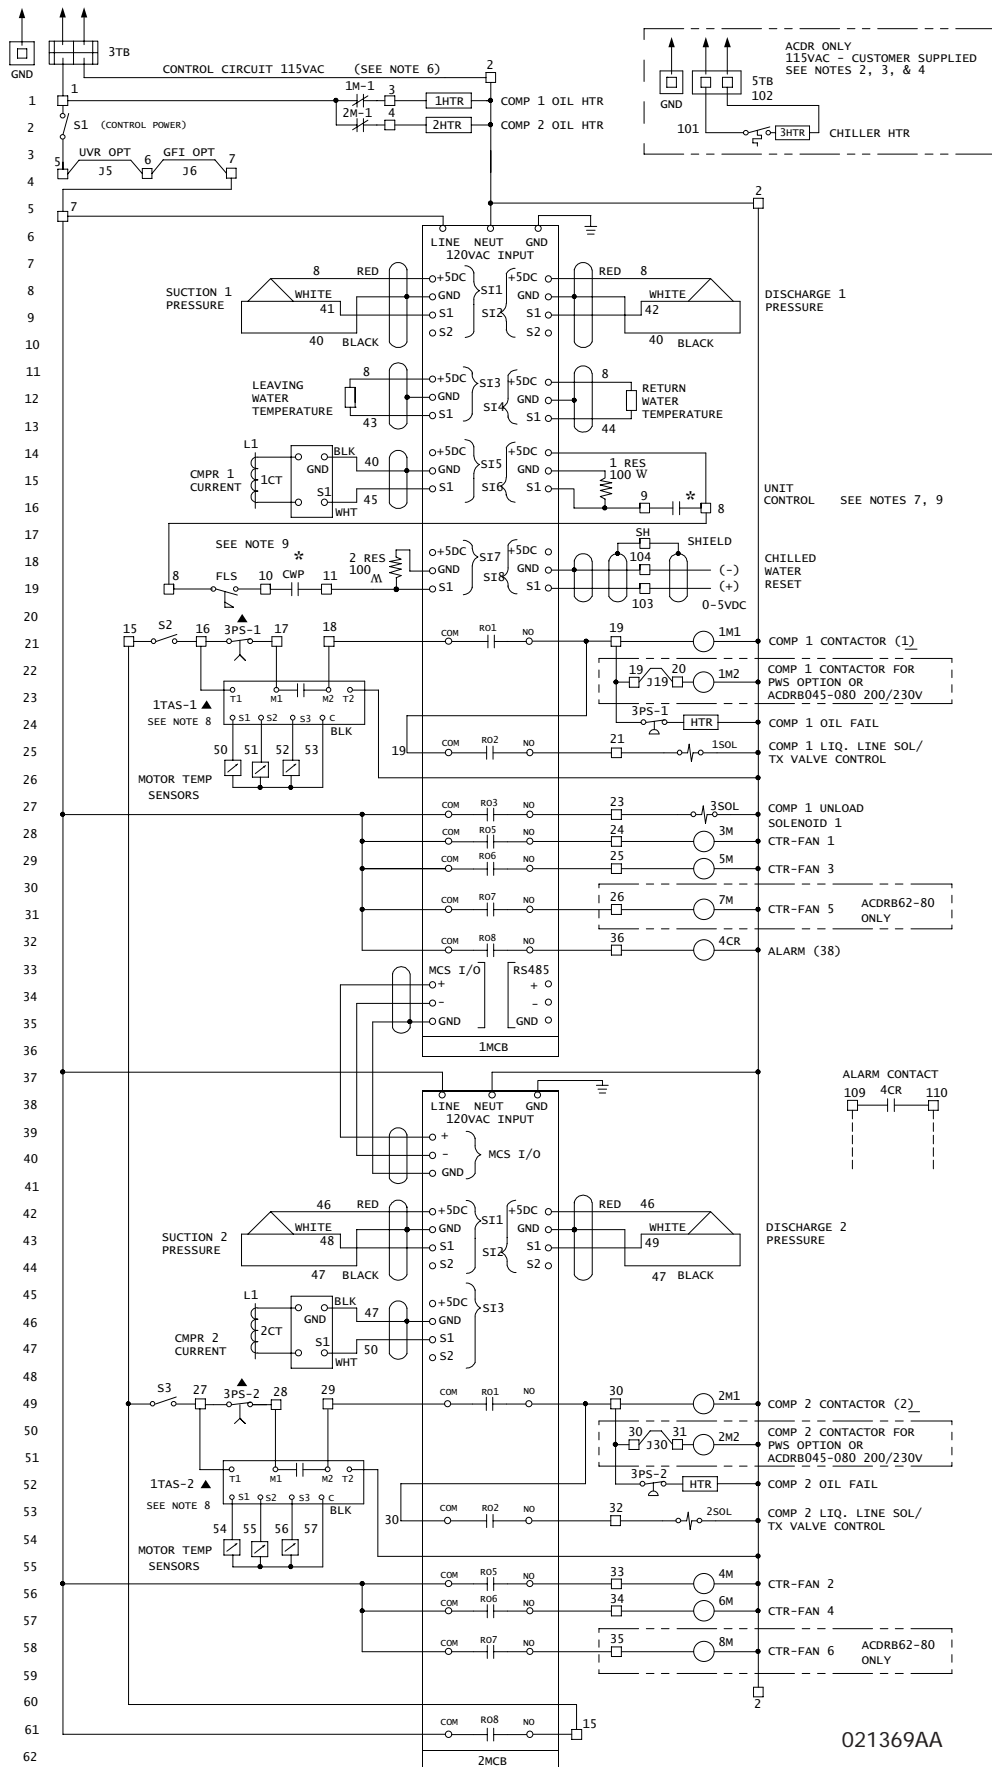

TYPICAL CONTROL WIRING DIAGRAM (TWO COMPRESSOR MODEL) ••••

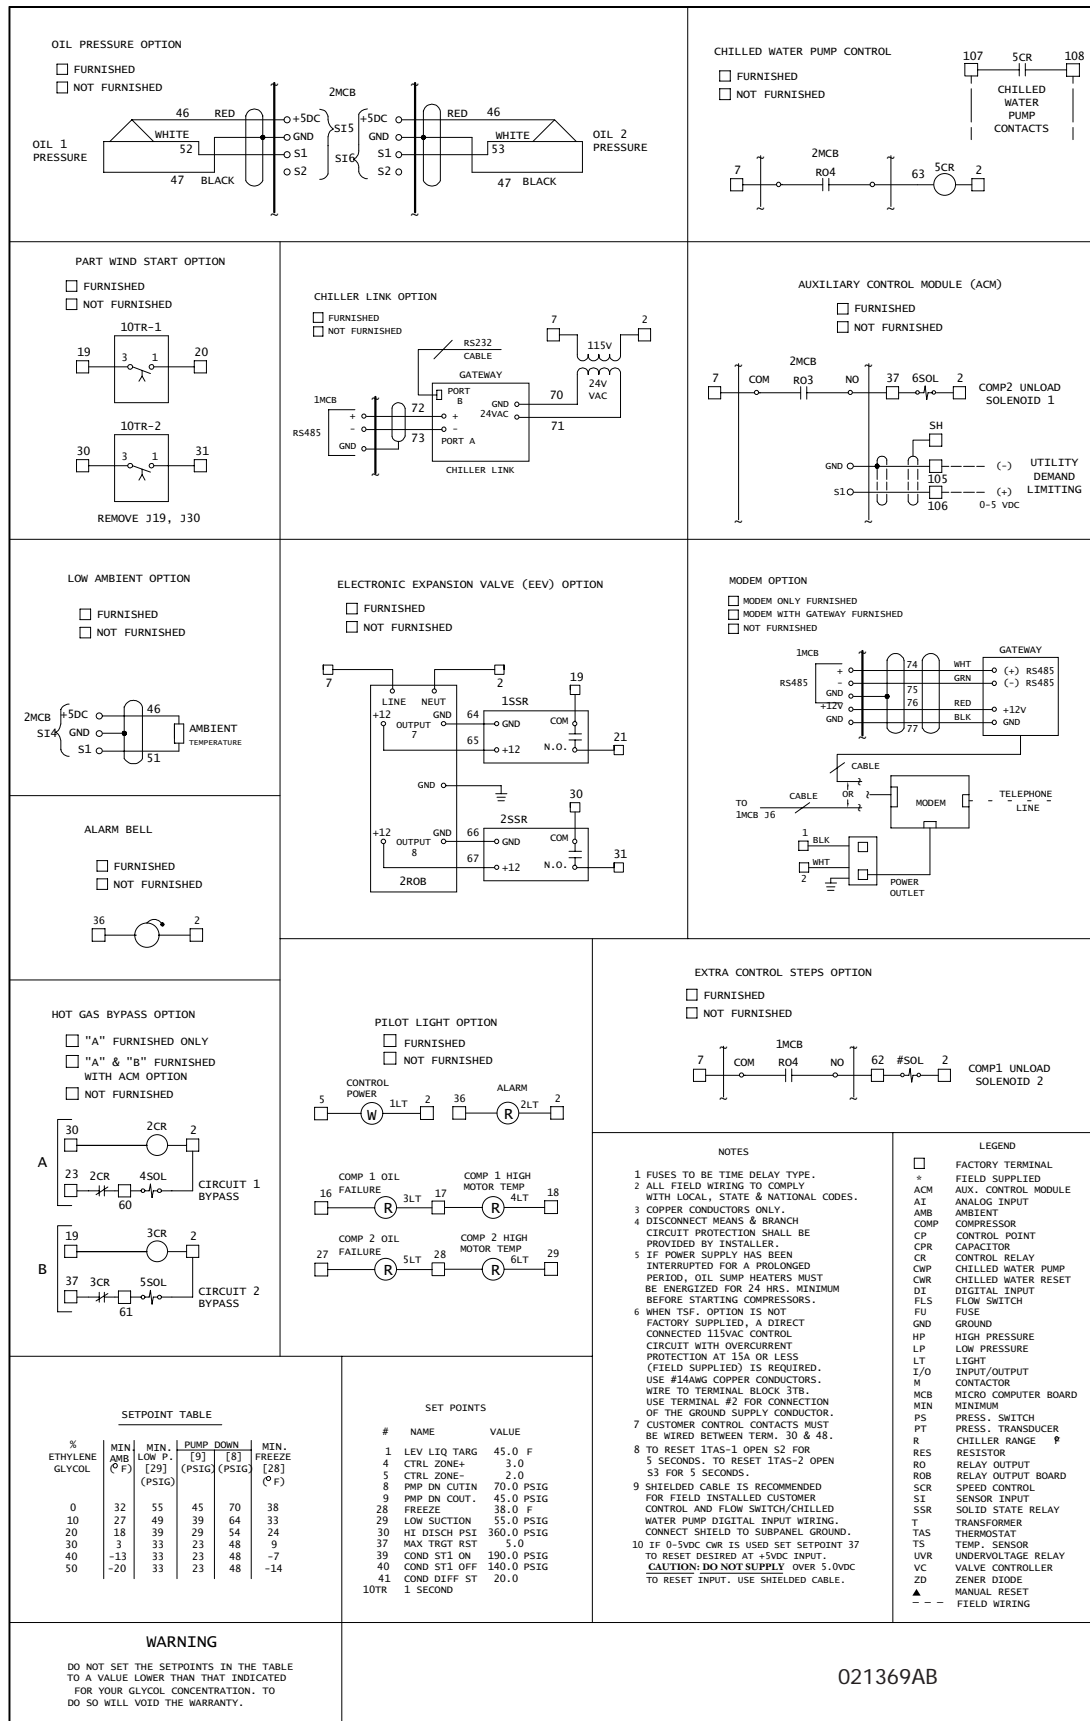

PART LOAD INFORMATION

STANDARD

TABLE 72

ACDR-B Model		Capacity Control Steps (Expressed in %)			
		% Step	% Step	% Step	% Step
021SZB	% CAP	100	62	—	—
	% kW	100	51	—	—
024SZB	% CAP	100	62	—	—
	% kW	100	52	—	—
027SZB	% CAP	100	79	47	—
	% kW	100	70	33	—
030SZB	% CAP	100	79	47	—
	% kW	100	71	35	—
035SZB	% CAP	100	78	46	—
	% kW	100	70	34	—
030DZB	% CAP	100	83	57	34
	% kW	100	74	41	21
035DZB	% CAP	100	83	56	34
	% kW	100	74	41	22
040DZB	% CAP	100	82	56	33
	% kW	100	75	41	21
045DZB	% CAP	100	84	50	29
	% kW	100	79	34	18
050DZB	% CAP	100	83	53	32
	% kW	100	76	39	21
052DZB	% CAP	100	90	56	40
	% kW	100	85	42	32
055DZB	% CAP	100	90	59	42
	% kW	100	84	46	36
062DZB	% CAP	100	90	56	37
	% kW	100	85	41	34
070DZB	% CAP	100	90	56	42
	% kW	100	85	41	30
075DZB	% CAP	100	90	53	35
	% kW	100	87	37	30
080DZB	% CAP	100	85	56	32
	% kW	100	80	41	30
085DZB	% CAP	100	83	56	30
	% kW	100	74	41	24
090DZB	% CAP	100	85	56	36
	% kW	100	75	42	22
100DZB	% CAP	100	84	56	34
	% kW	100	72	42	20
102DZB	% CAP	100	82	56	27
	% kW	100	71	42	23
112DZB	% CAP	100	84	56	34
	% kW	100	74	42	22
120DZB	% CAP	100	82	56	31
	% kW	100	71	42	20
130DZB	% CAP	100	83	56	33
	% kW	100	72	41	21
140DZB	% CAP	100	82	56	31
	% kW	100	71	41	20
155DZB	% CAP	100	80	56	29
	% kW	100	68	41	18
170DZB	% CAP	100	82	56	29
	% kW	100	70	41	20
180DZB	% CAP	100	80	56	27
	% kW	100	68	42	18
185DZB	% CAP	100	80	56	26
	% kW	100	67	42	18
190DZB	% CAP	100	82	56	31
	% kW	100	71	42	20
200DZB	% CAP	100	82	56	31
	% kW	100	71	42	20

- (1) Performance shown includes compressor(s) and fans per ARI 550/590-98.
- (2) EER @ part load step = (% CAP ÷ % kW) x full load EER from rating tables
- (3) IPLV shown per ARI 550/590-98 at 100, 75, 50 & 25% load
- (4) Consult rating tables for 100% CAP & kW data

PART LOAD INFORMATION

OPTIONAL

TABLE 73

ACDR-B Model		Capacity Control Steps (Expressed in %)							
		% Step	% Step	% Step	% Step	% Step	% Step	% Step	% Step
021SZB	% CAP	—	—	—	—	—	—	—	—
	% kW	—	—	—	—	—	—	—	—
024SZB	% CAP	—	—	—	—	—	—	—	—
	% kW	—	—	—	—	—	—	—	—
027SZB	% CAP	—	—	—	—	—	—	—	—
	% kW	—	—	—	—	—	—	—	—
030SZB	% CAP	—	—	—	—	—	—	—	—
	% kW	—	—	—	—	—	—	—	—
035SZB	% CAP	—	—	—	—	—	—	—	—
	% kW	—	—	—	—	—	—	—	—
030DZB	% CAP	—	—	—	—	—	—	—	—
	% kW	—	—	—	—	—	—	—	—
035DZB	% CAP	—	—	—	—	—	—	—	—
	% kW	—	—	—	—	—	—	—	—
040DZB	% CAP	—	—	—	—	—	—	—	—
	% kW	—	—	—	—	—	—	—	—
045DZB	% CAP	100	89	72	50	29	—	—	—
	% kW	100	83	62	34	18	—	—	—
050DZB	% CAP	100	89	71	53	32	—	—	—
	% kW	100	85	61	39	21	—	—	—
052DZB	% CAP	100	90	76	56	40	24	—	—
	% kW	100	85	66	42	32	15	—	—
055DZB	% CAP	100	90	75	59	42	26	—	—
	% kW	100	84	62	46	36	17	—	—
062DZB	% CAP	100	90	75	56	37	24	—	—
	% kW	100	85	66	41	34	16	—	—
070DZB	% CAP	100	90	76	56	42	24	—	—
	% kW	100	85	66	41	30	16	—	—
075DZB	% CAP	100	90	77	53	35	22	—	—
	% kW	100	87	68	37	30	14	—	—
080DZB	% CAP	100	93	85	56	45	32	—	—
	% kW	100	87	80	41	31	30	—	—
085DZB	% CAP	100	91	83	74	56	42	30	18
	% kW	100	87	74	61	41	32	24	12
090DZB	% CAP	100	94	85	79	56	48	36	24
	% kW	100	92	75	67	42	35	22	18
100DZB	% CAP	100	95	84	78	56	50	34	22
	% kW	100	93	72	65	42	35	20	17
102DZB	% CAP	100	95	82	77	56	50	27	21
	% kW	100	93	71	64	42	36	23	16
112DZB	% CAP	100	95	84	78	56	49	34	22
	% kW	100	93	74	66	42	35	22	18
120DZB	% CAP	100	95	82	77	56	50	31	20
	% kW	100	93	71	63	42	35	20	17
130DZB	% CAP	100	95	83	78	56	50	33	21
	% kW	100	92	72	64	41	35	21	18
140DZB	% CAP	100	95	82	77	56	50	31	19
	% kW	100	93	71	64	41	35	20	17
155DZB	% CAP	100	96	80	75	56	50	29	18
	% kW	100	94	68	62	41	35	18	15
170DZB	% CAP	100	93	82	74	56	45	29	16
	% kW	100	90	70	60	41	34	20	15
180DZB	% CAP	100	93	80	72	56	47	27	15
	% kW	100	92	68	59	42	35	18	14
185DZB	% CAP	100	93	80	72	56	46	26	14
	% kW	100	91	67	58	42	35	18	13
190DZB	% CAP	100	93	82	74	56	45	31	18
	% kW	100	91	71	62	42	35	20	14
200DZB	% CAP	100	93	82	74	56	47	31	18
	% kW	100	90	71	61	42	34	20	13

- (1) Performance shown includes compressor(s) and fans per 550/590-98.
- (2) $EER @ \text{part load step} = (\% \text{ CAP} \div \% \text{ kW}) \times \text{full load EER from rating tables}$
- (3) IPLV shown per ARI 590 at 100, 75, 50 & 25% load
- (4) Consult rating tables for 100% CAP & kW data

- B. The start-up date shall be certified by the Mechanical Contractor, and provided to the Manufacturer, Engineer and Owner.
- C. (Provide an optional extended four- (4) year warranty on the compressors only, 5 years total).
- D. (During the warranty period, the equipment supplier shall furnish the services of an authorized service agency for all labor associated with parts replacement or repair, and start-up of the refrigeration equipment at the beginning of each cooling season. The equipment supplier shall also furnish the services of an authorized service agent for one maintenance visit during winter months of operation, such times shall be designated by the Owner.)

1.09 Maintenance

Maintenance of the chillers shall be the responsibility of the owner and performed in accordance with the manufacturer's instructions.

Part 2: Products

2.01 Reciprocating Air Cooled Water Chillers

2.02 Acceptable Manufacturers

- A. Dunham-Bush, Inc.
- B. (Approved equal)

2.03 General

- A. Furnish and install as shown on the plans, air-cooled reciprocating compressor water chillers. Units shall be Dunham-Bush Model ACDR-B or equal.
- B. The units are to be completely factory assembled and wired in a single package complete with reciprocating compressor, evaporator, condenser, starting control with safety and operating controls. The unit is to be given a complete factory operating and control sequence test under load conditions and is to be shipped with full operating charge of R-22 and full oil charge.
- C. The units shall be built in accordance with all applicable national and local codes including the ANSI safety code; the National Electrical Code and applicable ASME Code for Unfired Pressure Vessels.

2.04 Performance

The units shall be furnished as shown on capacity schedules and drawings. Unit performance shall be in accordance with ARI Standard 590.

2.05 Construction

The unit will be designed for maximum corrosion protection being of heavy gauge, UL90 approved galvanized steel construction. The base and legs shall be manufactured of 10 gauge galvanized steel channel. Frame members are constructed of 12 gauge, galvanized steel.

2.06 Evaporator

Evaporator shall be direct expansion, shell and tube type. The shell shall be fabricated from carbon steel, with enhanced inner fin construction inside seamless copper tubes. The tube sheets shall be heavy gauge copper in welded head vessels, or heavy carbon plate steel in removable head vessels. The tubes shall be roller-expanded or brazed into the tubesheets. Water control baffles shall be copper or cold-rolled steel. The heads shall be constructed of carbon steel. Evaporators shall be designed, constructed and inspected to comply with current ASME code for unfired pressure vessels. Shell side (water) design working pressure shall be minimum 200 PSIG and tube side (refrigerant) design working pressure shall be minimum 250 PSIG for removable head vessels and 300 PSIG for welded head vessels. A thermostatically controlled electric resistance heater cable shall be wrapped around the shell to prevent freezing down to -20°F outdoor temperature.

2.07 Condenser

The condenser coil is to be constructed of copper tubes and die formed aluminum fins having self-spacing collars. Fins shall be mechanically bonded to the tubes. An integral sub-cooling loop shall be incorporated into the coil. Condenser divider baffles shall fully separate each condenser fan section to control the airflow to maintain proper head pressure control.

2.08 Fans

The fans shall be heavy duty, aluminum blade, direct drive propeller type. Motors shall be three phase with internal overloads and are to be permanently lubricated.

2.09 Compressor

- A. The reciprocating compressors shall be of the serviceable semi-hermetic type. All compressors shall be 1750 RPM direct drive with an integral two-pole hermetic squirrel cage motor. A dust-proof terminal box, located in an accessible location on the compressor, shall contain all connection terminals.

- B. The compressors shall be fitted with a crankcase heater, large suction filter, oil sight glass, oil strainer and magnetic crankcase plug. The lubrication system shall include a forced feed, positive displacement, reversible oil pump with internal oil equalization.
- C. To maximize reliability, the compressors shall utilize across-the-line start and, to limit start-up current draw, be limited to a maximum of ___ HP with a time delay between compressor starts.

2.10 Capacity Control

A combination of cylinder unloading and/or compressor cycling shall be utilized to match the demand requirement of the system. A Proactive Full Function PC Windows® Based Microcomputer Controller shall unload or cycle compressors in response to leaving water temperature and maintain water temperature within 1.2°F of setpoint. This system is to provide precise and stable control of supply water temperature over the complete range of operating conditions. It shall be capable of a system capacity range from 100% to ___% at specified conditions without hot gas bypass.

2.11 Refrigerant Circuit

- A. (Single compressor) (Multiple compressors) shall be used with a direct expansion evaporator.
- B. The packaged chiller shall have independent refrigerant circuits up through 80 nominal tons.
- C. The packaged chiller shall have no more than two compressors per refrigerant circuit.
- D. The packaged chiller shall use HCFC-22 refrigerant, a positive pressure refrigerant that will not require a purge system and is recommended by the Montreal Protocol as an environmentally safe refrigerant.
- E. Insulate evaporator and other cold surfaces as required to prevent condensation at ambient conditions of 75% humidity of 90°F wet bulb with no air movement.
- F. Each refrigerant circuit shall include expansion valve, sight glass, moisture indicator, solenoid valve, replaceable core filter-drier, liquid line shut off valves, charging and gauge connections.

2.12 Control Center

- A. **Control Center** shall be fully enclosed in a steel, baked powder coated, control panel with hinged access doors. Dual compartments, separating safety and operating controls from the power controls, are to be provided. Controls shall include:
 1. Compressor, solid state, thermal sensing overloads, manual reset
 2. High refrigerant discharge temperature, manual reset
 3. Separate power terminal blocks for main power, 115vAC control power and 115vAC chiller heater power
 4. Compressor starter including current sensing overload protection
 5. Proactive Full Function PC Windows® Based Microcomputer Controller with factory installed sensors including integral anti-recycle protection
 6. Complete labeling of all control components
 7. Numbered terminal strips and labeled components for easier wire tracing
 8. Condenser pressure sensing fan cycling control for start-up and operation down to 30°F.
 9. (Undervoltage and phase failure protection against low voltage, phase imbalance or phase reversal).
 10. (Operating and safety lights visible from unit exterior including:)
 - a. Power on
 - b. Individual compressor operation
 - c. Safety failure for each refrigerant circuit
 11. (Control panel solenoid door latch to prevent door opening before turning off power to the unit).
 12. (Electronic expansion valves which shall be controlled by the microcomputer.)
- B. **Control Center's** individual Full Function PC Windows® Based Microcomputer shall provide compressor staging based on leaving water temperature. It shall have two lines of 16 large characters each Alpha-Numeric Liquid Crystal display, and the inputs shall be through a 16 single function keypad through the Windows® based, menu driven prompts. The displayed data shall be updated once per second and the microcomputer shall have a Non-Volatile memory used for all control information. The microcomputer shall have an extended operating range of -20°F to +158°F (-29 to +70°C). (It shall be proactive in control and accommodate system anomalies such as high condenser temperature and high entering water temperature by controlling loading and refrigerant flow to keep the machine on line but at reduced capacity until the condition is corrected.)
- C. **Microcomputer** individual chiller controller shall provide as a minimum the following features and options.
 1. **Microcomputer - Unit Control** shall provide the following capabilities:
 - a. Power control relay with start-up control sequence
 - b. Staging of compressors, hot gas bypass and unloader(s) to achieve precise control of leaving liquid
 - c. Activating fans of the air-cooled package to control head pressure

- d. 7 day time clock with schedules for machine control
 - e. Automatic pump down with proactive cycle detection to eliminate excessive compressor cycling
 - f. Proactive control of unloader and /or hot gas bypass to help prevent high pressure or low pressure trips
 - g. Proactive control providing safeties for high pressure, low pressure and freeze protection, to eliminate nuisance trips
 - h. Proactive loading & unloading to eliminate overloading during start-up to reduce compressor cycling
 - i. Continuous evaluation of sensors
 - j. (Control of Hot Gas bypass on circuit #1)
2. **Microcomputer - Unit Protection** shall provide the following:
- a. Low pressure cutout with adjustable time parameters & Proactive safety
 - b. High pressure cutout with adjustable time parameters & Proactive safety
 - c. Automatic re-start from power outage with event posting
 - d. Battery backed-up real time clock and memory with over 10 years life and automatic recharge of lithium ion battery that requires no service.
 - e. Safeties for temporary shutdown as well as lockout protection that requires manual reset
 - f. Freeze protection on leaving chilled water temperature
 - g. Anti-recycle timing
 - h. Sensor error
 - i. Pump down failure
 - j. (Proactive Oil Pressure Safety for compressor protection with time and pressure parameters)
 - k. (Chilled water pump control system with both safety or lockout ability)
3. **Microcomputer - Readouts** shall provide the following:
- a. Sensor inputs
 - b. Leaving liquid temperature
 - c. Entering liquid temperature
 - d. Compressor ampere draw
 - e. Suction pressure each circuit
 - f. Discharge pressure each compressor
 - g. Unit control contacts
 - h. Water flow switch
 - i. Chilled liquid reset
 - j. Digital Outputs
 - k. Compressor control status
 - l. Unloader control status
 - m. Liquid line solenoid control status
 - n. Condenser fan control status
 - o. Alarm control status
 - p. Control power status
 - q. (Compressor oil pressure safety each compressor)
 - r. (Low ambient temperature)
 - s. (Utility demand limit)
 - t. (Chilled water pump control)
 - u. (Electronic expansion valve)
4. **Microcomputer - Setpoints** shall provide the following:
- a. High discharge pressure
 - b. Low suction pressure
 - c. Freeze protect temperature
 - d. Leaving liquid temperature
 - e. Control zone settings
 - f. Fan condenser control
 - g. Pump down settings
 - h. High & low compressor amperes
 - i. Low suction unload
 - j. High discharge unload
 - k. Anti-recycle delay setting
 - l. (Compressor oil safety settings)
5. **Microcomputer - Alarm History** shall provide the following:
- a. The 32 most recent alarms can be added and identified
 - b. Low suction pressure of all circuits
 - c. High discharge pressure of all circuits
 - d. Freeze protection cutout
 - e. Pump down failure of all circuits

- f. External shutdown of each compressor
 - g. Communication failure
 - h. Battery failure
 - i. Time/date invalid
 - j. Memory failure
 - k. Power failure
 - l. (Low compressor oil differential pressure)
6. **Microcomputer Remote Monitoring Capabilities** - shall include a complete Full Function Windows® based communication system through the following means:
- a. **PC Connection** - shall provide communications to a 3.1 or higher level Windows® based Personal Computer, or BMS (Building Automation System) to provide, as a minimum, the following:
 - 1. Dynamic system data update of all outputs, inputs, control states, and alarms
 - 2. Complete History Storage of all data needed for both Static and Dynamic graphing
 - 3. Multiple Authorization Code Levels based on operator or full service authorization for modification of setpoints and manual status
 - 4. Capability of up to 20 Chiller Packages networked together via RS485 (up to 6000 feet)
 - b. **(Remote Mounted-Stand Alone Control Terminal** - shall communicate and control a single unit, or network of up to twenty (20) units in a network, from a remote location up to 6000 feet away. The RS485 communications port shall be wired with a 3 wire shielded cable for up to the 6000 feet away from the chiller, or 100 feet away through the RS232 communication system via a (4) wire shielded cable).
 - 1. This option utilizes a duplicate display and keypad Control Terminal, similar to the one that shall be installed in the packaged chiller, or chiller network, and shall provide a full function operating terminal as well as a remote alarm function.
 - 2. This remote Control Terminal must be in addition to the unit mounted controller, so the unit can be fully serviced locally, without using the Remote Control Terminal that may be as much as 6000 feet away.
 - 3. The remote communications shall be accomplished through the RS485 high speed communications system up to 6000 feet away, or the RS232 communication system up to 100 feet away.
 - c. **(Telephone Modem** - for extended distance communications to a remote BMS System, a remote PC Computer or a Remote Mounted Stand Alone Control Terminal through the telephone system.)
 - 1. A 14400 baud modem shall be connected directly to the RS232 port on the microcomputer.
 - 2. The Modem Option shall be capable of operating a network of up to 20 units in the network, connected via the RS485 port high speed communication system and a GATEWAY card, then connected through the modem for extended network communications via the telephone system.
 - d. **(Communications to a Building Management System (BMS)** - shall be connected to the packaged chiller (or chiller network system) as follows for remote communication:
 - 1. (A modem shall be connected to the RS232 communication port for long distance communication through the telephone system, and a translator must be provided for communication with the Building Management System.)
 - 2. (The RS232 communication system shall be used for connection up to 100 feet away from the chiller (or chiller network) when connected by a 4 wire shielded cable, and a translator must be supplied for communication with the Building Management System.)
 - 3. (The RS485 high speed communication system shall be connected up to 6000 feet away from the packaged chiller (or chiller network) when connected with a 3 wire shielded cable, and a translator must be supplied for communication with the Building Management System.)
 - e. **(Chiller Link Translator** - shall be supplied for communication from the Chiller (or Chiller Network) to the BMS (Building Management System) through BACnet or MODBUS communicating systems).

2.13 Starting Equipment

- A. Unit mounted contactors with compressor motor module protection for each compressor.
- B. Five (5) minute anti-recycle timer
- C. (Non-fused disconnect switch with through-the-door interlocking handle.)
- D. (Unit mounted power transformer to provide 115 VAC control power.)
- E. (Part Wind Start or multiple small horsepower compressors for reduced inrush starting.)
- F. (Ground fault interrupter.)

2.14 Additional Equipment

- A. (Copper Fin/Copper Tube condenser coil.)
- B. (Silicone polyester Poly-Coat condenser fin coating per ASME B117 specification for maximum salt spray and corrosion resistance.)

- C. (Convenience Outlet 115 volt AC powered dual 3 prong ground fault receptacle powered by dedicated transformer and fused for 15 amps.)
- D. (Hot gas bypass valve to permit operation down to 50% of unit mechanical unloading capability.)
- E. (Low ambient control to 0°F (-17.8°C) minimum starting ambient.)
- F. (Extra low ambient control to -20°C) minimum starting ambient.)
- G. (Low ambient lock-out control requiring a field setpoint.)
- H. (Oil pressure reading through the microcomputer.)
- I. (Gauges include suction, discharge and oil pressure for each refrigerant circuit in addition to the readings through the microcomputer.)
- J. (Steel Painted Louvers for complete unit enclosure for general mechanical security and unit aesthetics.)
- K. (Aluminum Painted Grills similar to louvers except manufactured or aluminum with 3/8" x 3 1/2" slots instead of louvers for hail damage protection and unit aesthetics.)
- L. (Fin Guards Top only (1" x 4" wire mesh) for vertical side condenser coil protection.)
- M. (Fin Guards Bottom only (1" x 4" wire mesh) for general unit mechanical security for the lower portion of the unit.)
- N. (Over and under voltage protection relay protects against high and low incoming voltage conditions as well as single phasing, phase reversal and phase imbalance.)
- O. (Circuit Breakers to provide branch circuit protection.)
- P. (Weatherproof Alarm Bell mounted and wired to indicate a common alarm fault.)
- Q. (Fully Painted Unit meets the requirements for outdoor unit application of 500 Hour Salt Spray Paint tested in accordance with ASTM-B-117.)
- R. (Suction Line Insulation for medium and low temperature applications, or where the relative humidity is above 75% with ambient temperature of 90°F (32°C) wet bulb.)
- S. (Chilled Water Pump Control providing a contact closure for pump starting prior to starting the chiller.)
- T. (*Mounted and Wired Water Flow Switch*)
- U. (Auxiliary Control Module providing auto circuit lead-lag where applicable, utility demand limiting (requires an external 0 to 5 volt DC signal), load limiting by compressor over current protection, high and low pressure limiting.)

Part 3: Execution

3.01 Installation Work By Mechanical Contractor

- A. Install on a flat surface level within 1/16 inch and of sufficient strength to support concentrated loading. Place vibration isolators under the unit.
- B. Assemble and install all components furnished loose by manufacturer as recommended by the manufacturer's literature.
- C. Complete all water and electrical connections so unit, water circuits and electrical circuits are serviceable.
- D. Provide and install valves in water piping upstream and downstream of the evaporator water boxes to provide means of isolating shells for maintenance and to balance and trim system.
- E. Provide soft sound and vibration eliminator connections to the cooler water inlet and outlet as well as electrical connections to the unit.
- F. Interlock chillers through a flow switch in the chilled water line to the chilled water pump to ensure the unit can operate only when water flow is established.
- G. Furnish and install taps for thermometers and pressure gauges in water piping adjacent to inlet and outlet connections of the evaporator.
- H. Provide and install drain valves with capped hose ends to each water box.
- I. Install vent cocks to each water box.
- J. Provide a separate 115 volt electrical service to power the cooler heater for winter freeze protection.

3.02 Work By Temperature Control Contractor

- A. Furnish interlock wiring per manufacturer's recommendations and install loose control components furnished by chiller manufacturer.

3.03 Work By Electrical Contractor

- A. Furnish power wiring to chiller control panel and obtain required code approval.
- B. Furnish and install approved disconnect switch.

END OF SECTION

Specifications subject to change without notice

INSTALLATION CLEARANCE

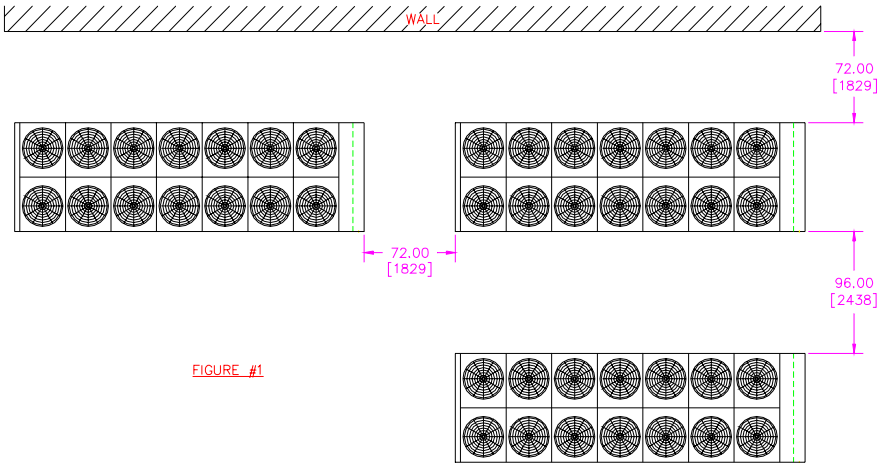


FIGURE #1




FIGURE #5
ACDRB021S-035S
LEVEL SURFACE - BACK TO WALL

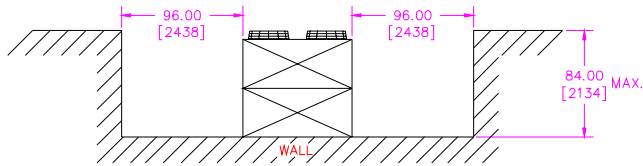


FIGURE #2
SINGLE PIT
(SEE NOTE 3)

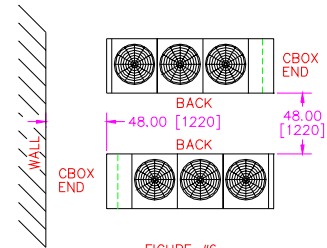


FIGURE #6
ACDRB021S-035S
LEVEL SURFACE - BACK TO WALL

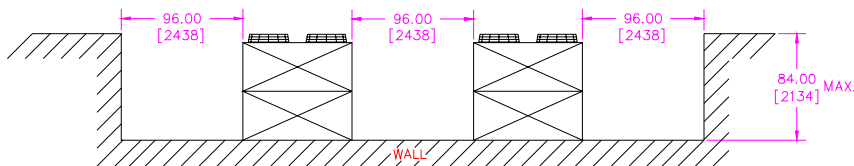


FIGURE #3
DOUBLE PIT
(SEE NOTE 3)

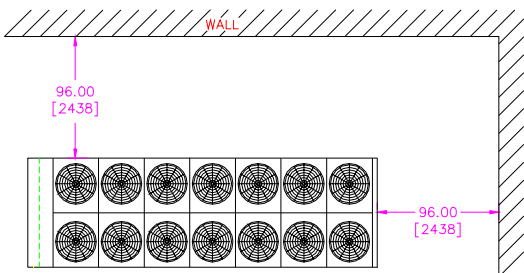


FIGURE #4
CORNER WALL

- NOTE:**
- 1) SCALE: 1/2" = 1" (INCHES) - 12.7MM = 25.4MM (MILLIMETERS)
 - 2) ALL DIMENSIONS ARE MINIMAL, UNLESS OTHERWISE NOTED.
 - 3) PIT INSTALLATIONS ARE NOT RECOMMENDED. RE-CIRCULATION OF HOT CONDENSER AIR IN COMBINATION WITH SURFACE AIR TURBULENCE CANNOT BE PREDICTED. HOT AIR RE-CIRCULATION WILL SEVERELY AFFECT UNIT EFFICIENCY (EER) AND CAN CAUSE HIGH PRESSURE TRIPS OR FAN MOTOR TEMPERATURE TRIPS. DUNHAM-BUSH WILL NOT BE RESPONSIBLE FOR DUCTING FANS TO A HIGHER LEVEL TO ALLEVIATE THE ABOVE MENTIONED CONDITIONS.
 - 4) REFERENCE DIMENSIONAL DRAWING 021681A0.



101 Burgess Road, Harrisonburg, VA 22801
Phone: 540-434-0711 FAX: 540-432-6690

www.dunham-bush.com